



REFERENCE:
G.E. DWG B28E539CA SH.10 REV.1

- NOTES:
1. TERMINALS WITHOUT LOCATION MARKS ARE LOCATED IN ANNUNCIATOR CAB. (1H13-P630)
 2. Δ DENOTES SEQUENCE OF EVENT RECORDER TERMINALS.
 3. ALPHABETICAL WIRE MARKS ARE PREFIXED BY: SYSTEM NO., SHEET NO., AND LINE NO. (EXAMPLE RG10101A).
 4. DEVICE DESIGNATIONS ARE PREFIXED BY: SYSTEM NO. (EXAMPLE IE21-K5).
 5. FOR GRAPHIC STANDARDS, REFER TO DRAWING B-208-001.
 6. POWER TO ISOLATORS IS SHOWN ON DWG B-208-060 SH. A07

LEGEND:

- EXTERNAL WIRE MARK (SEE NOTE 3)
- INTERNAL WIRE MARK
- 1H13-P621 DIV 1 AUX RELAY PNL (RCIC)
- 1H13-P629 DIV 1 AUX RELAY PNL (LPCS&RHR 'A')
- 1H13-P715 PGCC TERMINATION CAB
- DI CLASS IE-DIV 1
- AI ASSOCIATED-DIV 1

CONTINUED FROM DWG B-208-222 SH. 402

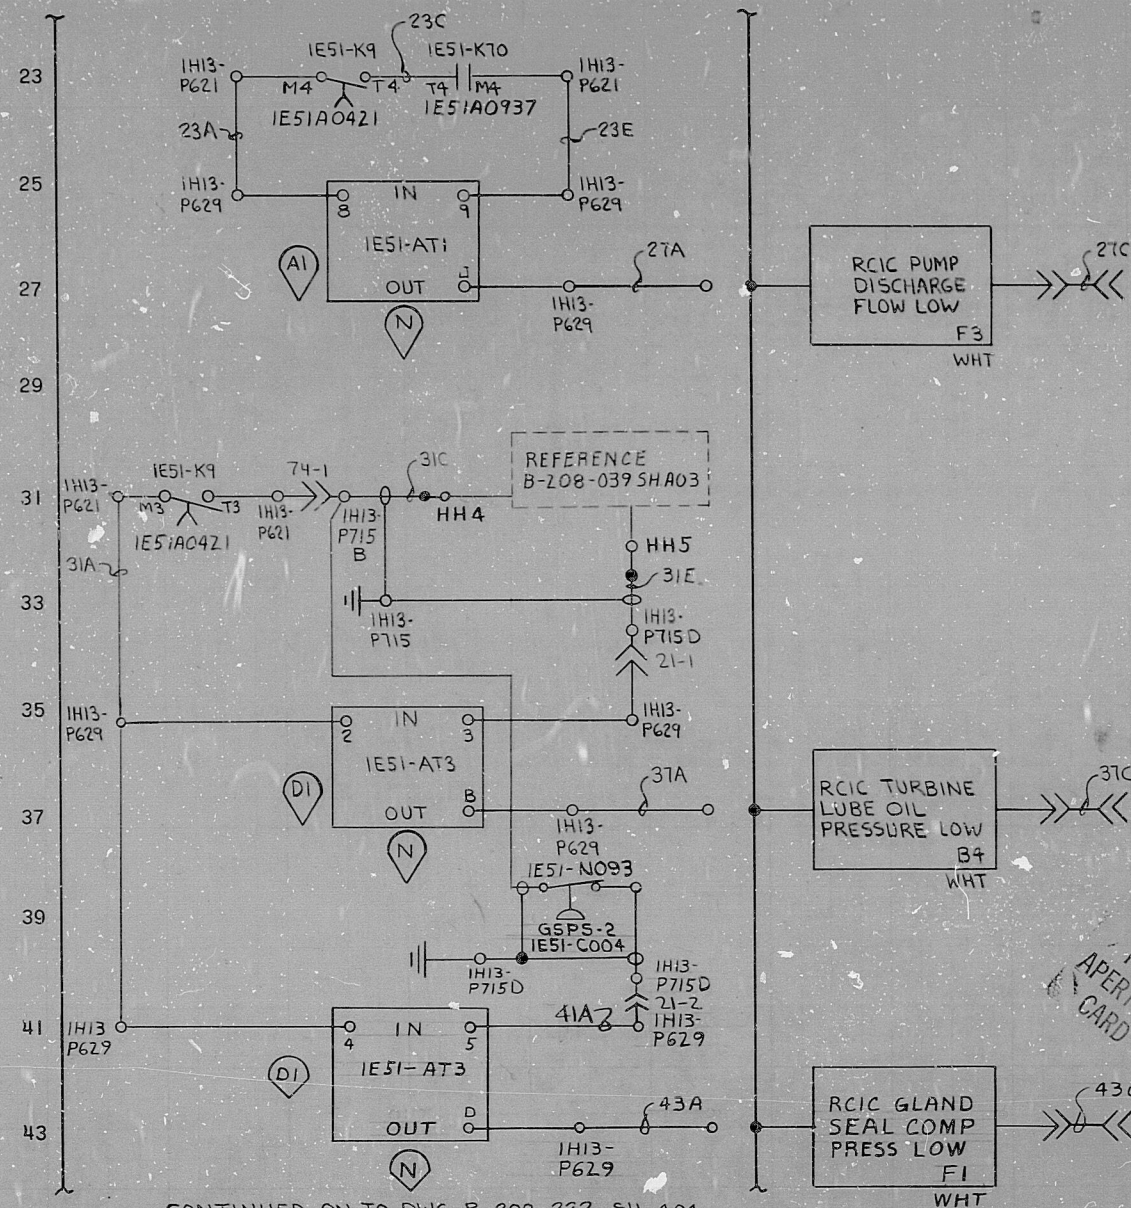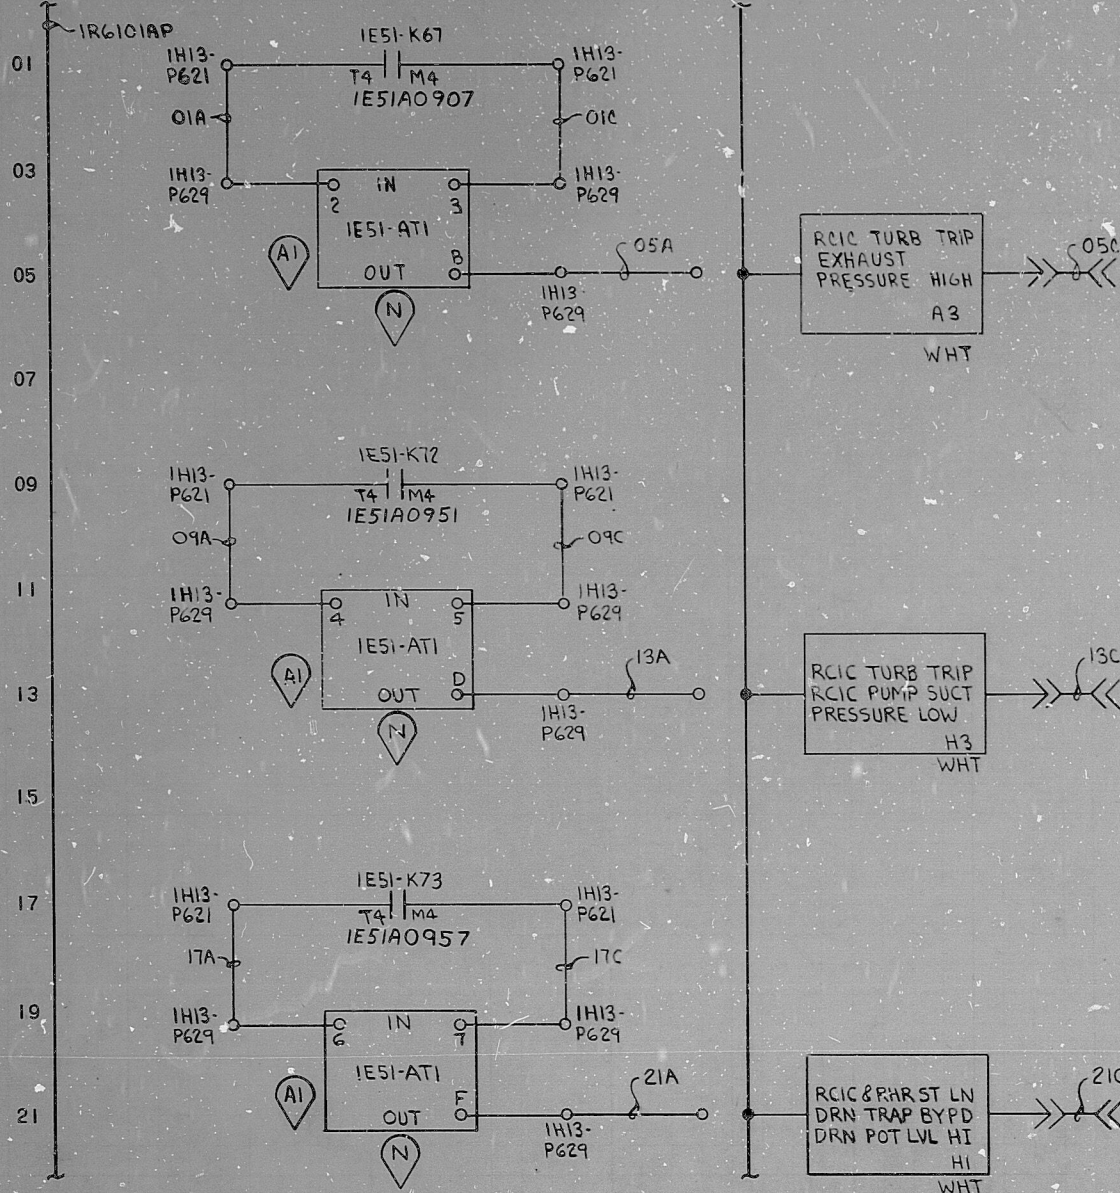

CONTINUED ON TO DWG B-208-222 SH. 404

AI DI NUCLEAR SAFETY RELATED

CHNG TERM LINE 31

F JH 3/1/77 12-31-78

CHG'D 1H13-P715D TO 1H13-P715B LINE 31, CHG'D REF. FOR IE51-N093 LINE 39

ADDED TERMINATION CABINET INFORMATION

NO ECN REQUIRED, REVISED LEVEL SW NUMBER LINE 39

NO ECN REQ. - ADDED WIRE MARK 41A ON LINE 41

REV PER ECN 245-033-01-123
ADDED REFERENCE LINE 31
REV. CKT LINES 31 & 39
REV NOTE 6 & REF. NO.
REV PER GE DRAWINGS.

CONSTRUCTION
PRELIMINARY
RELEASED FOR ENGR.

THE CLEVELAND ELECTRIC ILLUMINATING CO.

PERRY NUCLEAR POWER PLANT UNIT 1

ELECTRICAL-ELEMENTARY DIAGRAM

CONTROL ROOM ANNUNCIATOR, ECCS BENCHBOARD (1H13-P601) SECTION 21A

REV MADE CHKD APPROVALS DATE

REV MADE CHKD APPROVALS DATE

REV MADE CHKD APPROVALS DATE

REV MADE CHKD APPROVALS DATE

REV MADE CHKD APPROVALS DATE

READING PA. GILBERT ASSOCIATES, INC. ENGINEERS AND CONSULTANTS

044549-000 BIC BAT DG 04/1/77

REV MADE CHKD APPROVALS DATE

REV MADE CHKD APPROVALS DATE

REV MADE CHKD APPROVALS DATE

REV MADE CHKD APPROVALS DATE

REV MADE CHKD APPROVALS DATE

WORK ORDER MADE CHKD. DR. A. ENG. APP. DATE

04 4549 B-208-222 RG1 403 F

ELEM DIAG ANNUN WIRING RG1-403

RIDS-RDR

8103250018

