REFERENCES:
G.E. DWG. 828E531CA SH. A13 REV. Z

NOTES:
1. TERMINALS WITHOUT LOCATION MARKS ARE LOCATED IN ANNUNCIATOR CAB. (1H13-P630)
2. Δ DENOTES SEQUENCE OF EVENT RECORDER TERMINALS.
3. ALPHABETICAL WIRE MARKS ARE PREFIXED BY: SYSTEM NO., SHEET NO., AND LINE NO. (EXAMPLE R610101A).
4. DEVICE DESIGNATIONS ARE PREFIXED BY: SYSTEM NO. (EXAMPLE 1E21-K5).
5. FOR GRAPHIC STANDARDS, REFER TO DRAWING B-208-001.
6. POWER TO ISOLATORS IS SHOWN ON DWG. B-208-040 SH. A13
7. ANNUNCIATOR TERMINAL POINTS ARE JUMPERED INTERNALLY

LEGEND:
EXTERNAL WIRE MARK (SEE NOTE 3)
INTERNAL WIRE MARK
1H13-P691 - DIV. 1 RPS INSTR. & AUX RELAY PNL
1H13-P692 - DIV. 2 RPS INSTR. & AUX RELAY PNL
1H13-P693 - DIV. 3 RPS INSTR & AUX. RELAY PNL
1H13-P694 - DIV. 4 RPS INSTR & AUX RELAY PNL
A1 ASSOCIATED-DIV. 1
A2 ASSOCIATED-DIV. 2
A3 ASSOCIATED-DIV. 3
A4 ASSOCIATED-DIV. 4
1H13-P669 DIV. 1 NEUTRON POWER & RAD INSTRUMENTATION PANEL
1H13-P670 DIV. 2 NEUTRON POWER & RAD INSTRUMENTATION PANEL
1H13-P671 DIV. 3 NEUTRON POWER & RAD INSTRUMENTATION PANEL
1H13-P672 DIV. 4 NEUTRON POWER & RAD INSTRUMENTATION PANEL

CONTINUED FROM DWG B-208-222 SH. 109

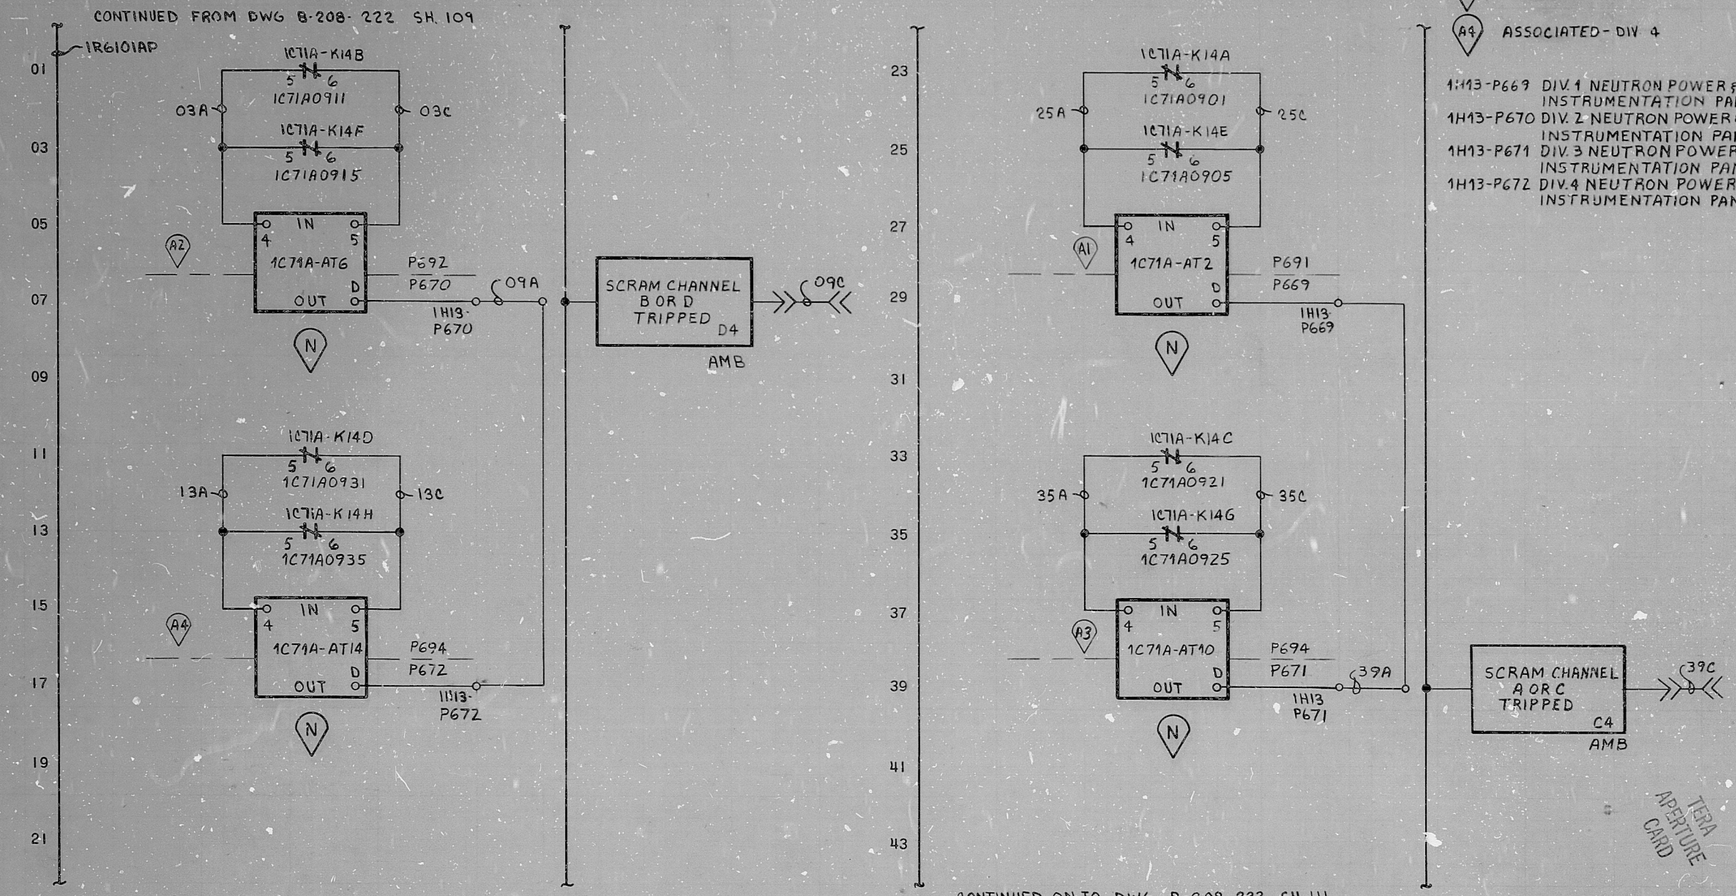

A1 A2 A3 A4 NUCLEAR SAFETY RELATED

THE CLEVELAND ELECTRIC ILLUMINATING CO.
PERRY NUCLEAR POWER PLANT UNIT 1
ELECTRICAL-ELEMENTARY DIAGRAM
CONTROL ROOM ANNUNCIATOR
UNIT CONTROL CONSOLE (1H13-P680)
SECTION 5A

DATE	RELEASED FOR	ENGR.
8/1/77	CONSTRUCTION	
	PRELIMINARY	

REV. PER ECN 245-033-01-35
REV. 1C71A-AT2,6,10 & 14
REV. DIV. SYMBOL
REV. REF. & LEGEND

GILBERT ASSOCIATES, INC.
ENGINEERS AND CONSULTANTS

READING	PA.	WORK ORDER	MADE	CHKD.	DR. APP.	ENG. APP.	DATE
A	BZC	044549-000	BZC	BAT	DG		8/1/77

DRAWING NUMBER			SYSTEM	SH. NO.	REV.
04	4549	B-208-222	R61	1.0	A

REV	MADE	CHKD	APPROVALS	DATE
A	BZC			8/1/77

FILEM DIAGRAM WIRING R611-110

RIDS-PDR

8103310292

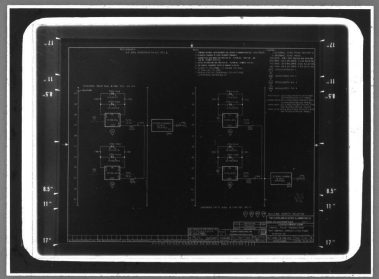

MMM 5824 — FILMSORT® Brand Aperture & Camera Cards and DUPLICARD® Brand Copy Cards — Products of 3M Company, St. Paul, Minn.