


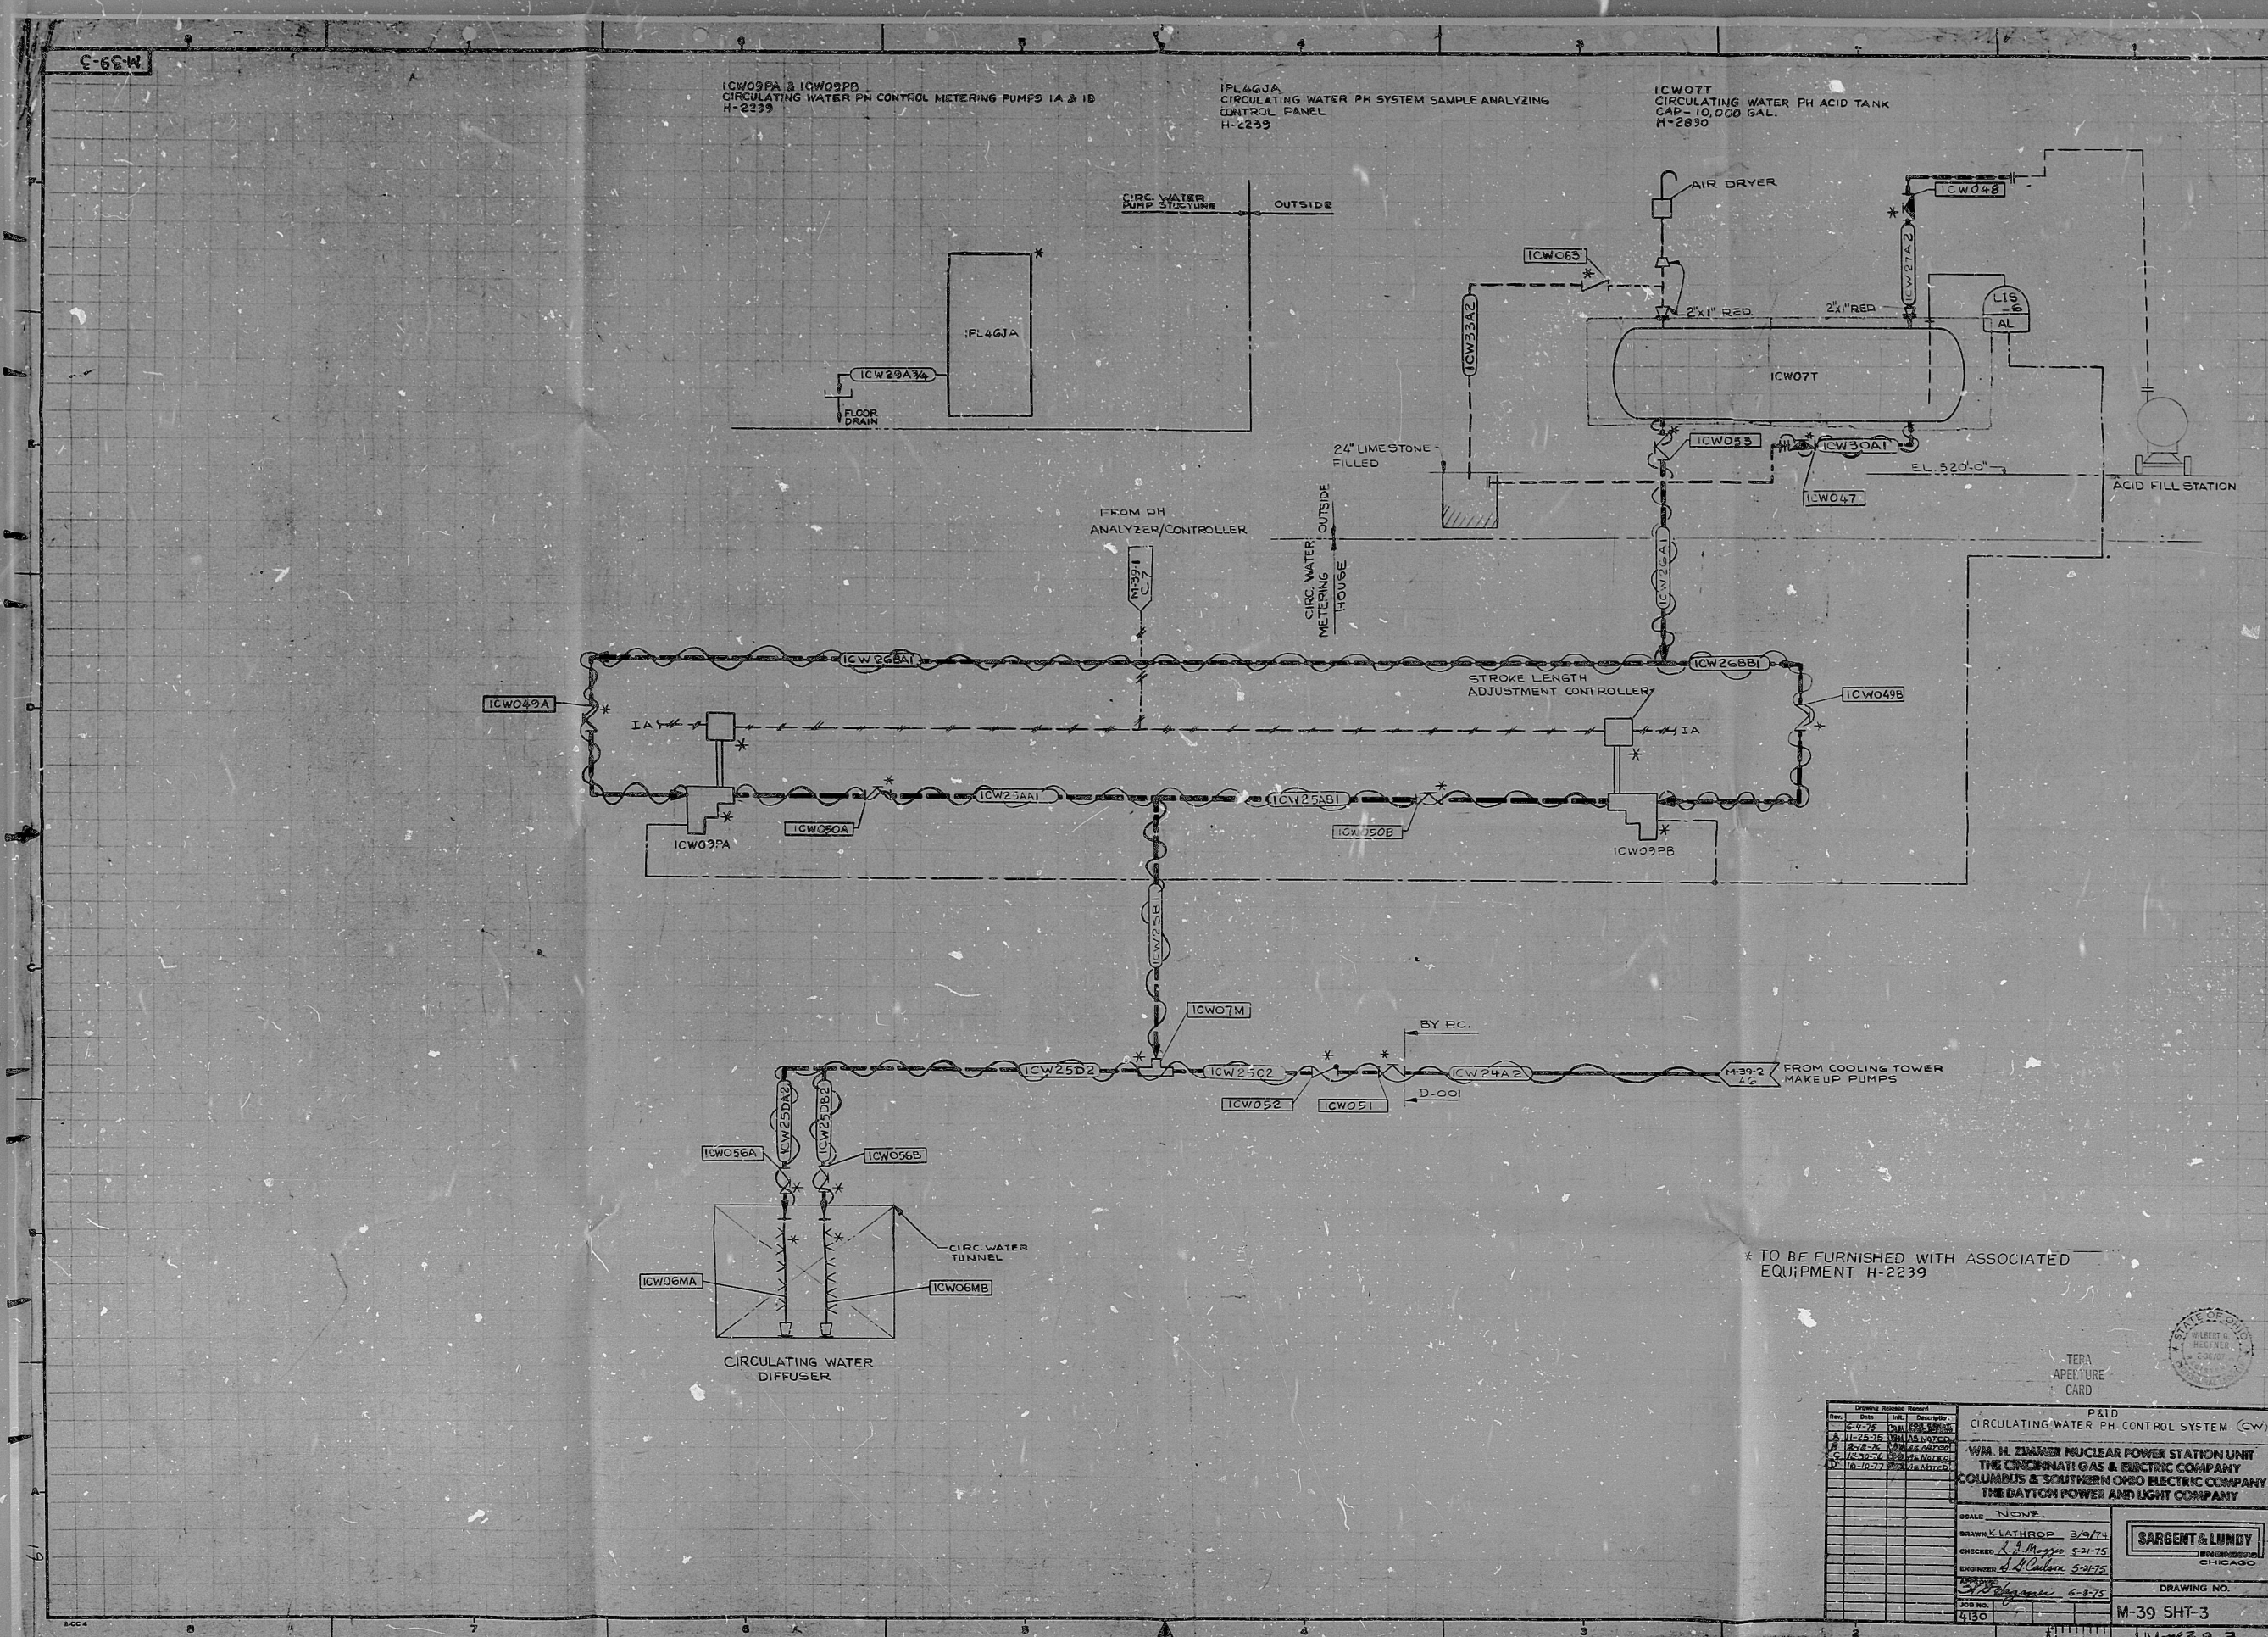

* TO BE FURNISHED WITH ASSOCIATED EQUIPMENT H-2239

TERA
APERTURE
CARD

Drawing Release Report Rev. 1 Date 11-15-72 By 1001/1001 2 11-25-72 By 1001/1001 3 12-2-72 By 1001/1001 4 12-26-72 By 1001/1001 5 12-27-72 By 1001/1001		PAID CIRCULATING WATER PH CONTROL SYSTEM (CW) WPA. H. ZIMMER NUCLEAR POWER STATION UNIT THE CINCINNATI GAS & ELECTRIC COMPANY COLUMBUS & SOUTHERN OHIO ELECTRIC COMPANY THE DAYTON POWER AND LIGHT COMPANY
SCALE NONE DRAWN BY KATHROP 2-9-74 CHECKED BY M. J. M. 5-21-75 ENGINEER BY J. L. C. 5-21-75 APPROVED BY J. L. C. 5-21-75	SARGENT & LUNDY CHICAGO	
DRAWING NO. M-39 SHT-3 4130	1M-39-3	

REDS-PDR

8104010324

