



22"

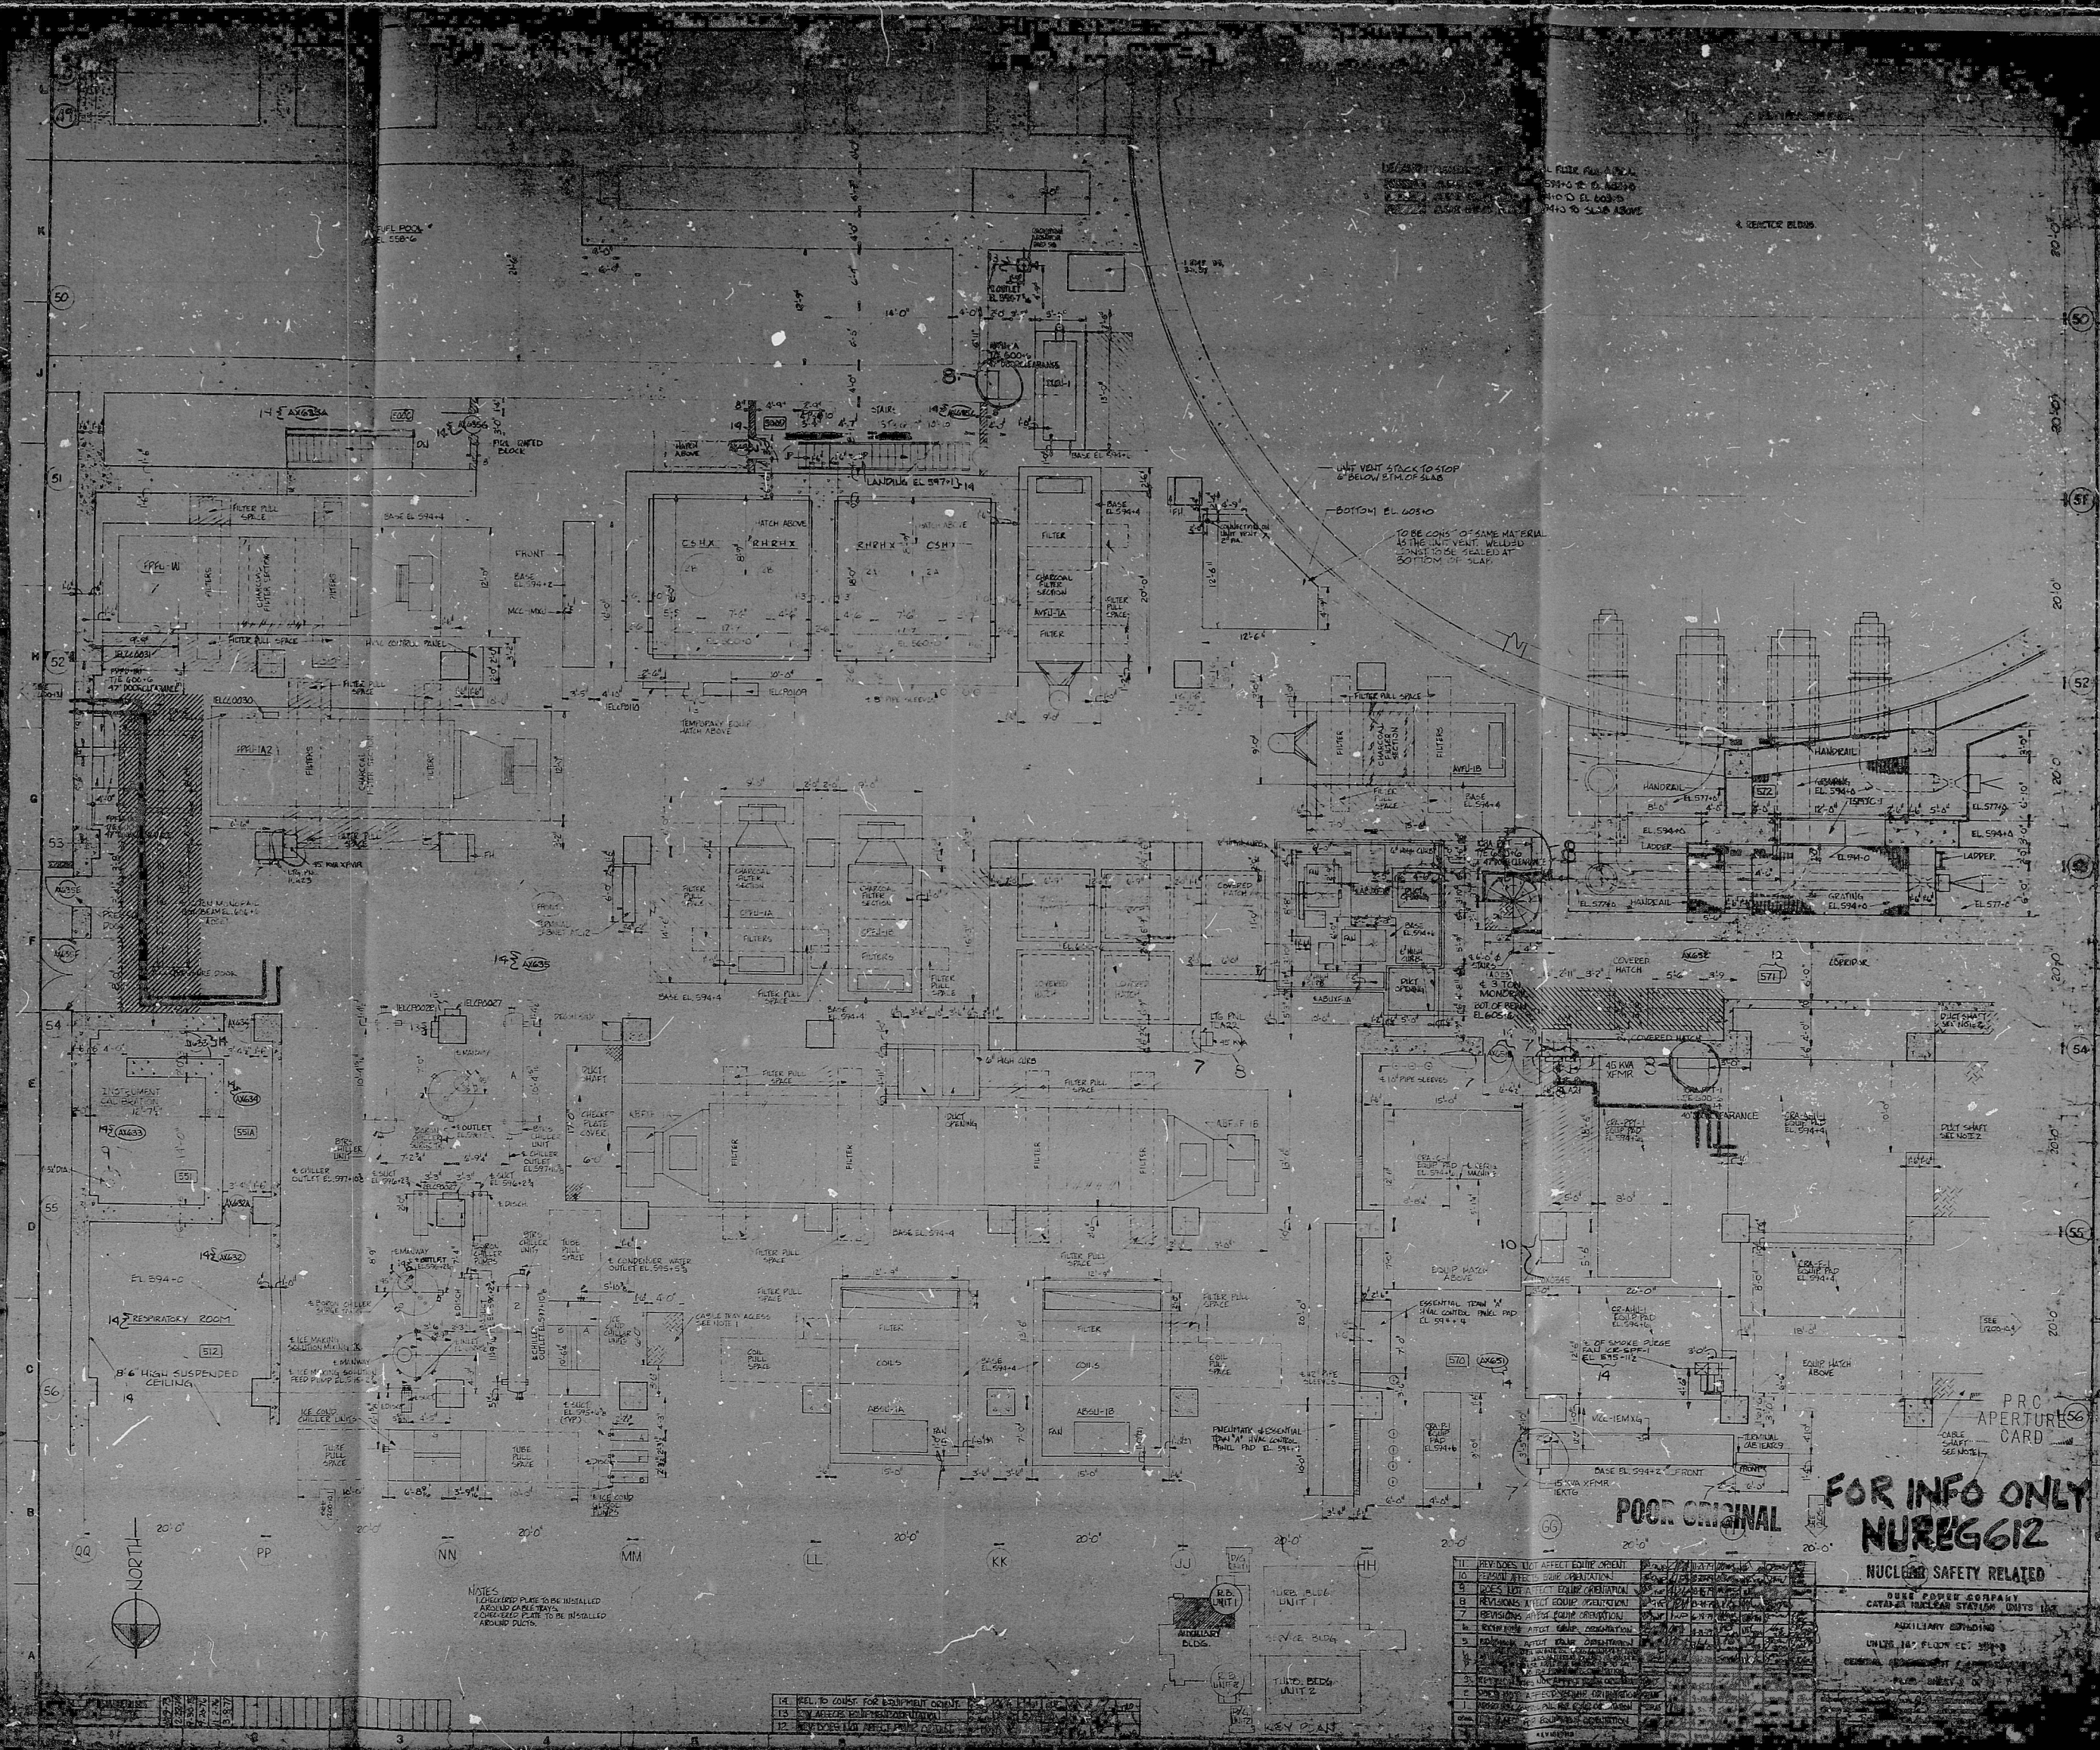

NOTES
1. LEAKAGE PLATE TO BE INSTALLED
AROUND CABLE TRAYS
2. CABLE TRAY TO BE INSTALLED
AROUND PLATE

- 1. REL. TO CONST. FOR EQUIPMENT ORIENT.
- 2. REL. TO CONST. FOR EQUIPMENT ORIENT.
- 3. REL. TO CONST. FOR EQUIPMENT ORIENT.
- 4. REL. TO CONST. FOR EQUIPMENT ORIENT.
- 5. REL. TO CONST. FOR EQUIPMENT ORIENT.
- 6. REL. TO CONST. FOR EQUIPMENT ORIENT.
- 7. REL. TO CONST. FOR EQUIPMENT ORIENT.
- 8. REL. TO CONST. FOR EQUIPMENT ORIENT.
- 9. REL. TO CONST. FOR EQUIPMENT ORIENT.
- 10. REL. TO CONST. FOR EQUIPMENT ORIENT.
- 11. REL. TO CONST. FOR EQUIPMENT ORIENT.
- 12. REL. TO CONST. FOR EQUIPMENT ORIENT.

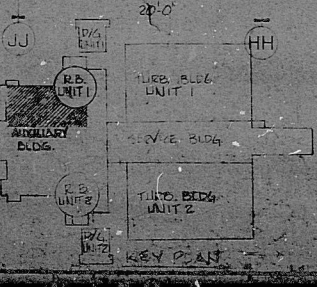

POOL ORIGINAL

FOR INFO ONLY
NUREGG612

NUCLEAR SAFETY RELATED

DUKE POWER COMPANY

CATAWBA NUCLEAR STATION, UNIT 1

AUXILIARY BUILDING

UNIT 1, 1ST FLOOR, ECT. 100-1

GENERAL ARRANGEMENT

PLAN, SHEET 1 OF 1

NO.	REVISIONS	DATE	BY	CHKD.
1	REVISED TO REFLECT EQUIP. ORIENT.	10/1/71	J. H. HARRIS	J. H. HARRIS
2	REVISED TO REFLECT EQUIP. ORIENT.	10/1/71	J. H. HARRIS	J. H. HARRIS
3	REVISED TO REFLECT EQUIP. ORIENT.	10/1/71	J. H. HARRIS	J. H. HARRIS
4	REVISED TO REFLECT EQUIP. ORIENT.	10/1/71	J. H. HARRIS	J. H. HARRIS
5	REVISED TO REFLECT EQUIP. ORIENT.	10/1/71	J. H. HARRIS	J. H. HARRIS
6	REVISED TO REFLECT EQUIP. ORIENT.	10/1/71	J. H. HARRIS	J. H. HARRIS
7	REVISED TO REFLECT EQUIP. ORIENT.	10/1/71	J. H. HARRIS	J. H. HARRIS
8	REVISED TO REFLECT EQUIP. ORIENT.	10/1/71	J. H. HARRIS	J. H. HARRIS
9	REVISED TO REFLECT EQUIP. ORIENT.	10/1/71	J. H. HARRIS	J. H. HARRIS
10	REVISED TO REFLECT EQUIP. ORIENT.	10/1/71	J. H. HARRIS	J. H. HARRIS
11	REVISED TO REFLECT EQUIP. ORIENT.	10/1/71	J. H. HARRIS	J. H. HARRIS
12	REVISED TO REFLECT EQUIP. ORIENT.	10/1/71	J. H. HARRIS	J. H. HARRIS

RIDS

8207130115

