



FOR ADDITIONAL ALARM AND INDICATION REQUIREMENTS SEE REF 3


REACTOR REGULATION SYSTEM

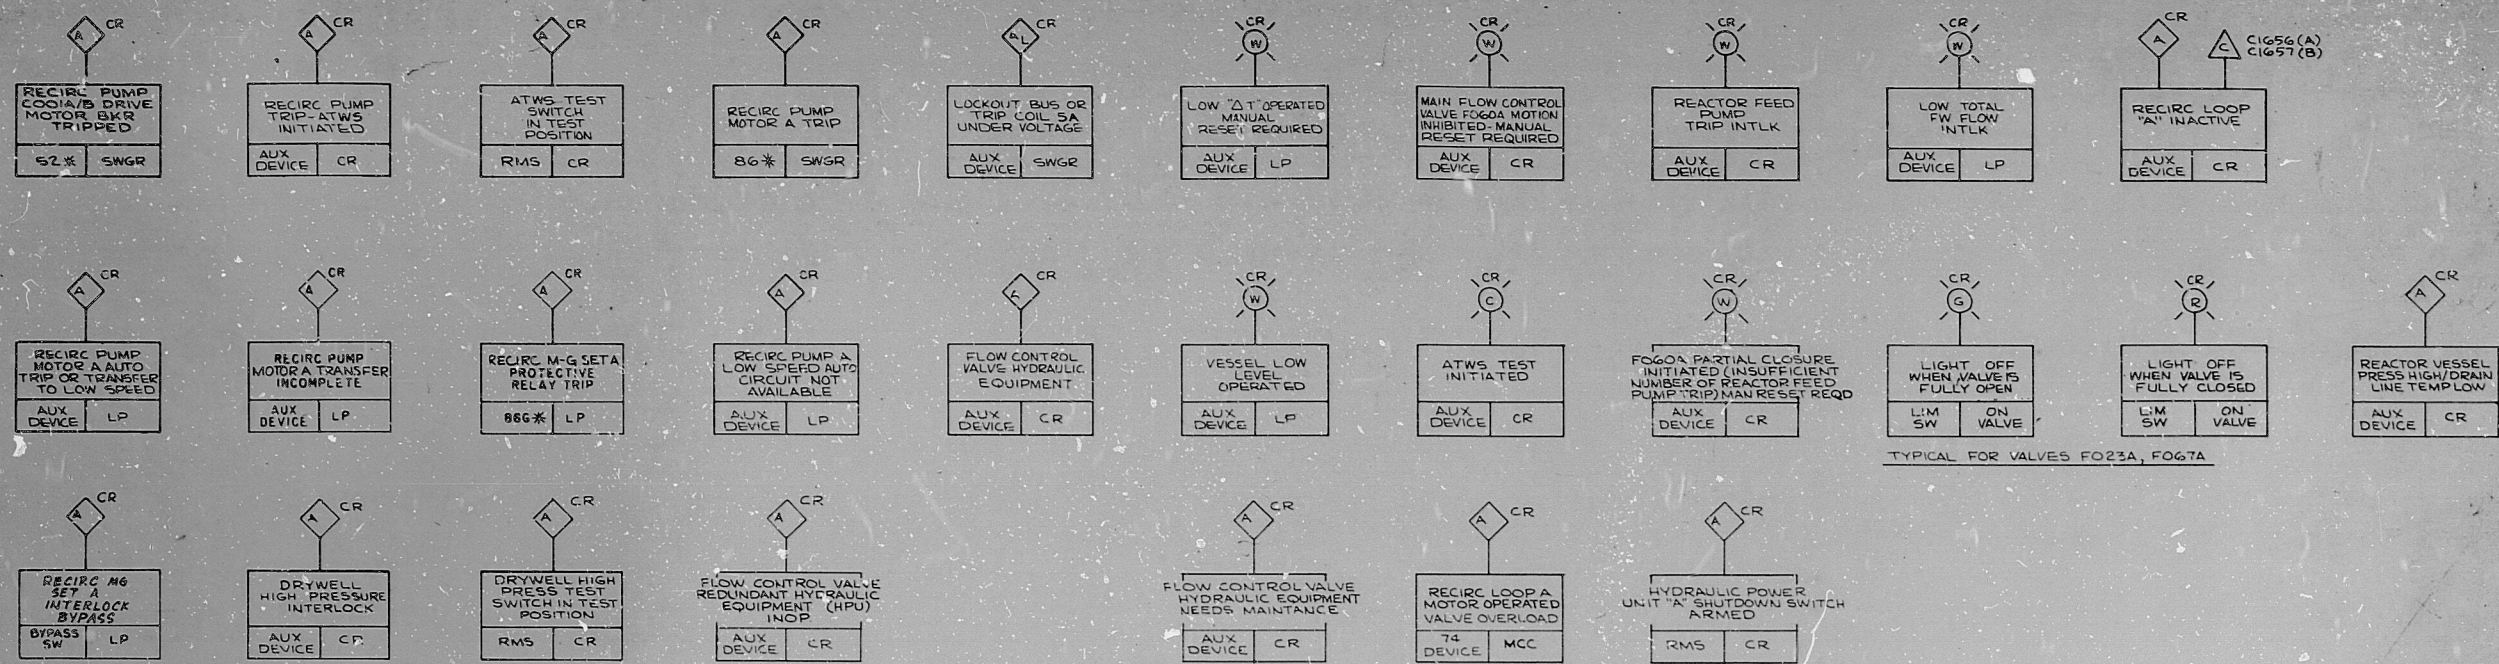

TYPICAL FOR VALVES FO23A, FO67A

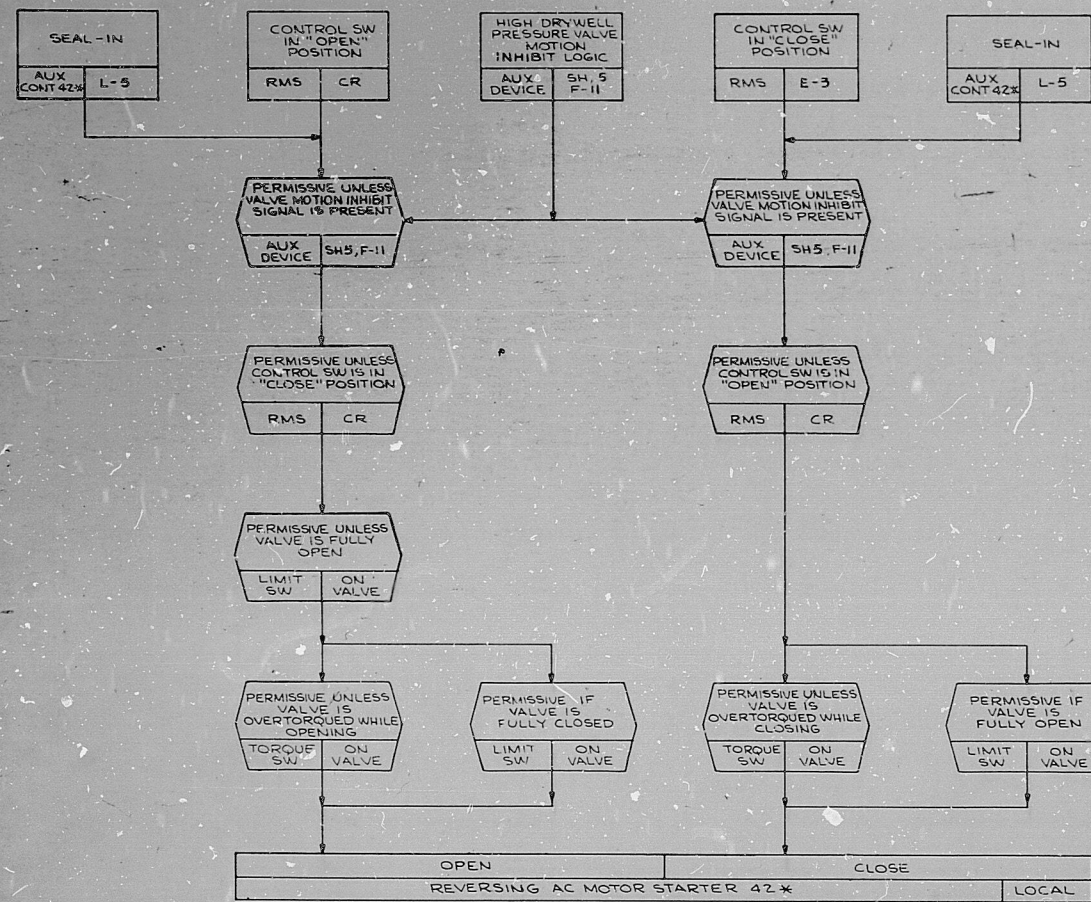

PUMP DISCHARGE VALVE FO67A

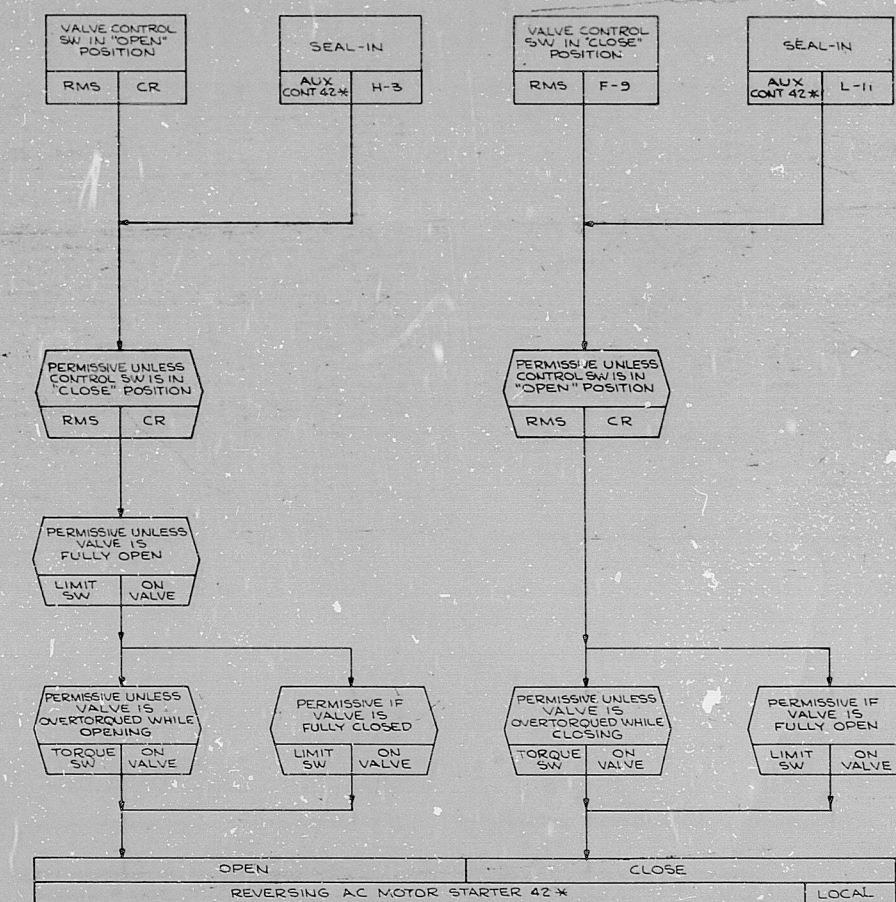

PUMP SUCTION VALVE FO23A

THE CLEVELAND ELECTRIC ILLUMINATING CO.
REACTOR REGULATION SYSTEM
APPROVED: [Signature]
NOTED: [Signature]
RETURNED FOR: [Signature]
GILBERT ASSOCIATES, INC.
REV 2879 4549

8104060863

