


This drawing and the design it covers is the property of the utilities which are participating in the SNUPPS Project. It is loaned on the borrower's express agreement that it will not be reproduced, copied, loaned, exhibited, or used except in the limited way and provided use permitted by written consent given by the SNUPPS Utilities to the borrower.

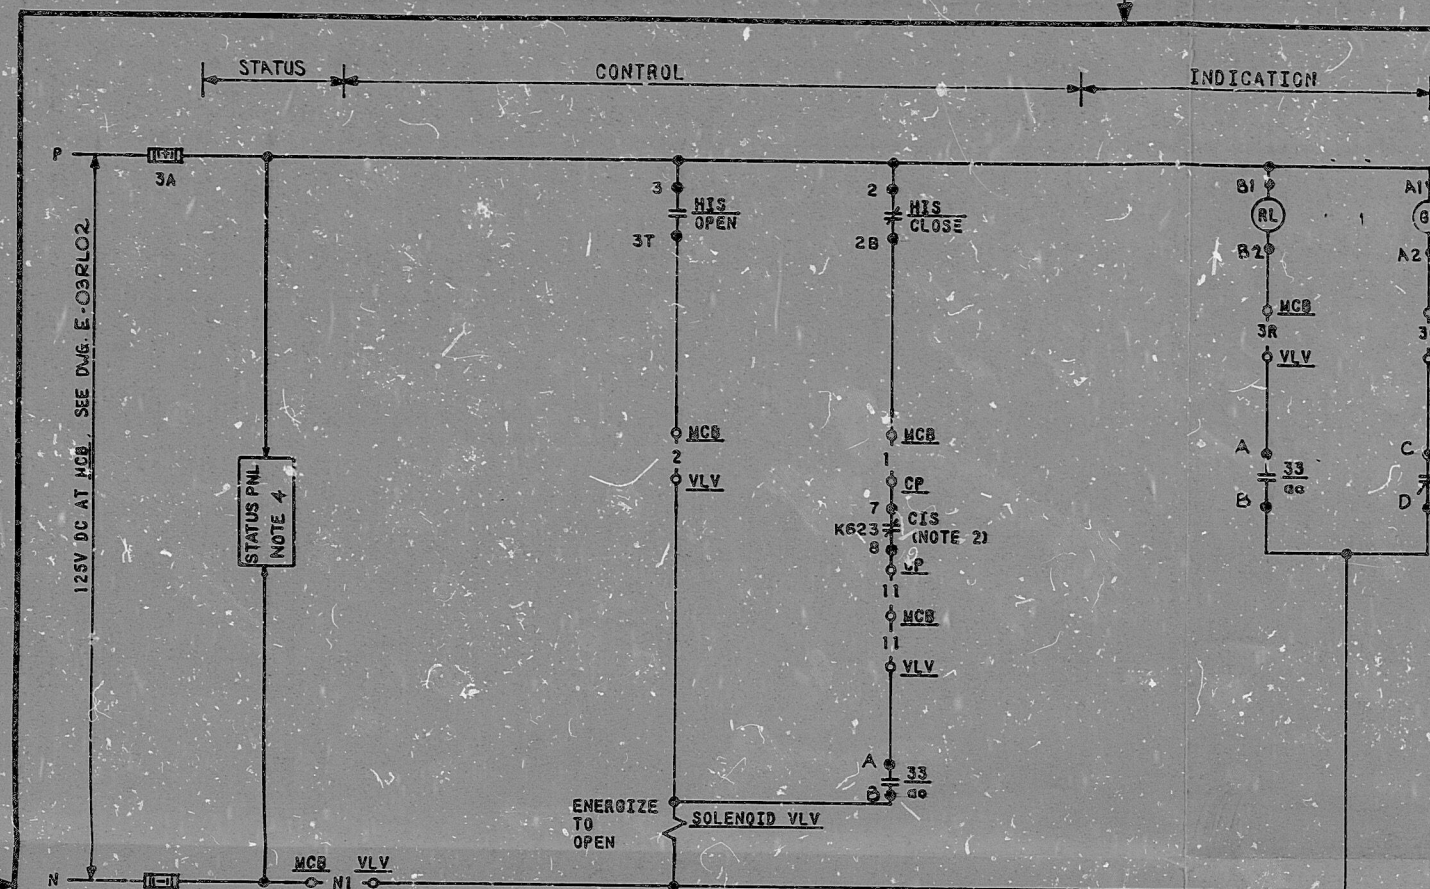

OPEN		CONTACT		POSITION	
BL	RL			NORM	CLOSE OPEN
1	1	1	1	X	X
2	2	2	2	X	X
3	3	3	3	X	X
4	4	4	4	X	X

CUTLER-HAMMER
TYPE E30 JY15
WITH TWO KLA-3
CONTACT BLOCKS

HAND INDICATING SWITCH
HIS-SEE TABLE
OPEN SW. MOMENTARY
CLOSE SW. MAINTAINED

DEVICE 33 - POSITION SWITCHES		VALVE POSITION		FUNCTION	
CONTACT		CLOSED	OPEN		
1	1			RED LIGHT	
2	2			GREEN LIGHT	
3	3			SPARE	
4	4			SPARE	

SOLID BAR INDICATES CONTACT CLOSED
LIMIT SWITCH TYPE NAMCO:
EA - 180-15303
EA - 180-14303


REF. DWGS:
M-02BLO1

TABLE B

COMPUTER REF. DWG.	J-106-0115
COMPUTER POINT	BLZ8047
COMPUTER LOCATION-PC	RJ:60A
VALVE LOCATION-VLV	BLHV8047
COMPUTER SCHEME NO.	48LR01A

TABLE A

HIS NUMBER	BLHIS8047
HIS LOCATION-MCB	RLOOI
LOCATION-CP	SB032C
VALVE NO.-VLV	BLHV8047
SCHEME NO.	48LR01A

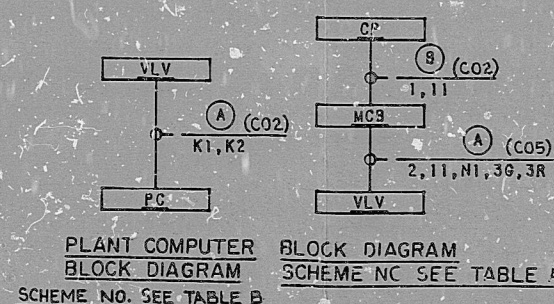

REVIEW LEVEL 3

- TI
APERTURE
CARD
- FOR STATUS PANEL CABLE PULL, SEE DWG. E-035A16.
 - TO STATUS PANEL, SEE DWG. E-035A13.
 - CONTACT OPENS ON CONTAINMENT ISOLATION SIGNAL. FOR DETAILS, SEE WESTINGHOUSE DWG, BECHTEL V. P. M-767-181.
 - VALVE FAILS CLOSED

REV'D POS. SW. FCTING	REV'D POS. SW. FCTING	REV'D POS. SW. FCTING	REV'D POS. SW. FCTING	REV'D POS. SW. FCTING	REV'D POS. SW. FCTING
PART NO. TO INCORP.	PART NO. TO INCORP.	PART NO. TO INCORP.	PART NO. TO INCORP.	PART NO. TO INCORP.	PART NO. TO INCORP.
SERIAL NO. 12-2-31-0074	SERIAL NO. 12-2-31-0074	SERIAL NO. 12-2-31-0074	SERIAL NO. 12-2-31-0074	SERIAL NO. 12-2-31-0074	SERIAL NO. 12-2-31-0074
REVISED LIMIT SWITCH	REVISED LIMIT SWITCH	REVISED LIMIT SWITCH	REVISED LIMIT SWITCH	REVISED LIMIT SWITCH	REVISED LIMIT SWITCH
PART NO.	PART NO.	PART NO.	PART NO.	PART NO.	PART NO.
ISSUED FOR CONSTRUCTION	ISSUED FOR CONSTRUCTION	ISSUED FOR CONSTRUCTION	ISSUED FOR CONSTRUCTION	ISSUED FOR CONSTRUCTION	ISSUED FOR CONSTRUCTION
NO.	DATE	REVISIONS	BY	CHK	DESIGN
SCALE	RESTORED TY	DRAWN	CAD	CHIEF	ENGR
BECHTEL					
GAITHERSBURG, MARYLAND					
SNUPPS					
SCHEMATIC DIAGRAM					
PRESSURIZER RELIEF TANK TO REACTOR					
MAKE-UP WATER SUPPLY ISOLATION VALVE					
UTILITY DRAWING NO.					
KEY					
JOB NO.					
10486					
BECHTEL DRAWING NO.					
E-038LJ1 (Q)					
KEY					
5					
DRAWING APPLICABLE TO SHEETS					
1 2 3 4 5 6 7 8 9 10					

I certify that the image contained on this frame was made in the normal and regular course of business, on the date stated below and that it is an accurate reproduction of the document(s) submitted to Micrographics.
DATE 6-23-93 OPERATOR *red Kennedy* SUPERVISOR *quinn mep*

16X

DATADRAFT

PDR RIDS

8506240704

