
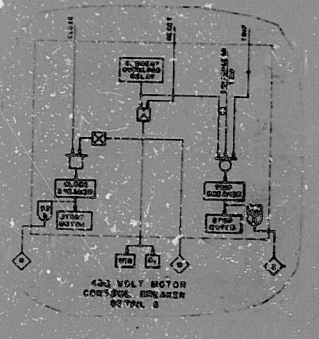


237127A-E039

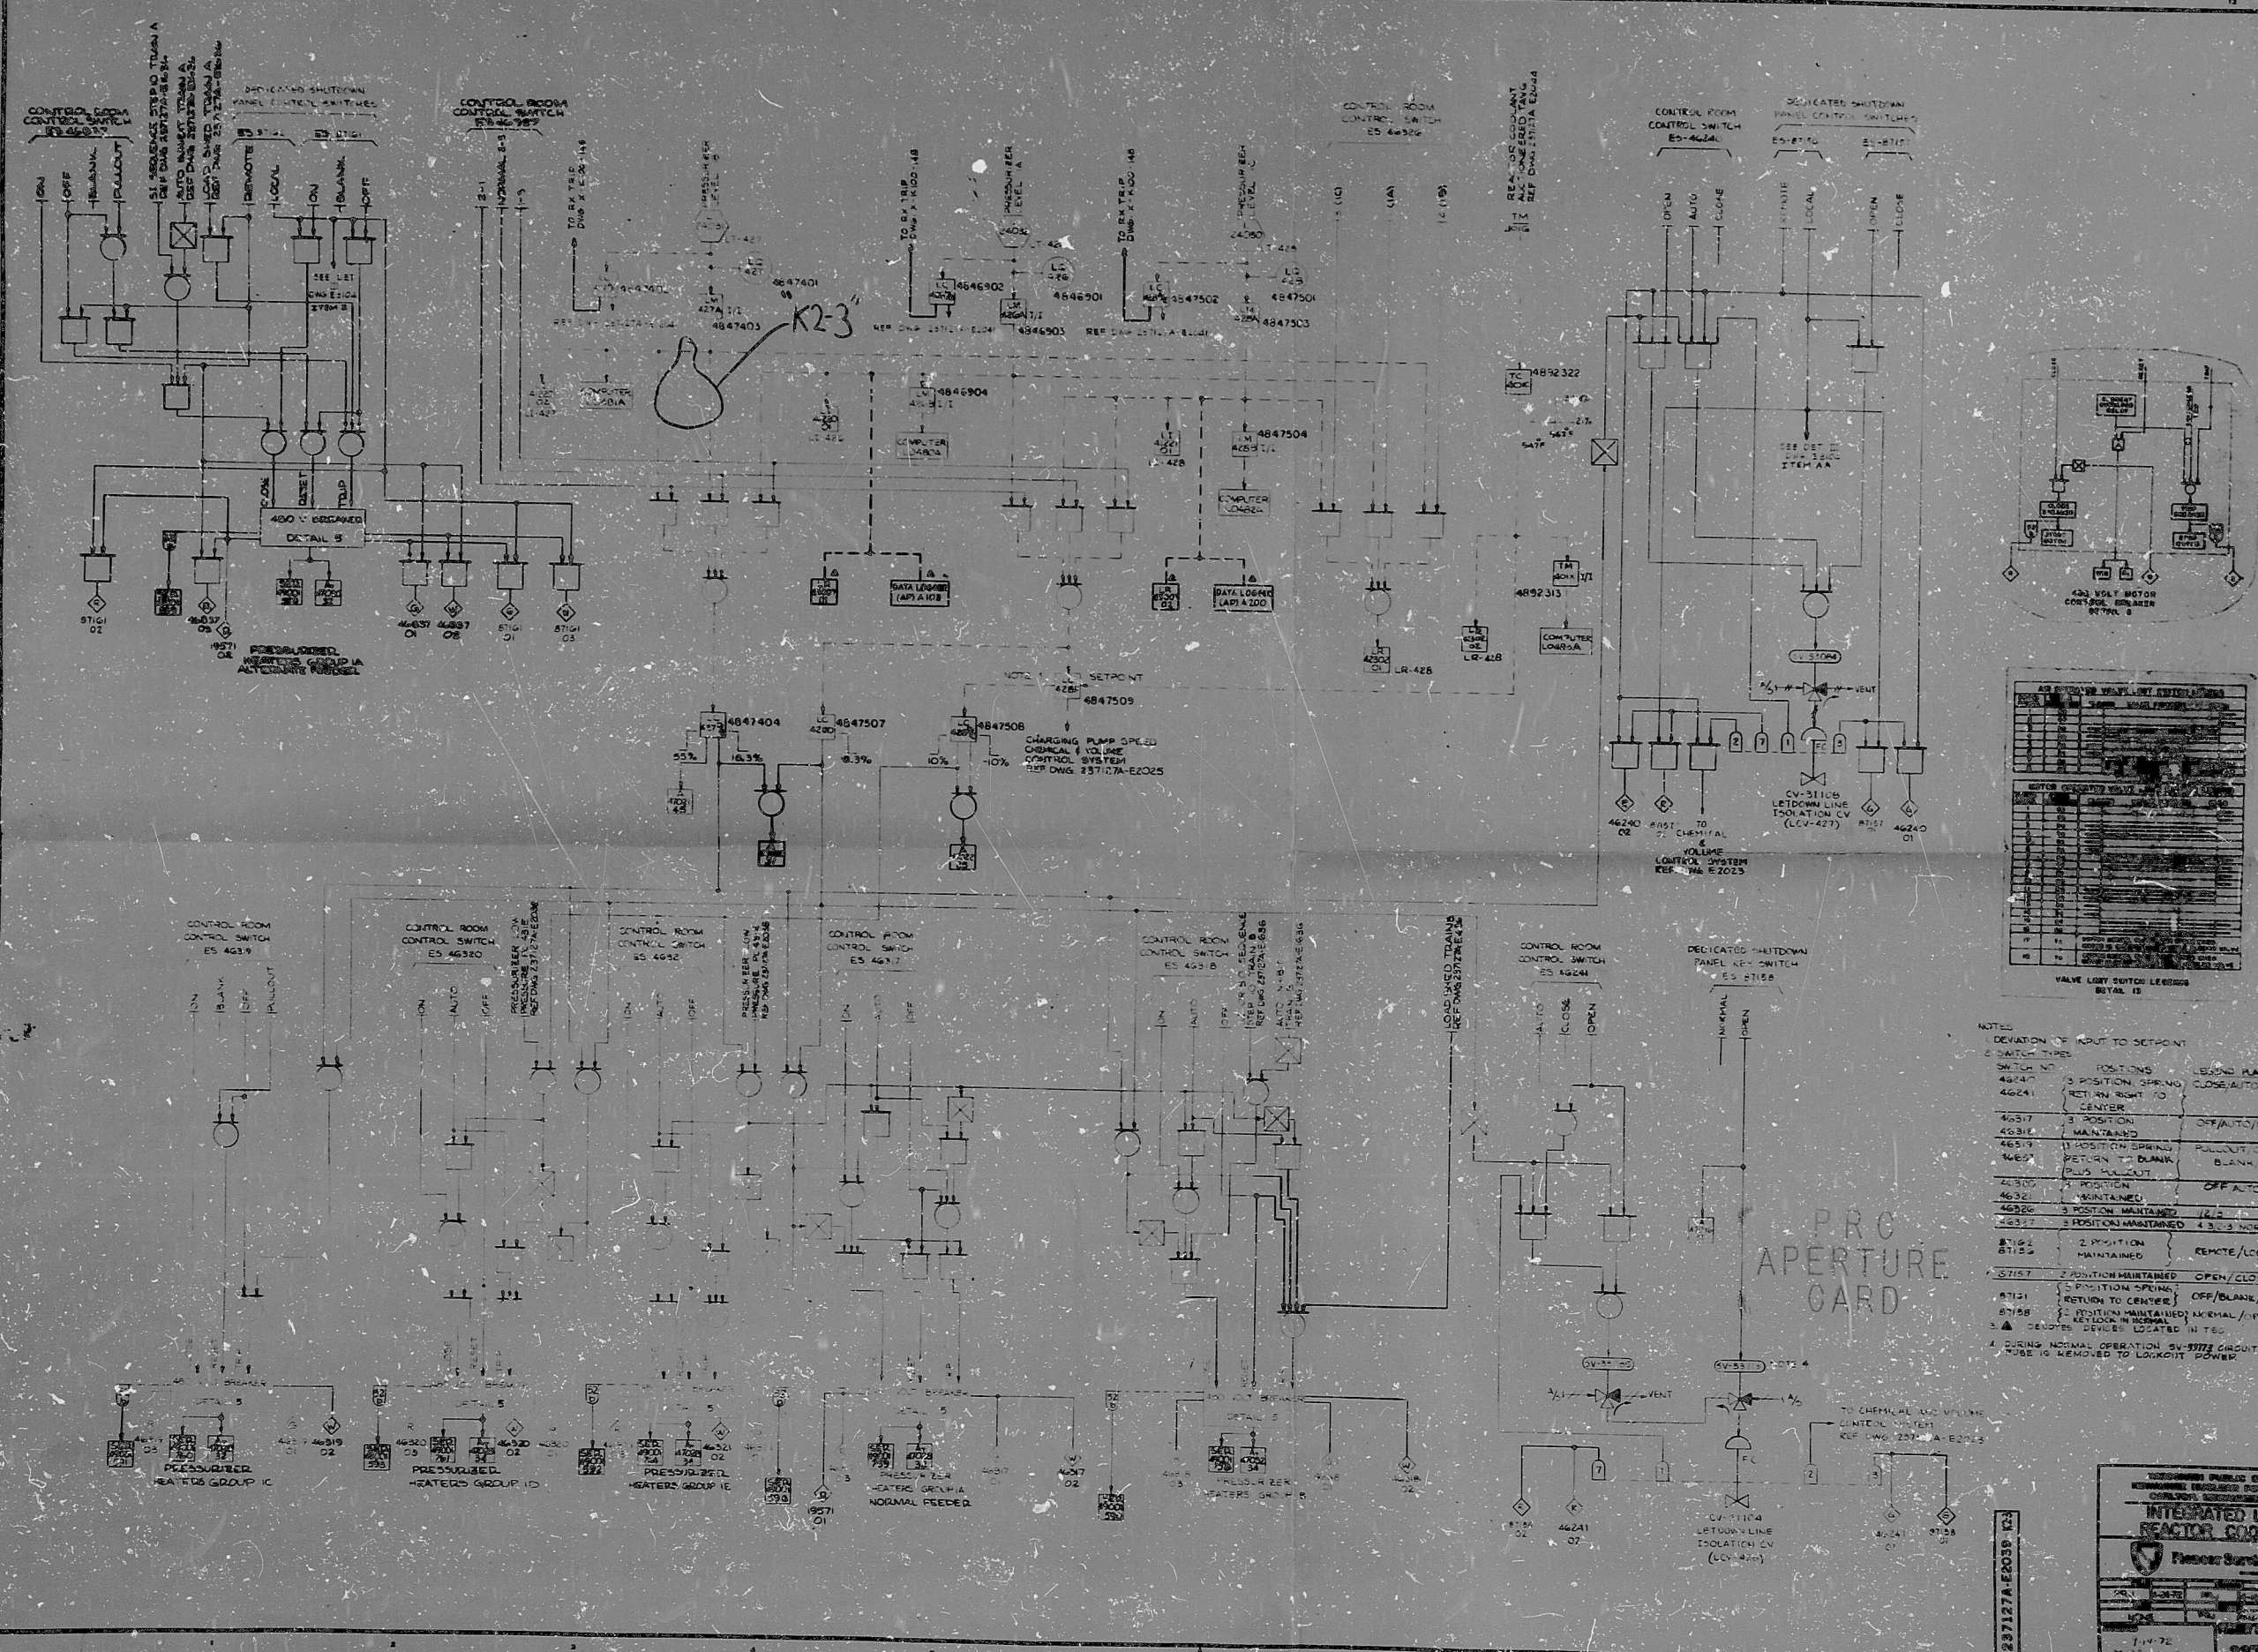

AS SHOWN VALVE LIST LOGIC

NO.	NAME	FUNCTION	STATUS
1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20

- NOTES
1. SWITCH TYPES
- 46319 3 POSITION SPRING CLOSE/AUTO/OPEN
 - 46324 3 POSITION SPRING CLOSE/AUTO/OPEN
 - 46317 3 POSITION CENTER OFF/AUTO/ON
 - 46318 MAINTAINED
 - 46319 3 POSITION SPRING PULLOUT/DEF BLANK/ON
 - 46320 3 POSITION MAINTAINED 4.5 MONTHS
 - 46321 3 POSITION MAINTAINED 4.5 MONTHS
 - 5115A 2 POSITION MAINTAINED OFF/AUTO/ON
 - 5115B MAINTAINED REMOTE/LOCAL
 - 5115C 2 POSITION MAINTAINED OFF/BLANK/ON
 - 5115D 2 POSITION MAINTAINED KEYS LOCK/MAINTAINED
 - 5115E 2 POSITION MAINTAINED KEYS LOCK/MAINTAINED
2. DURING NORMAL OPERATION, VALVE CASSETTE NUMBER IS REMOVED TO LOCKOUT POWER.

PRO APERTURE CARD

237127A-E039

REVISIONS

NO.	DATE	DESCRIPTION
1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20

237127A-E039-K2-3

GENERAL PUBLIC SERVICE CORPORATION

REACTOR COOLANT SYSTEM

INTEGRATED LOGIC DIAGRAM

PIECEWISE ENGINEERING CO.

1-14-72

237127A-E039-K2-3

1309120495

RIDS

8309120495

