


NOTES: CONTACTS (A12-B12)(AG-BG)(C11-D11)(C1-D1)(C5-D5) AND (C7-D7) WILL BE OPEN WHEN LOCAL-REMOTE CONTROL SWITCH IN NO1 (NO2) IS IN LOCAL POSITION.

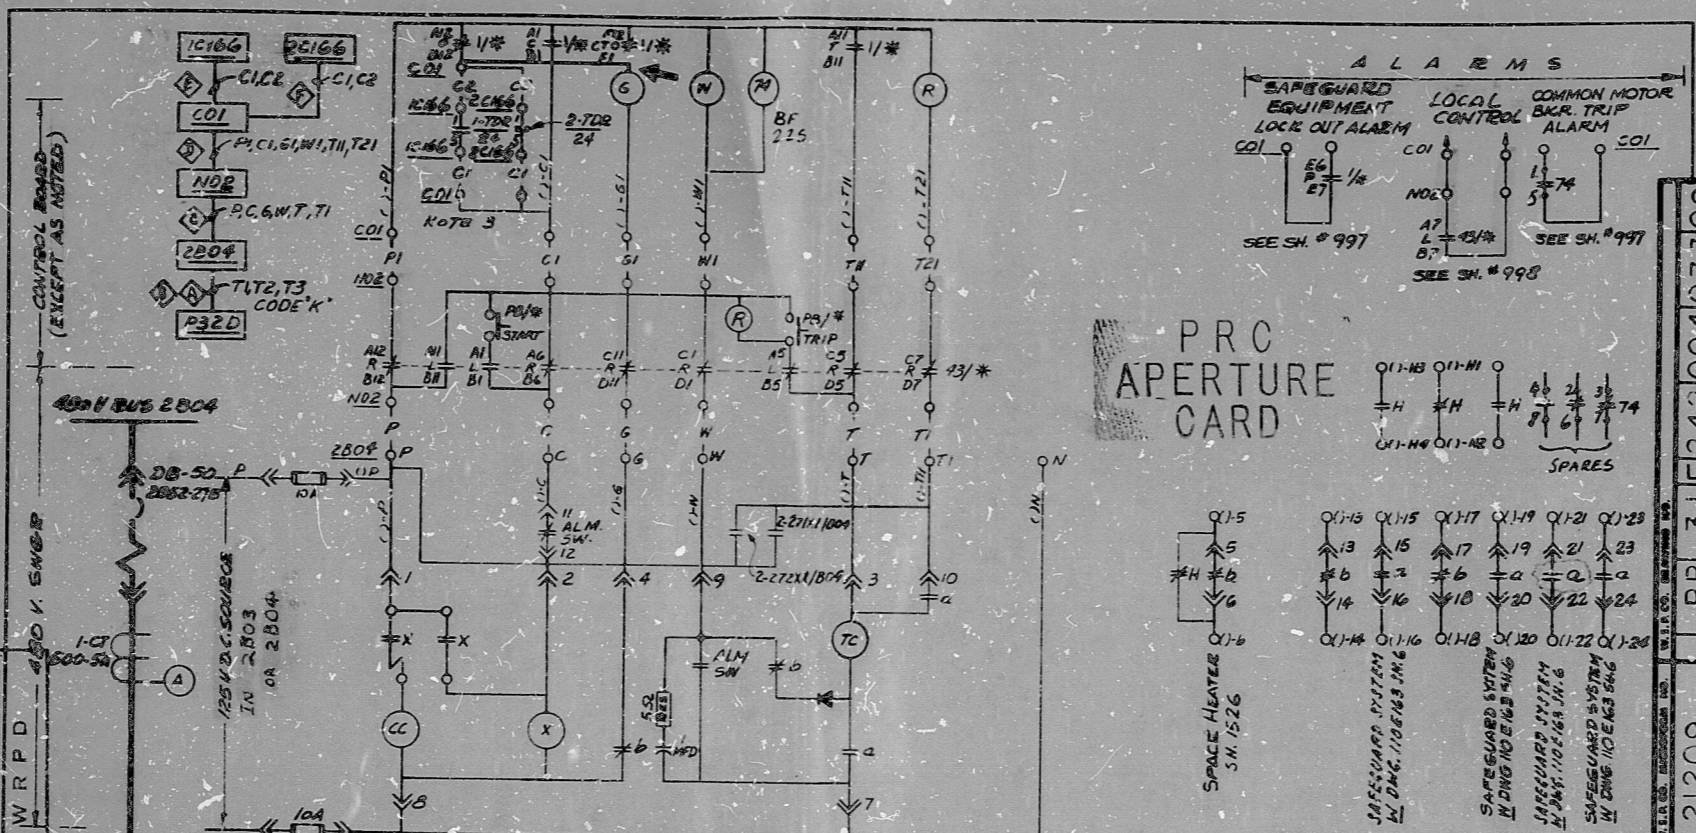


APPROVED
BY: TOM-B-526 DATE: 8-6-69
WESTINGHOUSE
PWR PPD 480V 5W/B

SCHEME 2827B
SWGR UNIT No. 27B - S.G. CHANNEL B
SWGR UNIT No. 27C - S.G. CHANNEL B
SWGR UNIT No. 34A - S.G. CHANNEL A

RMP No.	SCHEM. No.	SWGR No.	SCHEM. No.	U.K. RELAY No.	LOC. CODE	RELAY	SL. LOCATION
P32D	2827B	2827B	2827B	2-2701/1008 2-2701/1008	NO2	14202-24	1420166
P32E	2827C	2827C	2827C	2-2712/1009 2-2712/1009	NO2	14202-25	1420166
P32F	2827A	2827A	2827A	2-2711/1008 2-2711/1008	NO1	14202-15	1420156

PRC APERTURE CARD

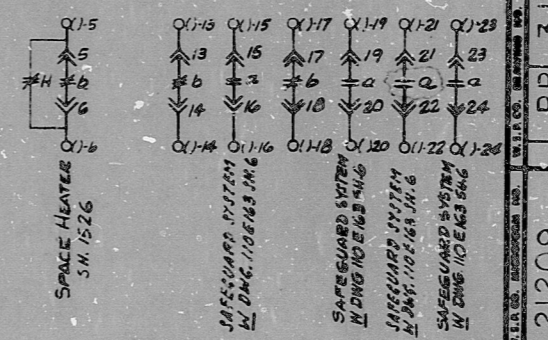

NOTES:
1-13/* P32D [P32E] [P32F] SEE SH. 60 DEK 3, N.P.E.
2-1/* P32D [P32E], [P32F] (SEE SH. 60 DET 1)
3- SEE W. DWG. 10E 163 64.12
4- P32D [P32E] [P32F] LOCAL TRIP BUTTOL.

BRCHTEL
SAN FRANCISCO
WESTINGHOUSE ELECTRIC CORPORATION
ATOMIC POWER DIVISION
WISCONSIN MICHIGAN POWER COMPANY
POINT BEACH NUCLEAR PLANT UNIT 2
ELEMENTARY WIRING DIAG. SERV. W. PUMP P32D P32E P32F
DATE: 7-23-69
DRAWN: L.M. CANN
CHECKED: R.R.
499B466
BRCHTEL JOB No. 6118
BRCHTEL DATE No. E-2071 ENL 1 REV. 7
UNIT 202

21209
PB 31E124210041077109

826190783

21209

RIDS

8210190783

