


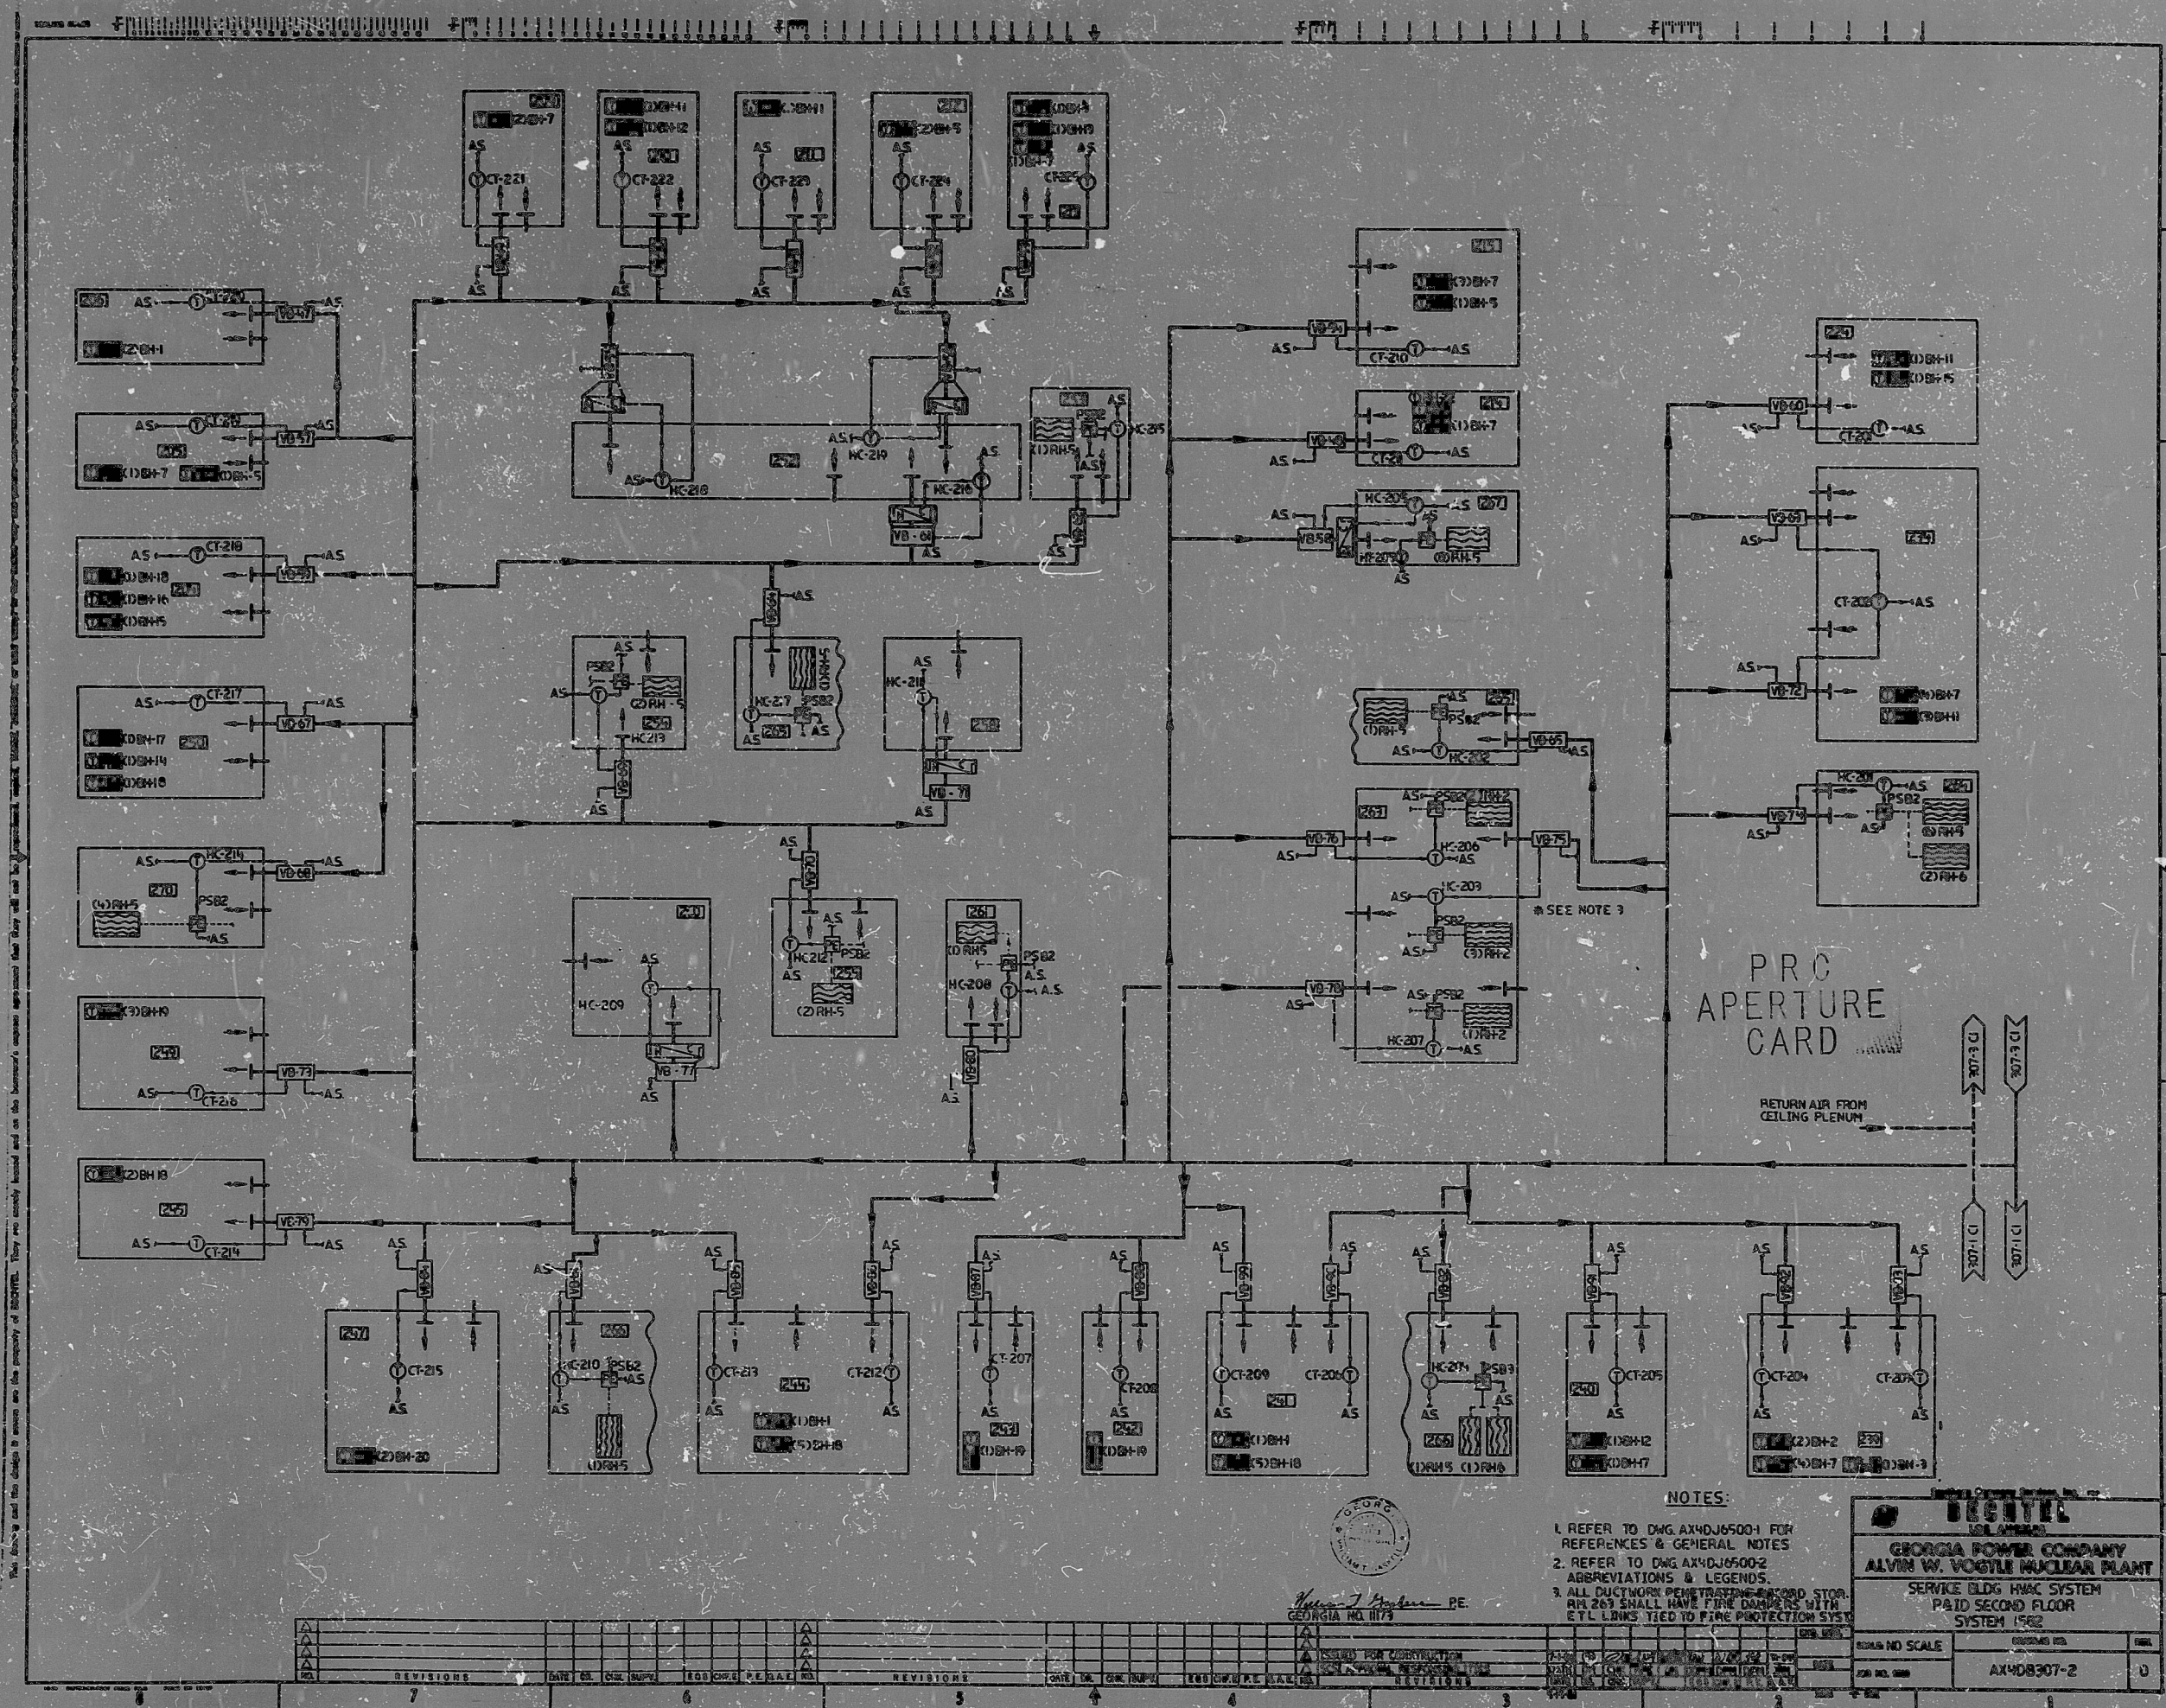

- NOTES:
1. REFER TO DWG. AX40J65001 FOR REFERENCES & GENERAL NOTES
  2. REFER TO DWG. AX40J65002 ABBREVIATIONS & LEGENDS.
  3. ALL DUCTWORK PENETRATING RECORD STORAGE SHALL HAVE FIRE DAMPERS WITH ETL LINKS TIED TO FIRE PROTECTION SYSTEM

|                                                              |              |
|--------------------------------------------------------------|--------------|
| <b>GEORGIA POWER COMPANY</b><br>ALVIN W. VOGUE NUCLEAR PLANT |              |
| SERVICE BLDG HVAC SYSTEM<br>PAID SECOND FLOOR<br>SYSTEM 1962 |              |
| DRAWING NO. SCALE                                            | AX40J65002-2 |
| DATE                                                         | 10/1/62      |
| BY                                                           | PE           |

| NO. | REVISION                   | DATE    | BY | CHKD. | APP'D. |
|-----|----------------------------|---------|----|-------|--------|
| 1   | AS ISSUED FOR CONSTRUCTION | 10/1/62 | PE |       |        |
| 2   | REVISION                   |         |    |       |        |
| 3   | REVISION                   |         |    |       |        |
| 4   | REVISION                   |         |    |       |        |
| 5   | REVISION                   |         |    |       |        |
| 6   | REVISION                   |         |    |       |        |
| 7   | REVISION                   |         |    |       |        |

RIDS

8309270425

