
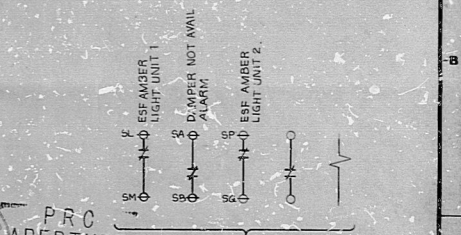
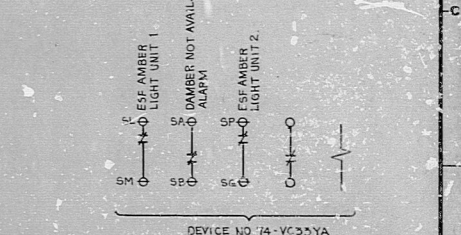
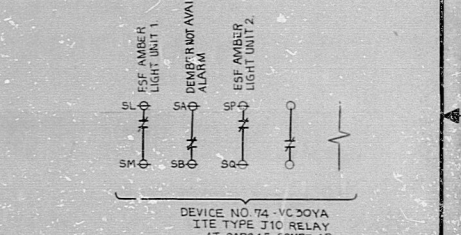
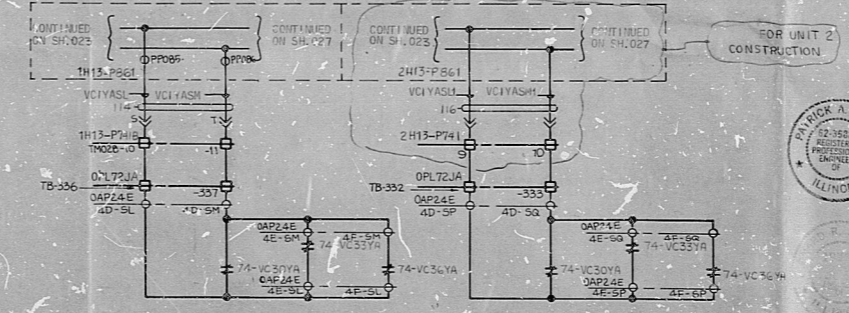




CONTACTS	SYMBOL	DAMPER POSITION		
		FULL CLOSE	INTER-MEDIATE	FULL OPEN
A — — B	IC	X	X	
C — — D	O			X
E — — F	O			X
G — — H	IC	X	X	
A — — B	C	X		
C — — D	IO		X	X
E — — F	IO		X	X
G — — H	C	X		

X - DENOTES CONTACT CLOSED  
 LIMIT SW. IN SCHEMATIC SHOWN WITH DAMPER IN FULLY CLOSED POSITION  
 NMCQ TYPE EATD-31302 & 32302

LIMIT SWITCH DEVELOPMENT (LS)  
 TYPICAL FOR: OVC30YA, OVC33YA & OVC36YA



DRAWING RELEASE RECORD					DRAWING RELEASE RECORD				
REV	DATE	REV'D	APPROVED	PURPOSE	REV	DATE	REV'D	APPROVED	PURPOSE
A	8-26-77	J. J. ...	[Signature]	FOR FGCC FABRICATION ONLY. SPEC. NO. K-2891	A	8-26-77	J. J. ...	[Signature]	FOR FGCC FABRICATION ONLY. SPEC. NO. K-2891
B	10-6-77	[Signature]	[Signature]	REVISED PER MFG & ENGR COMMENTS. SPEC. NO. K-2891	B	10-6-77	[Signature]	[Signature]	REVISED PER MFG & ENGR COMMENTS. SPEC. NO. K-2891
C	7-1-79	[Signature]	[Signature]	REVISED PER ENGR NO. 12-15 DATED 12-11-77	C	7-1-79	[Signature]	[Signature]	REVISED PER ENGR NO. 12-15 DATED 12-11-77
D	12-28-79	[Signature]	[Signature]	REVISED FOR INTERNAL MFG. REV. FOR CONST. SPEC. NO. K-2911	D	12-28-79	[Signature]	[Signature]	REVISED FOR INTERNAL MFG. REV. FOR CONST. SPEC. NO. K-2911
E	02-23-81	[Signature]	[Signature]	REVISED FOR PANEL FABRICATION. SPEC. NO. K-2911	E	02-23-81	[Signature]	[Signature]	REVISED FOR PANEL FABRICATION. SPEC. NO. K-2911
F	04-20-81	[Signature]	[Signature]	MISC. REV. FOR CONSTRUCTION. SPEC. NO. K-2993	F	04-20-81	[Signature]	[Signature]	MISC. REV. FOR CONSTRUCTION. SPEC. NO. K-2993
G	01-15-82	[Signature]	[Signature]	REVISED FOR CONSTRUCTION. SPEC. NO. R-2977 & PNL. P.A.M., SPEC. NO. 2911	G	01-15-82	[Signature]	[Signature]	REVISED FOR CONSTRUCTION. SPEC. NO. R-2977 & PNL. P.A.M., SPEC. NO. 2911
H	5-3-82	[Signature]	[Signature]	REVISED FOR CONSTRUCTION. SPEC. NO. K-8000	H	5-3-82	[Signature]	[Signature]	REVISED FOR CONSTRUCTION. SPEC. NO. K-8000

NUCLEAR SAFETY RELATED EQUIPMENT IS SHOWN ON THIS DRAWING.  
 (FOR SAFETY CLASSIFICATION SEE EQUIPMENT, VALVE, OR INSTRUMENT LISTS.)

SCHMATIC DIAGRAM  
 CONTROL ROOM HVAC SYSTEM (VC)  
 CONTROL ROOM SUPPLY AIR A ZONE & ISOLATION  
 DAMPERS OVC30YA, OVC33YA & OVC36YA  
 CLINTON POWER STATION UNIT 1  
 ILLINOIS POWER COMPANY  
 CLINTON, ILLINOIS

SCALE: NONE  
 PROJECT NUMBER: 4536

DRAWING NO. E02-OVC59  
 SHEET 025 OF 02

RID3

8210220099

