
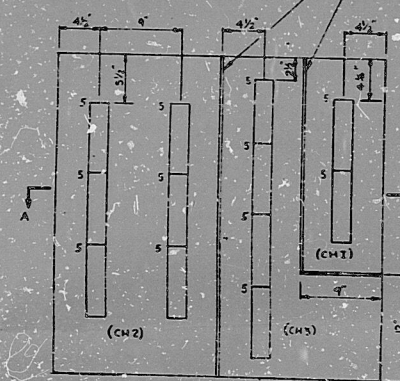
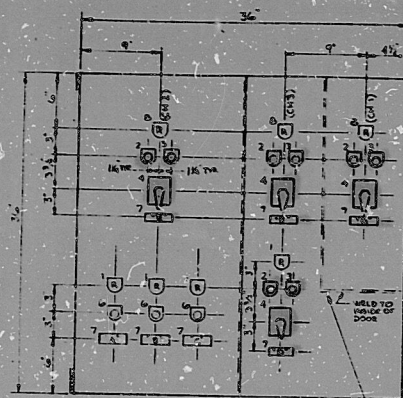
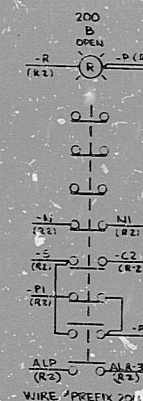
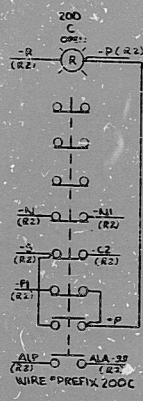


NOTE:
WIRING FROM TERMINAL BLOCKS TO DOOR
MOUNTED DEVICES TO BE CARRIED PER
CHANNEL AS INDICATED BY CHANNEL NO.


NOTES

- 1 - STATION TO BE 35"x36"x10" DEEP-112GA. SHEET STL.-TO MEET NEMA TYPE 1" GENERAL PURPOSE ENCLOSURE STANDARDS.
- 2 - FINISH-ASA 61-GRAY
- 3 - PROVIDE MOUNTING HOLES IN BACK-SUITABLE FOR WALL MOUNTING.
- 4 - SWITCHES, INDICATING LIGHTS, & PUSHBUTTONS TO BE WIRED TO TERMINAL BLOCKS IN STATION (MADE WITH WIRE POS. AS SHOWN) PER W. DIAG. 8971, SHTS. 9-13-24-39-72-73-80-122 (U.S.C. P. 9-322-05-3307).
- 5 - DOORS TO BE 612 GA. STL. WITH CONTINUOUS HINGE MOUNTING & 3-POINT LATCH WITH KEY-LOCKING HANDLE.
- 6 - NAMEPLATES TO BE BLACK PHENOLIC/WHITE CENTER TYPE, WITH 1/8" HIGH ENGRAVED CHARACTER.
- 7 - WIRE TO BE 1/2" 612 GA.-600V INSUL.



LM DOOR - REAR VIEW

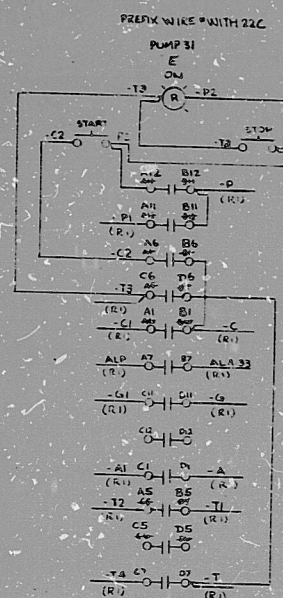

BACK PANEL - FRONT VIEW

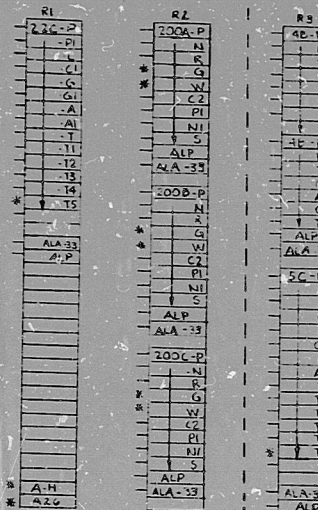

RH DOOR - REAR VIEW

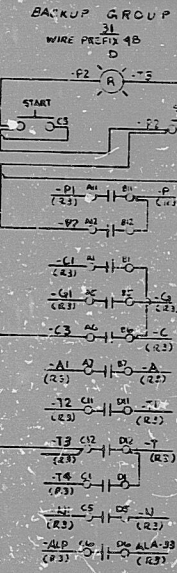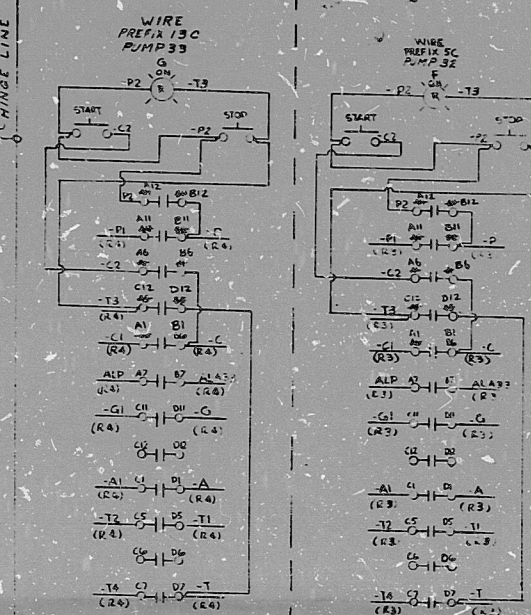

PRC
APERTURE
CARD
POOR ORIGINAL

NOT FOR INSTALLATION
INFORMATION ONLY

1972M2900
FINAL ISSUE
F.P. No. 9321-00-5-3956
REV. 08 DATE 09/13/74
F.P. 9321-05-3956

WIRING DIAGRAM

MARKINGS BY U.E. & C
4-15-74

MECHANICAL CONTROLS CORPORATION		WESTINGHOUSE ELECTRIC CORP.	
DIVISION OF WICHITA INDUSTRIES, INC.		CONTROL STATION "PL2"	
DESIGNED BY	DATE	DATE	DATE
CHW	2-8-72	DATE	DATE
TRACED	APP'D	DATE	DATE
		14010711	

8211040380

RIDS

8211040380

