


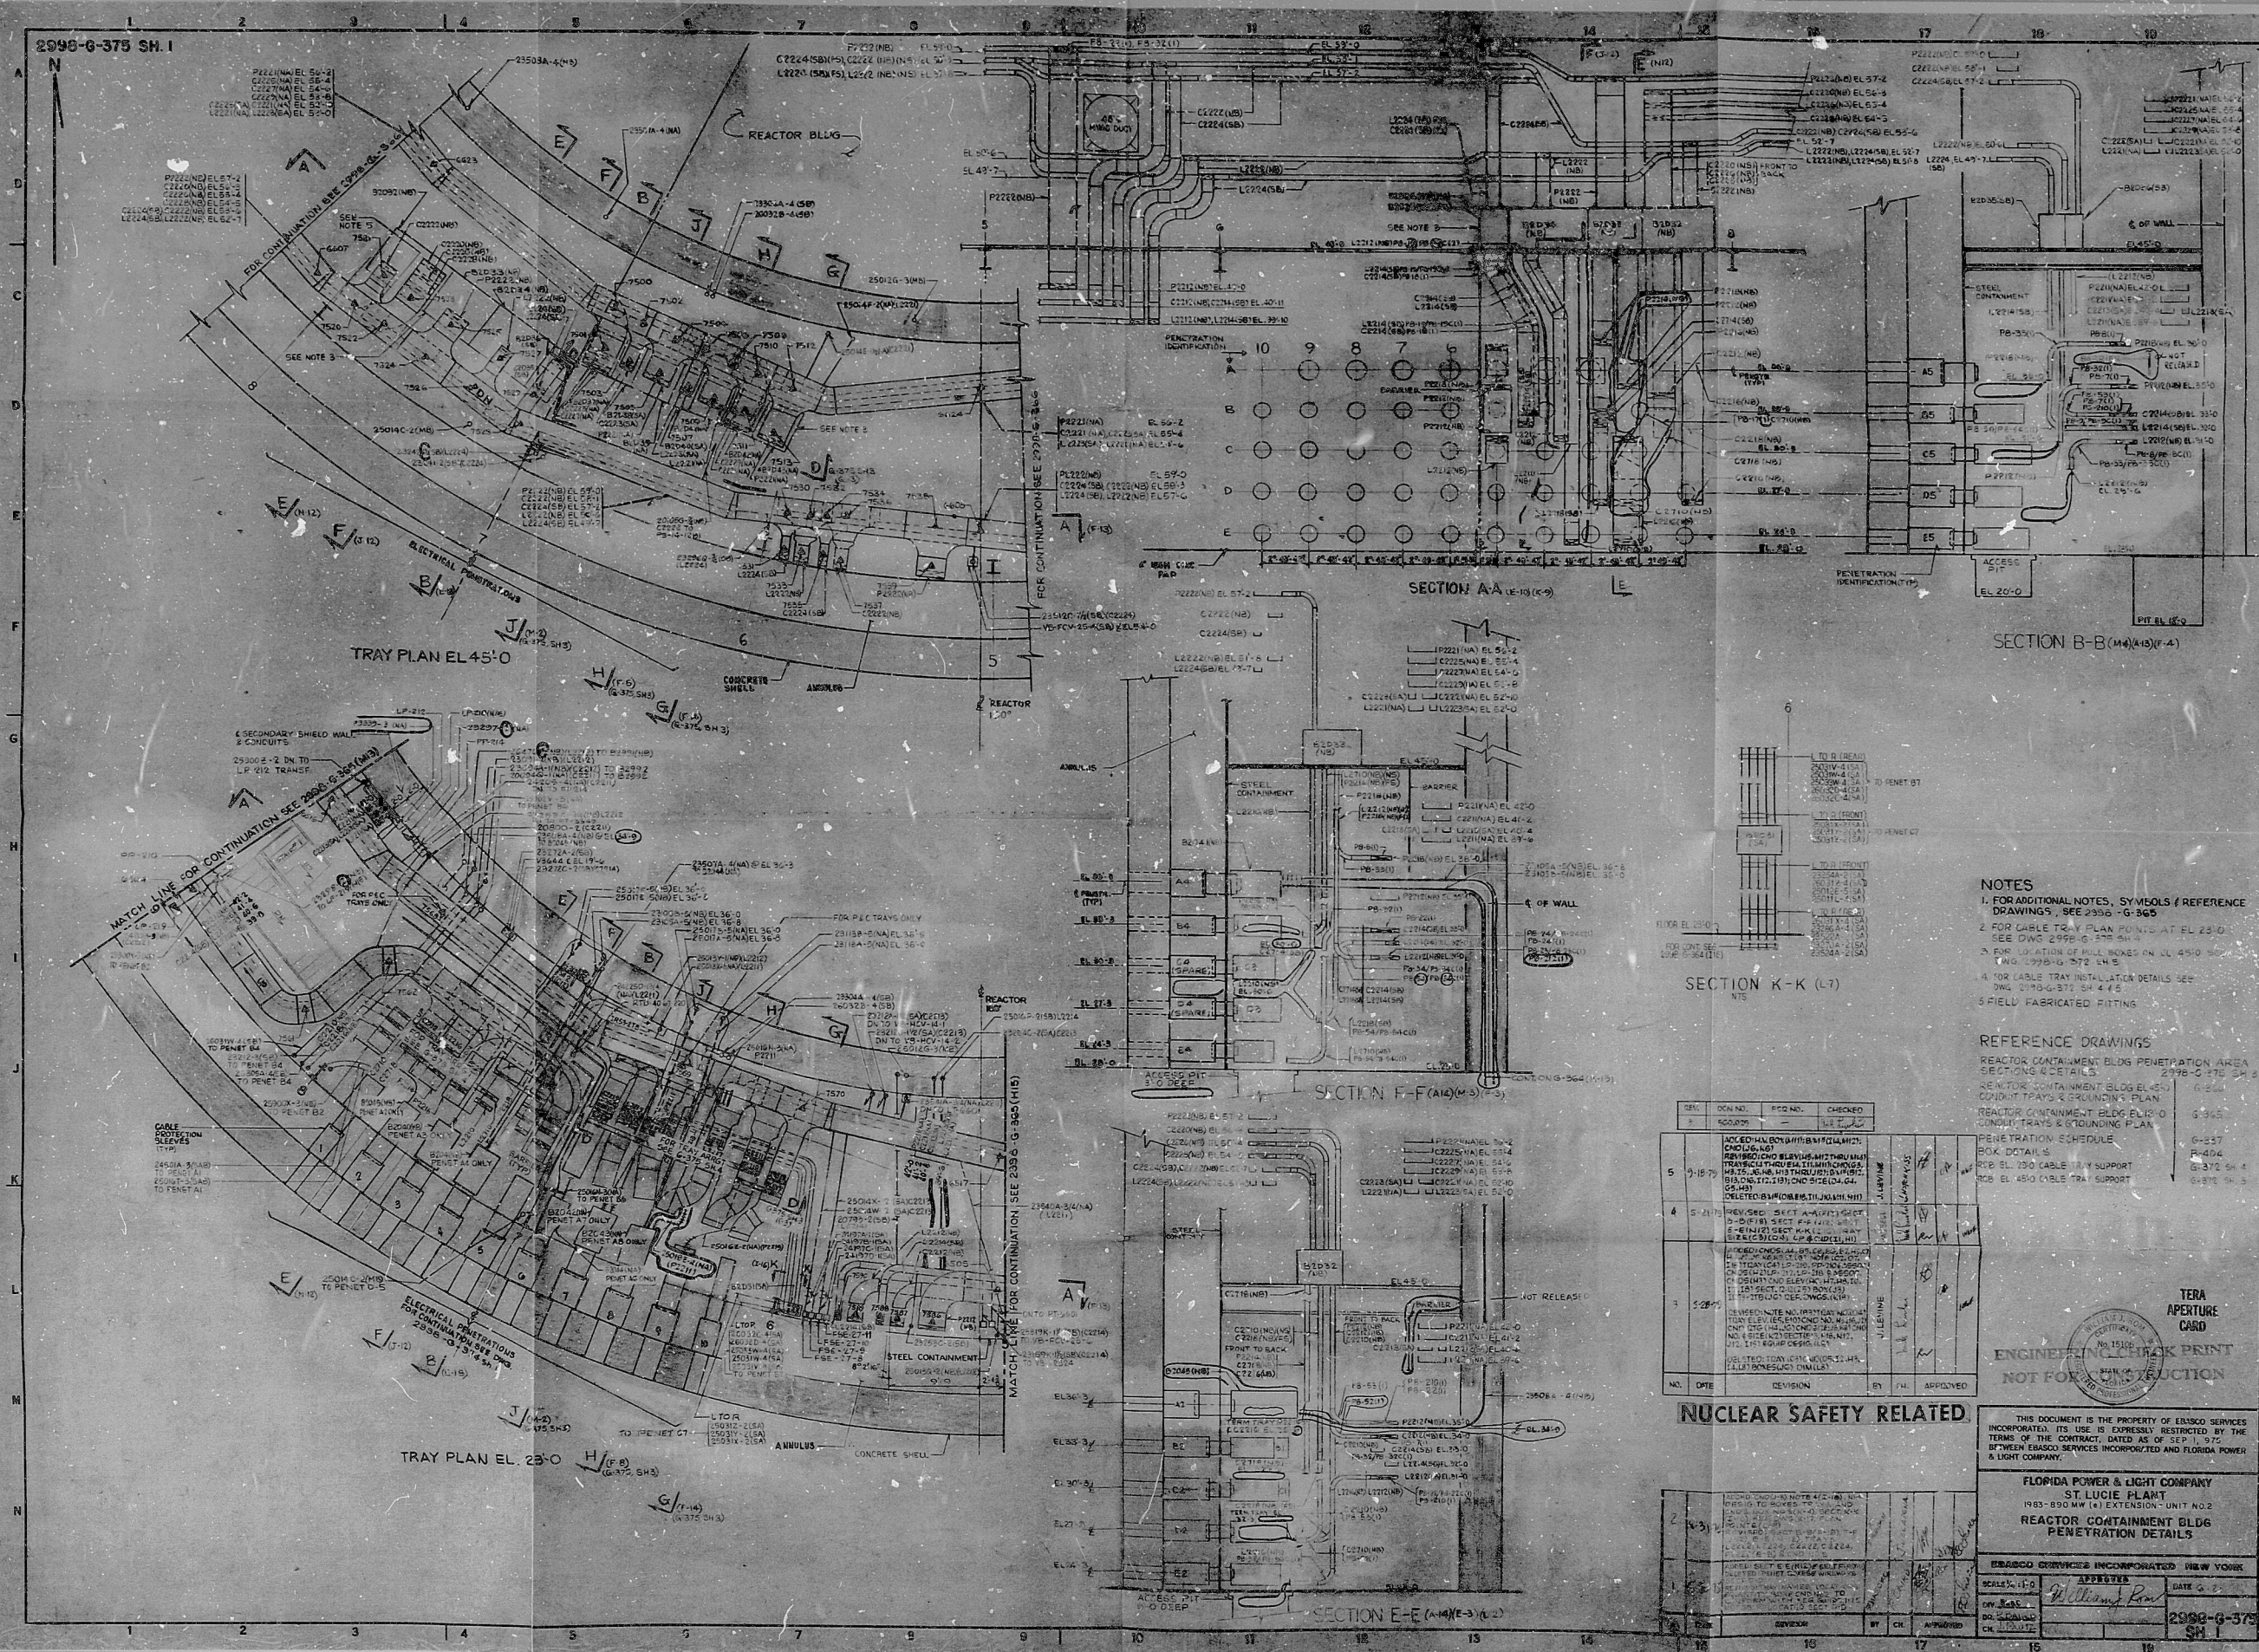

NOTES
1. FOR ADDITIONAL NOTES, SYMBOLS / REFERENCE DRAWINGS, SEE 2390-G-375
2. FOR CABLE TRAY PLAN POINTS AT EL 23'-0"
3. FOR CABLE TRAY PLAN POINTS AT EL 45'-0"
4. FOR CABLE TRAY INSTALLATION DETAILS SEE DWG. 2390-G-375 SH 4 & 5
5. FIELD FABRICATED FITTINGS

REFERENCE DRAWINGS
REACTOR CONTAINMENT BLDG PENETRATION AREA
REACTOR CONTAINMENT BLDG EL 45'-0"
REACTOR CONTAINMENT BLDG EL 23'-0"
REACTOR CONTAINMENT BLDG EL 15'-0"
REACTOR CONTAINMENT BLDG EL 5'-0"
REACTOR CONTAINMENT BLDG EL 0'-0"

REV.	DATE	DESCRIPTION	BY	CHK	APPROVED
1	10/1/78	ISSUED FOR CONSTRUCTION	J. L. LEE	J. L. LEE	J. L. LEE
2	10/1/78	REVISED TO SHOW CHANGES	J. L. LEE	J. L. LEE	J. L. LEE
3	10/1/78	REVISED TO SHOW CHANGES	J. L. LEE	J. L. LEE	J. L. LEE
4	10/1/78	REVISED TO SHOW CHANGES	J. L. LEE	J. L. LEE	J. L. LEE
5	10/1/78	REVISED TO SHOW CHANGES	J. L. LEE	J. L. LEE	J. L. LEE

NUCLEAR SAFETY RELATED

ENGINEER'S SEAL
NOT FOR CONSTRUCTION

FLORIDA POWER & LIGHT COMPANY
ST. LUCIE PLANT
1983-800 MW 1 & 2 EXTENSION UNIT NO. 2
REACTOR CONTAINMENT BLDG
PENETRATION DETAILS

DATE: 10/1/78
BY: J. L. LEE
CHK: J. L. LEE
APPROVED: J. L. LEE

8106090249

