


PRELIMINARY PRINT

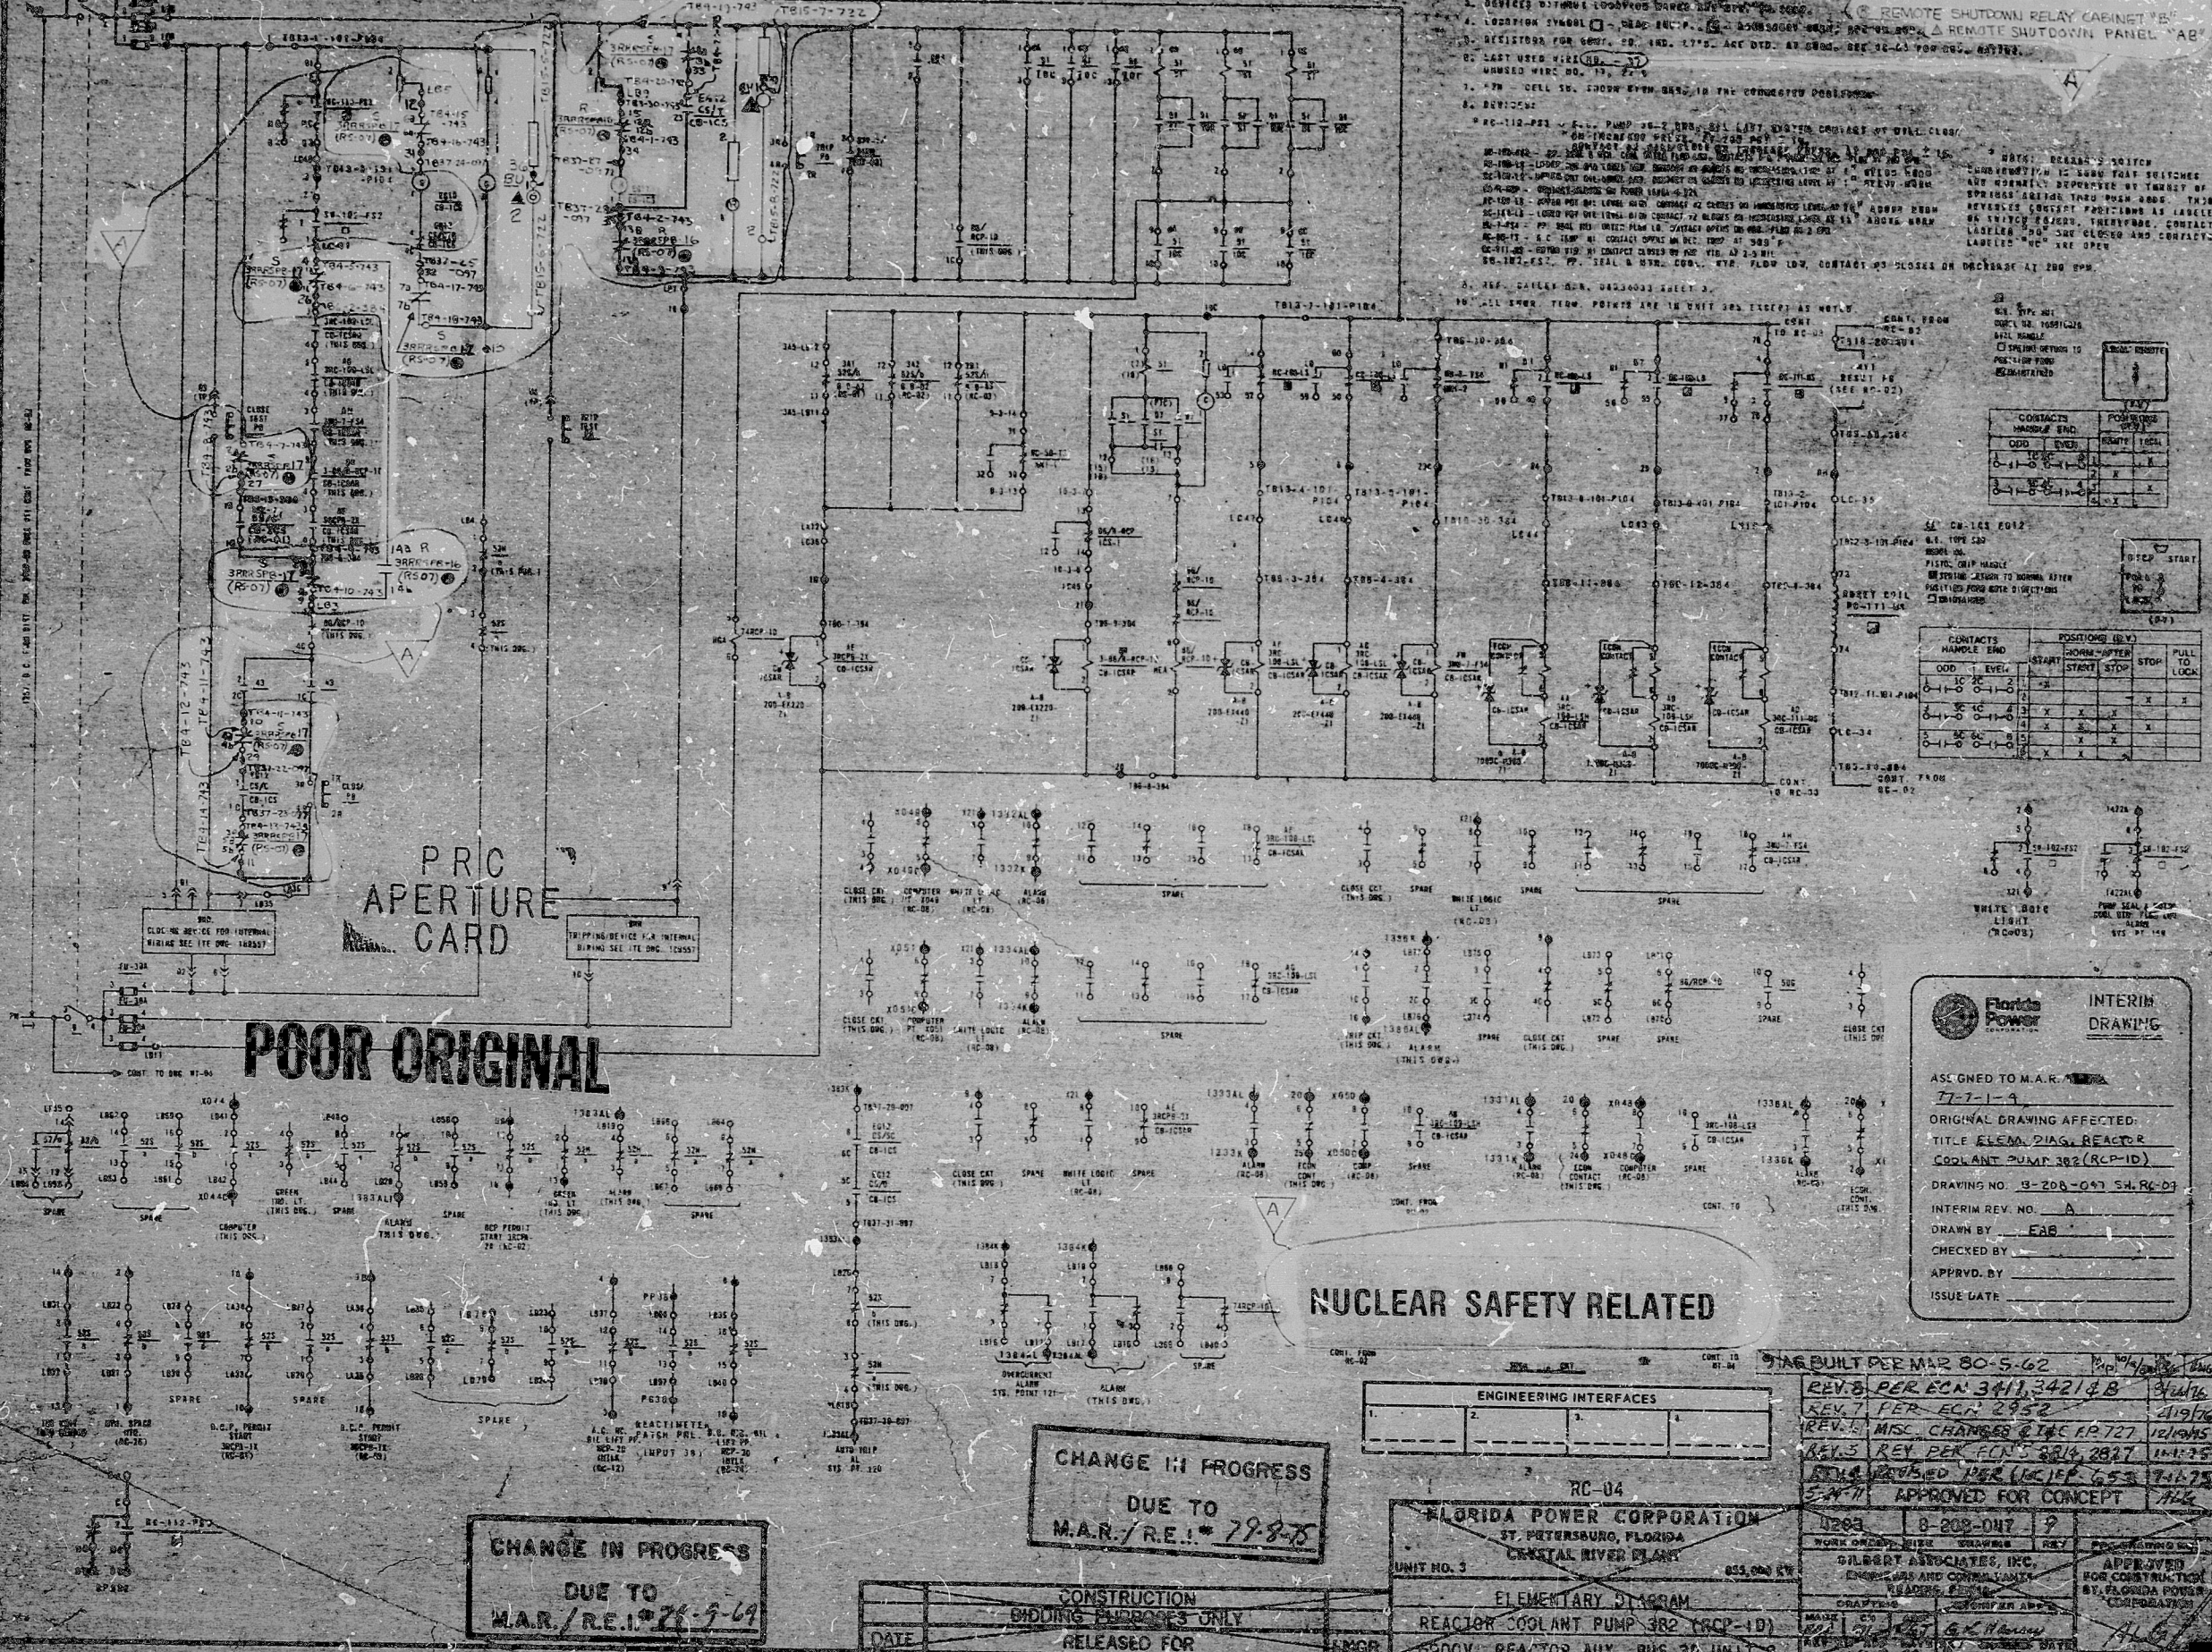

1. REMOTE SHUTDOWN RELAY CABINET 'B'
2. REMOTE SHUTDOWN PANEL 'AB'
3. REMOTE SHUTDOWN PANEL 'AB'
4. REMOTE SHUTDOWN PANEL 'AB'
5. REMOTE SHUTDOWN PANEL 'AB'
6. REMOTE SHUTDOWN PANEL 'AB'
7. REMOTE SHUTDOWN PANEL 'AB'
8. REMOTE SHUTDOWN PANEL 'AB'
9. REMOTE SHUTDOWN PANEL 'AB'
10. REMOTE SHUTDOWN PANEL 'AB'

CONTACTS	POSITIONS
1-10	1-10
11-20	11-20
21-30	21-30
31-40	31-40
41-50	41-50
51-60	51-60
61-70	61-70
71-80	71-80
81-90	81-90
91-100	91-100

CONTACTS	POSITIONS
1-10	1-10
11-20	11-20
21-30	21-30
31-40	31-40
41-50	41-50
51-60	51-60
61-70	61-70
71-80	71-80
81-90	81-90
91-100	91-100

FLORIDA POWER CORPORATION
INTERIM DRAWING

ASSIGNED TO M.A.R. 77-1-9

ORIGINAL DRAWING AFFECTED:
TITLE ELEMENTARY DIAGRAM
COOLANT PUMP 302 (RCP-10)

DRAWING NO. B-208-047 54-R-01

INTERIM REV. NO. 1

DRAWN BY: EAB

CHECKED BY:

APPROVED BY:

ISSUE DATE:

NUCLEAR SAFETY RELATED

CHANGE IN PROGRESS
DUE TO
M.A.R./R.E. 77-8-8

CHANGE IN PROGRESS
DUE TO
M.A.R./R.E. 77-9-69

ENGINEERING INTERFACES
1. 2. 3. 4.

RC-04
FLORIDA POWER CORPORATION
ST. PETERSBURG, FLORIDA
CRYSTAL RIVER PLANT

UNIT NO. 3
ELEMENTARY DIAGRAM
REACTOR COOLANT PUMP 302 (RCP-10)
6500V, REACTOR AUX. BUS 30 UNIT 3

REV.	REV. NO.	REV. DATE	REV. BY	REV. FOR
REV. 1	REV. 1	REV. 1	REV. 1	REV. 1
REV. 2	REV. 2	REV. 2	REV. 2	REV. 2
REV. 3	REV. 3	REV. 3	REV. 3	REV. 3
REV. 4	REV. 4	REV. 4	REV. 4	REV. 4
REV. 5	REV. 5	REV. 5	REV. 5	REV. 5
REV. 6	REV. 6	REV. 6	REV. 6	REV. 6
REV. 7	REV. 7	REV. 7	REV. 7	REV. 7
REV. 8	REV. 8	REV. 8	REV. 8	REV. 8
REV. 9	REV. 9	REV. 9	REV. 9	REV. 9
REV. 10	REV. 10	REV. 10	REV. 10	REV. 10

R.D.S

821180397

