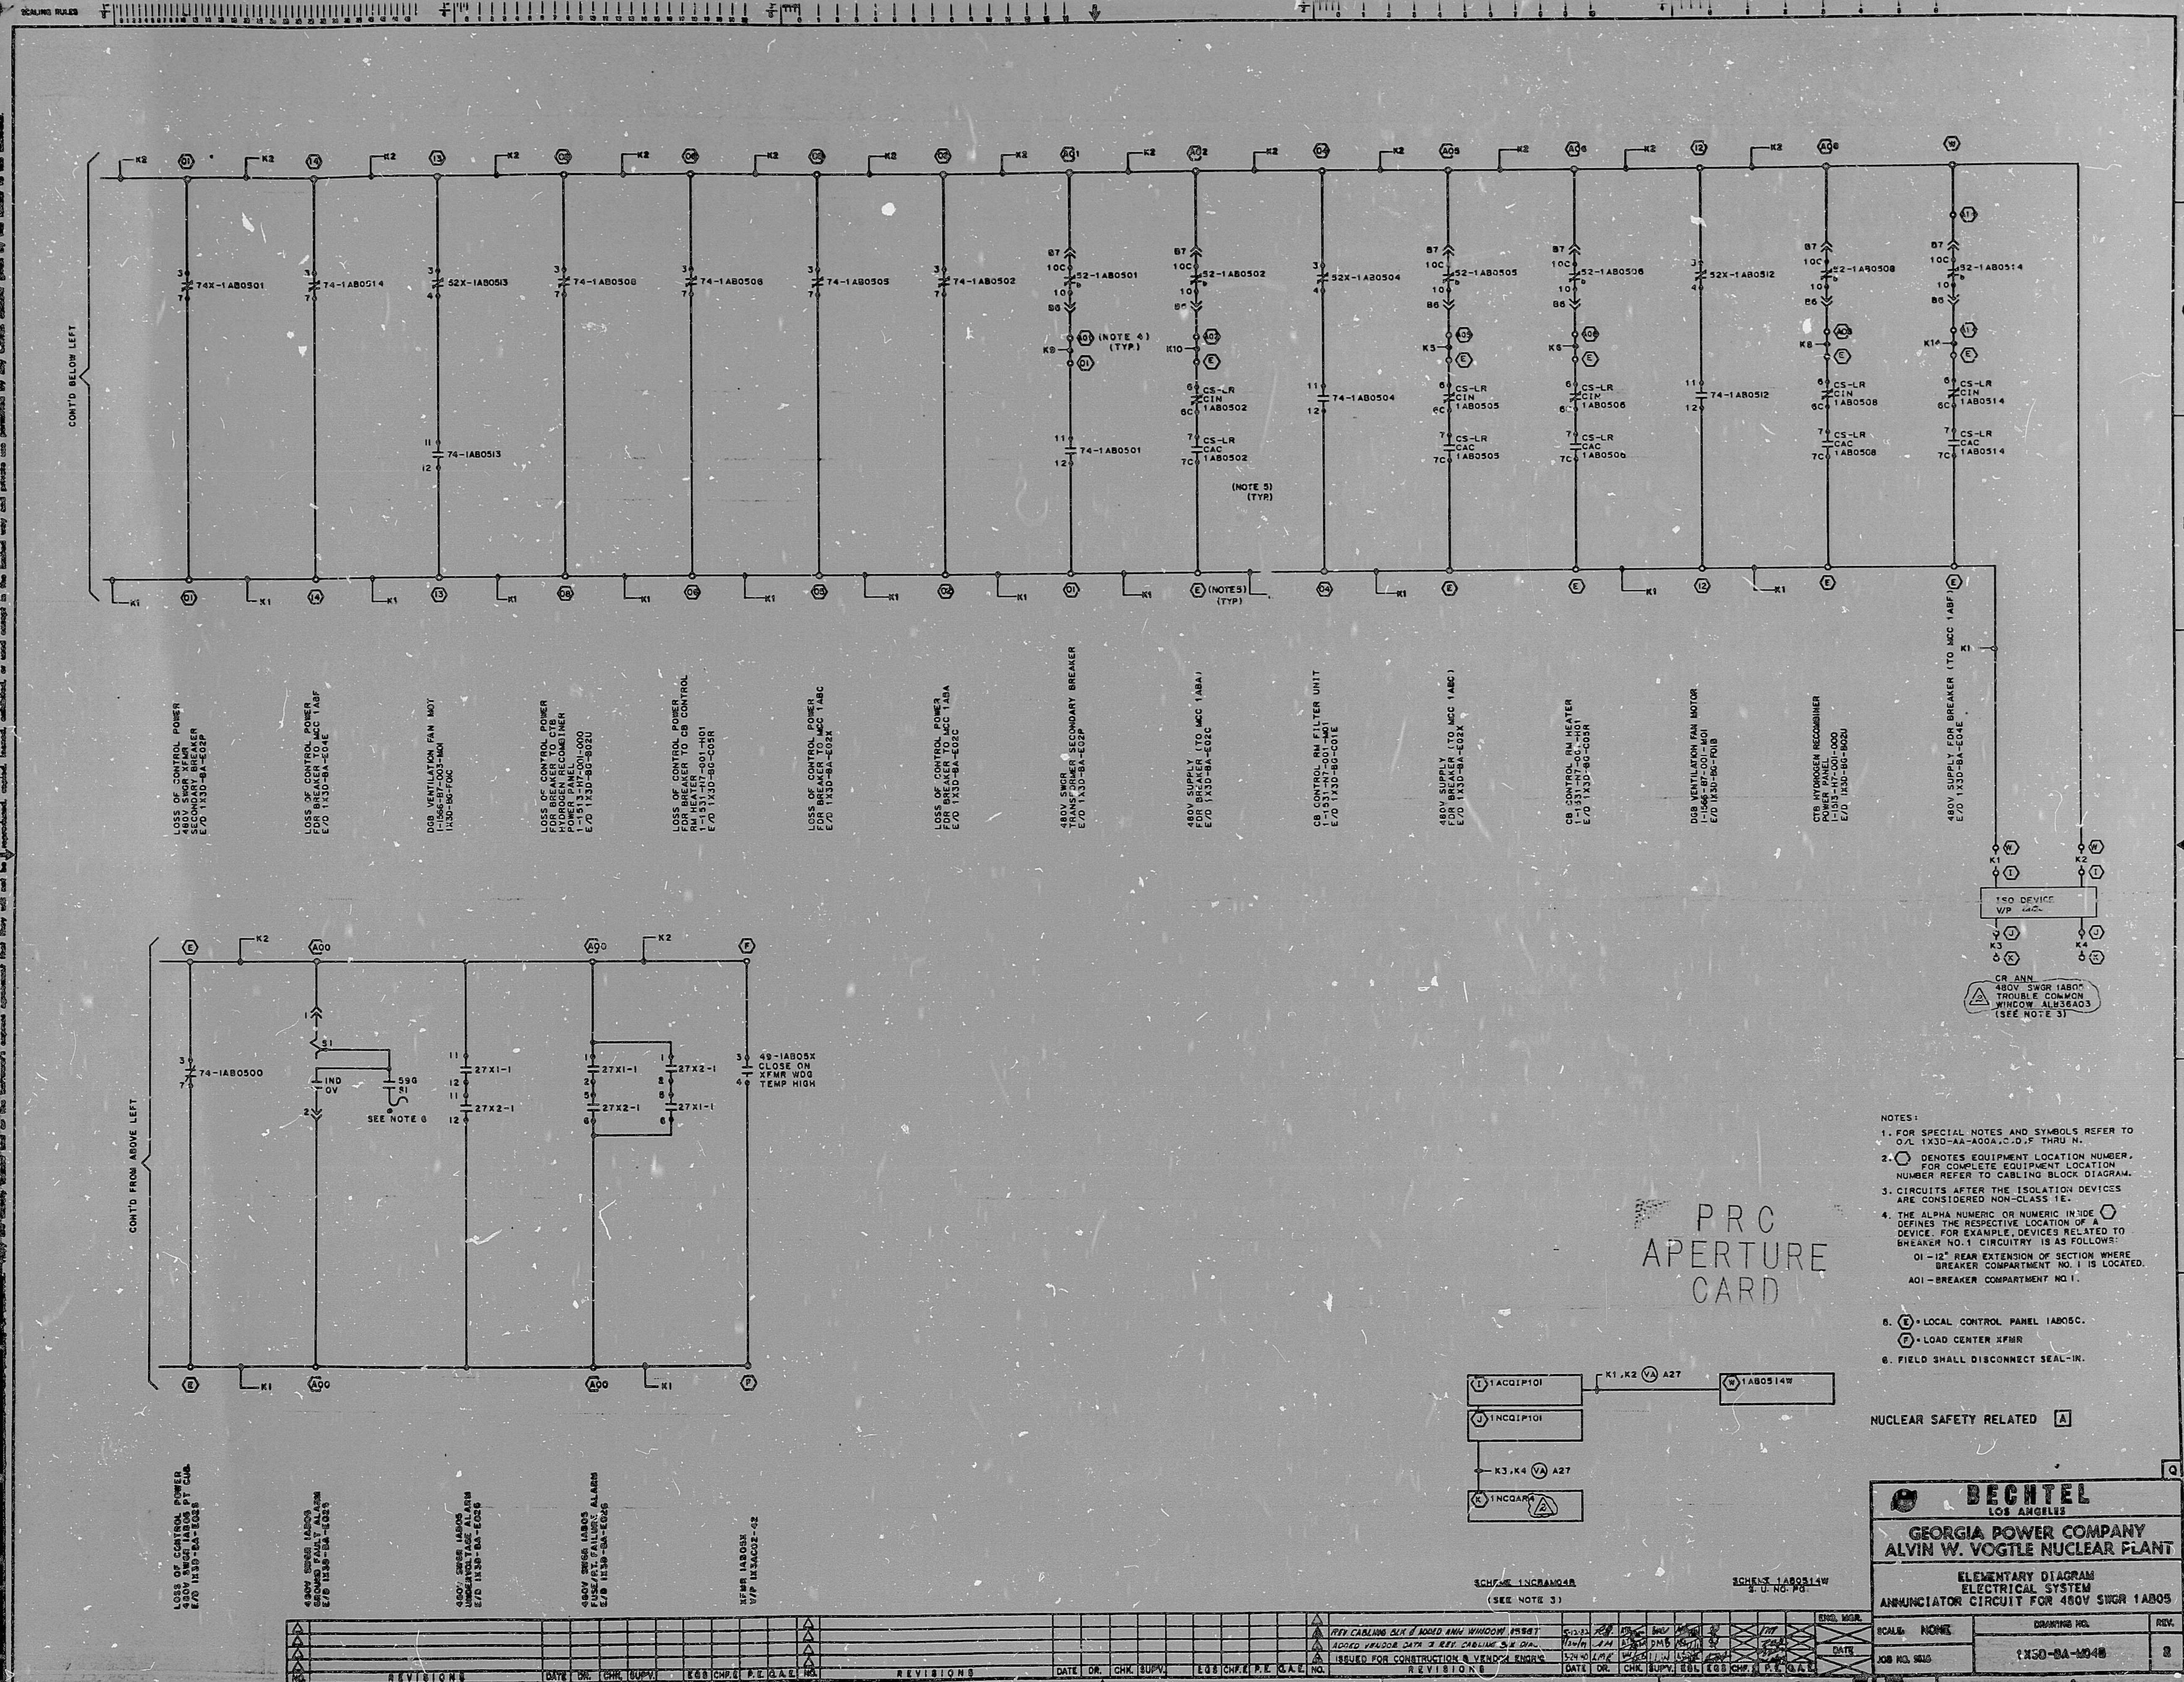

NOTES:

1. FOR SPECIAL NOTES AND SYMBOLS REFER TO O/L 1X3D-AA-A00A,C,D,F THRU N.
2. ⬡ DENOTES EQUIPMENT LOCATION NUMBER. FOR COMPLETE EQUIPMENT LOCATION NUMBER REFER TO CABLING BLOCK DIAGRAM.
3. CIRCUITS AFTER THE ISOLATION DEVICES ARE CONSIDERED NON-CLASS 1E.
4. THE ALPHA NUMERIC OR NUMERIC INSIDE ⬡ DEFINES THE RESPECTIVE LOCATION OF A DEVICE. FOR EXAMPLE, DEVICES RELATED TO BREAKER NO.1 CIRCUITRY IS AS FOLLOWS:
   01 - 12" REAR EXTENSION OF SECTION WHERE BREAKER COMPARTMENT NO. 1 IS LOCATED.
   A01 - BREAKER COMPARTMENT NO. 1.
5. (E) = LOCAL CONTROL PANEL 1AB05C.
   (F) = LOAD CENTER XFMR
6. FIELD SHALL DISCONNECT SEAL-IN.

NUCLEAR SAFETY RELATED [A]

NO.	REVISIONS	DATE	DR.
2	REV. CABLING BLK & ADDED ANN WINDOW, ISSUE	5-12-83	R.B.
1	ADDED VENDOR DATA & REV. CABLING BLK DIAG.	1/24/81	AM
0	ISSUED FOR CONSTRUCTION & VENDOR ENGR'G	3-24-80	LMF

BECHTEL
LOS ANGELES

GEORGIA POWER COMPANY
ALVIN W. VOGTLE NUCLEAR PLANT

ELEMENTARY DIAGRAM
ELECTRICAL SYSTEM
ANNUNCIATOR CIRCUIT FOR 480V SWGR 1AB05

SCALE	DRAWING NO.	REV.
NONE	1X3D-BA-M04B	2

JOB NO. 9510

RIDS

8309290391

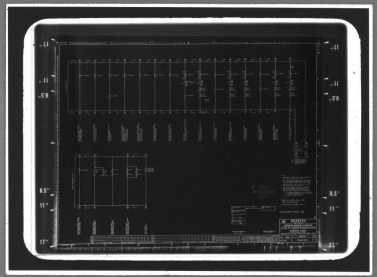

MMM 5824 — FILMSORT® Brand Aperture & Camera Cards and DUPLICARD® Brand Copy Cards — Product of 3M Company, St. Paul, Minn.