

34"

34"

22"

22"

17"

17"

11"

11"

8.5"

8.5"

8.5"

8.5"

11"

11"

17"


17"

22"

22"

34"

34"

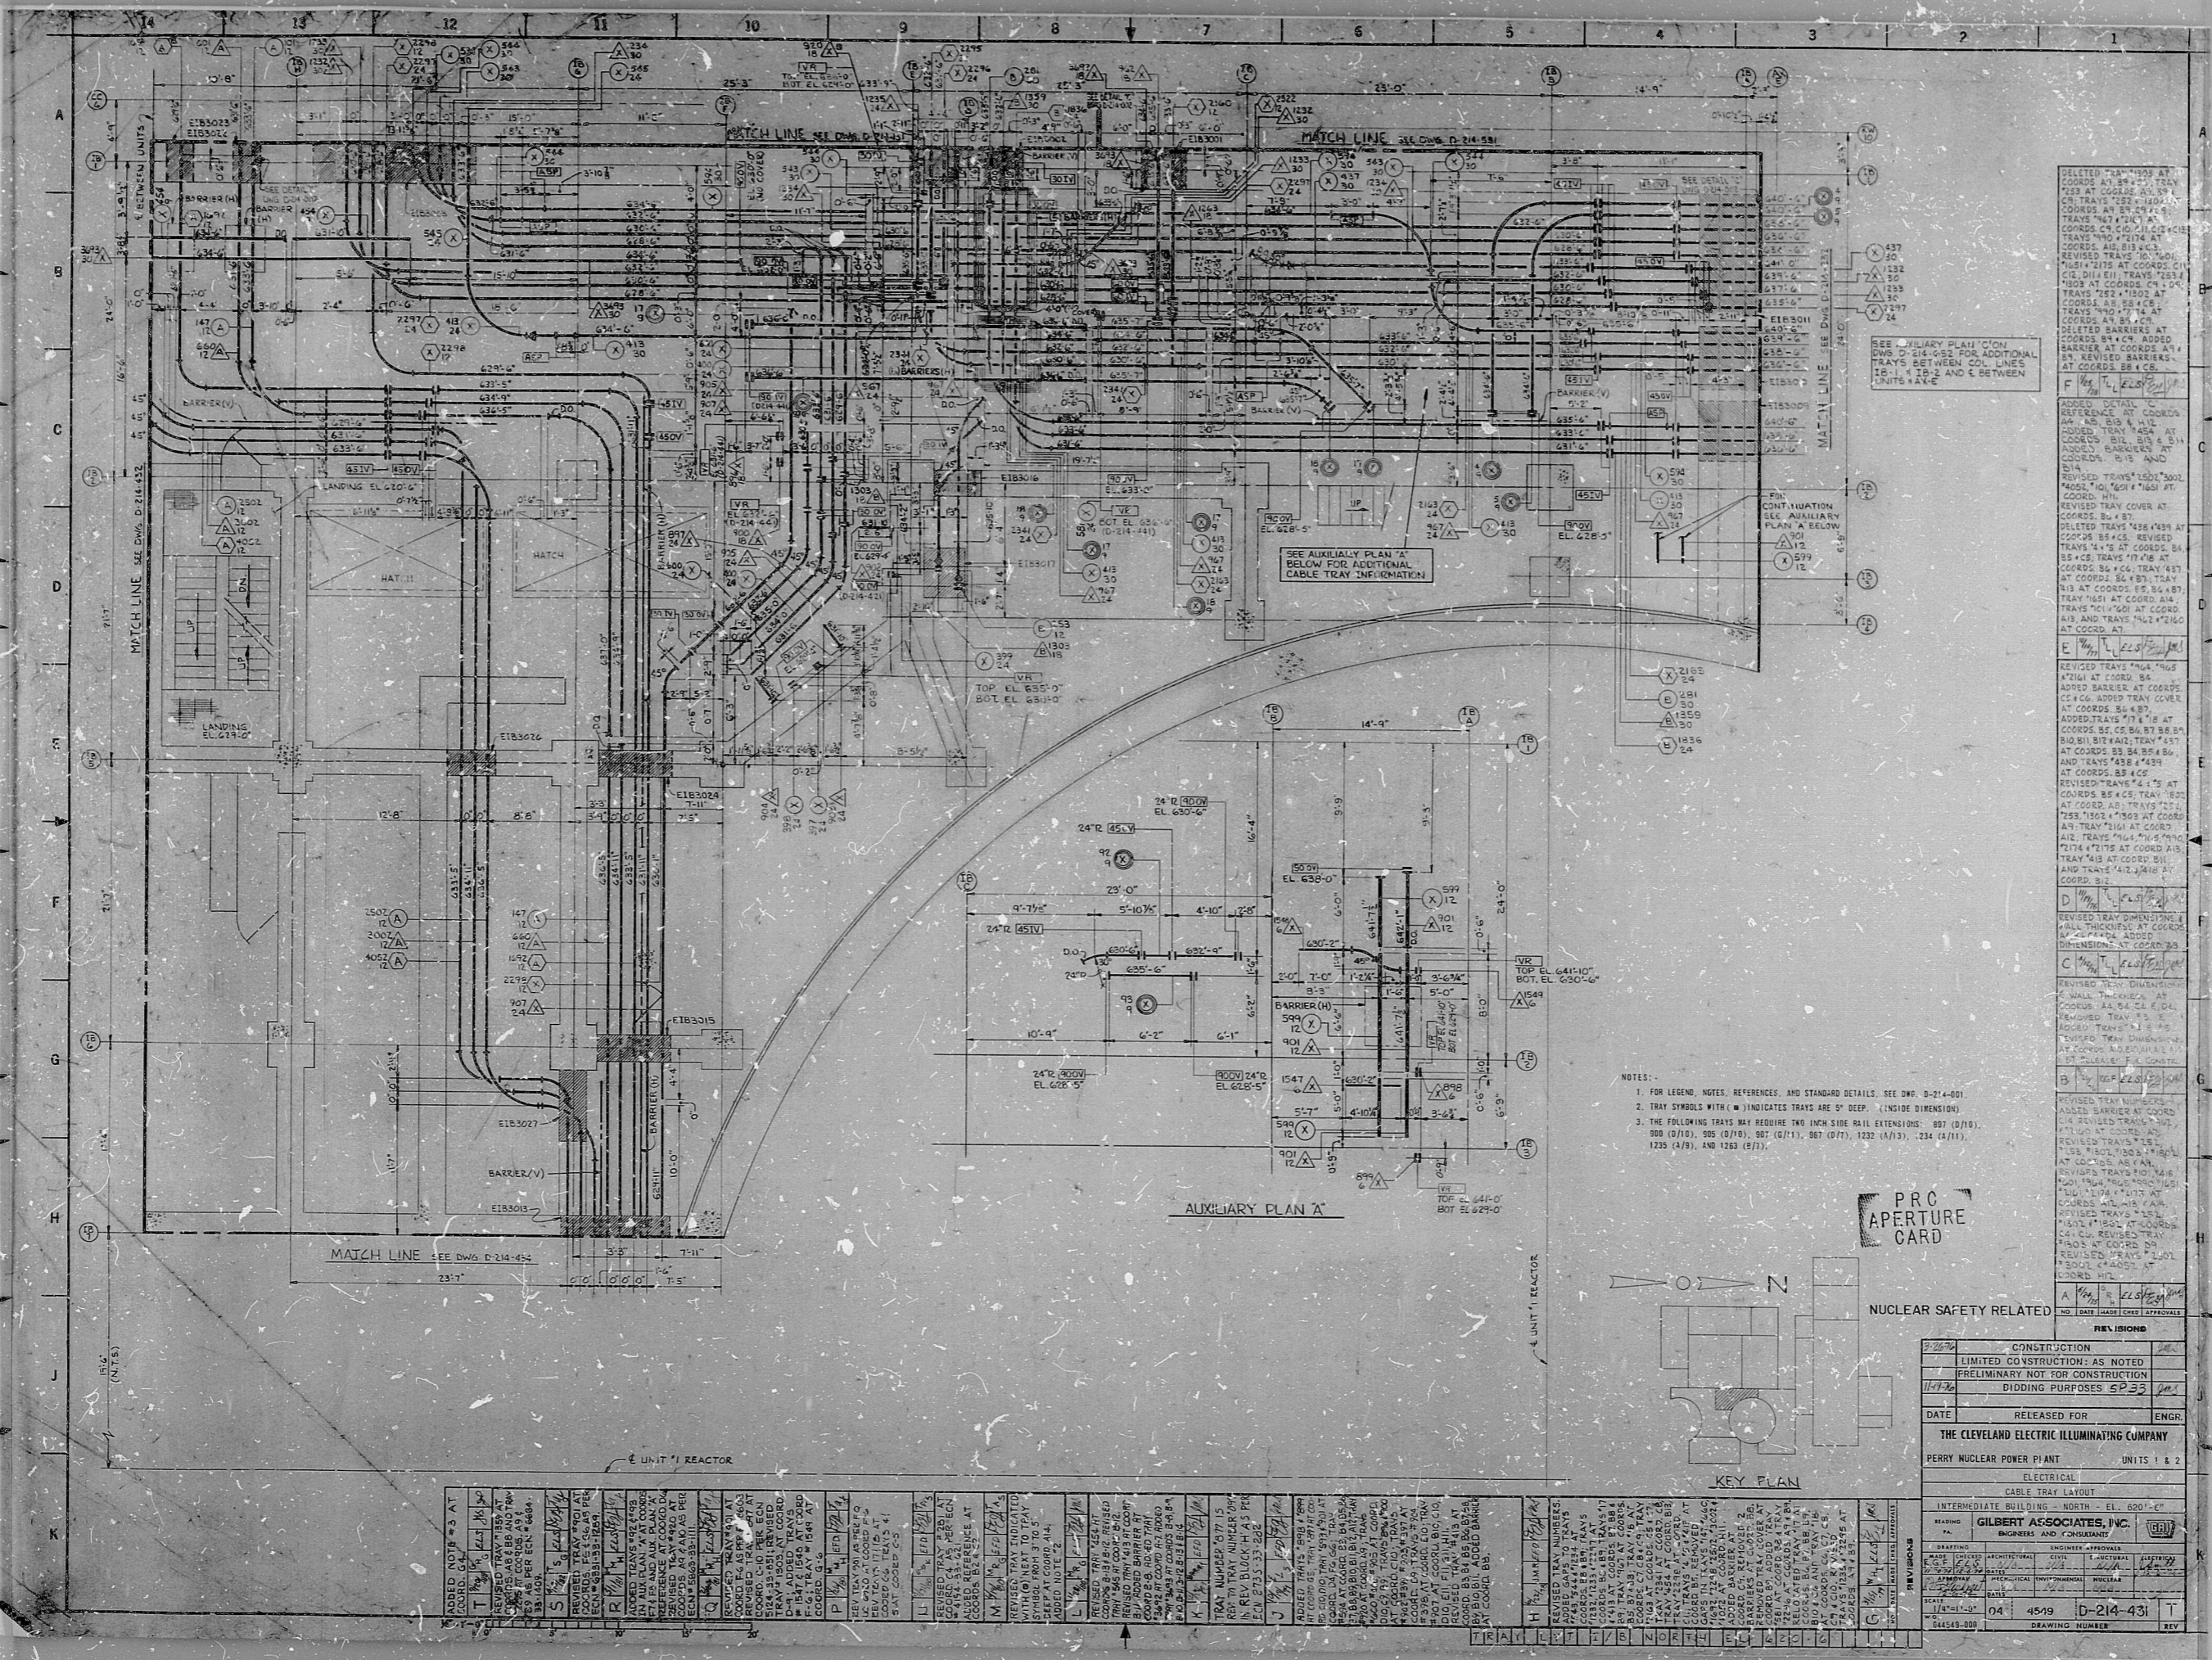


SEE AUXILIARY PLAN 'C' ON DWG D-214-052 FOR ADDITIONAL TRAYS BETWEEN COL. LINES 12-1, 12-2 AND C BETWEEN UNITS 1 & 2

SEE AUXILIARY PLAN 'A' BELOW FOR ADDITIONAL CABLE TRAY INFORMATION

PRC APERTURE CARD

NUCLEAR SAFETY RELATED

- NOTES -
1. FOR LEGEND, NOTES, REFERENCES AND STANDARD DETAILS, SEE DWG. D-214-001
 2. TRAY SYMBOLS WITH (M) INDICATES TRAYS ARE 6" DEEP. (INSIDE DIMENSION)
 3. THE FOLLOWING TRAYS MAY REQUIRE TWO INCH SIDE RAIL EXTENSIONS: 907 (D/1), 900 (D/1), 905 (D/1), 907 (D/1), 967 (D/1), 1232 (A/1), 234 (A/1), 1235 (A/8), AND 1263 (B/7).



NO.	REVISIONS	DATE	BY	CHKD.	APP'D.
1	ISSUED FOR CONSTRUCTION	11/7/76	[Signature]	[Signature]	[Signature]
2	REVISIONS				
3					
4					
5					
6					
7					
8					
9					
10					
11					
12					
13					
14					
15					
16					
17					
18					
19					
20					
21					
22					
23					
24					
25					
26					
27					
28					
29					
30					
31					
32					
33					
34					
35					
36					
37					
38					
39					
40					
41					
42					
43					
44					
45					
46					
47					
48					
49					
50					
51					
52					
53					
54					
55					
56					
57					
58					
59					
60					
61					
62					
63					
64					
65					
66					
67					
68					
69					
70					
71					
72					
73					
74					
75					
76					
77					
78					
79					
80					
81					
82					
83					
84					
85					
86					
87					
88					
89					
90					
91					
92					
93					
94					
95					
96					
97					
98					
99					
100					

CONSTRUCTION	
LIMITED CONSTRUCTION: AS NOTED	
PRELIMINARY NOT FOR CONSTRUCTION	
DIDDING PURPOSES SP33	
DATE	RELEASED FOR ENGR.
THE CLEVELAND ELECTRIC ILLUMINATING COMPANY	
PERRY NUCLEAR POWER PLANT UNITS 1 & 2	
ELECTRICAL	
CABLE TRAY LAYOUT	
INTERMEDIATE BUILDING - NORTH - EL. 690'-0"	
DRAWING NO. 04 4599 D-214-431 T	
DESIGNED AND CONSULTANT: GILBERT ASSOCIATES, INC.	
DRAWING NUMBER	

82.1208 0344

RIDS

