


27

27

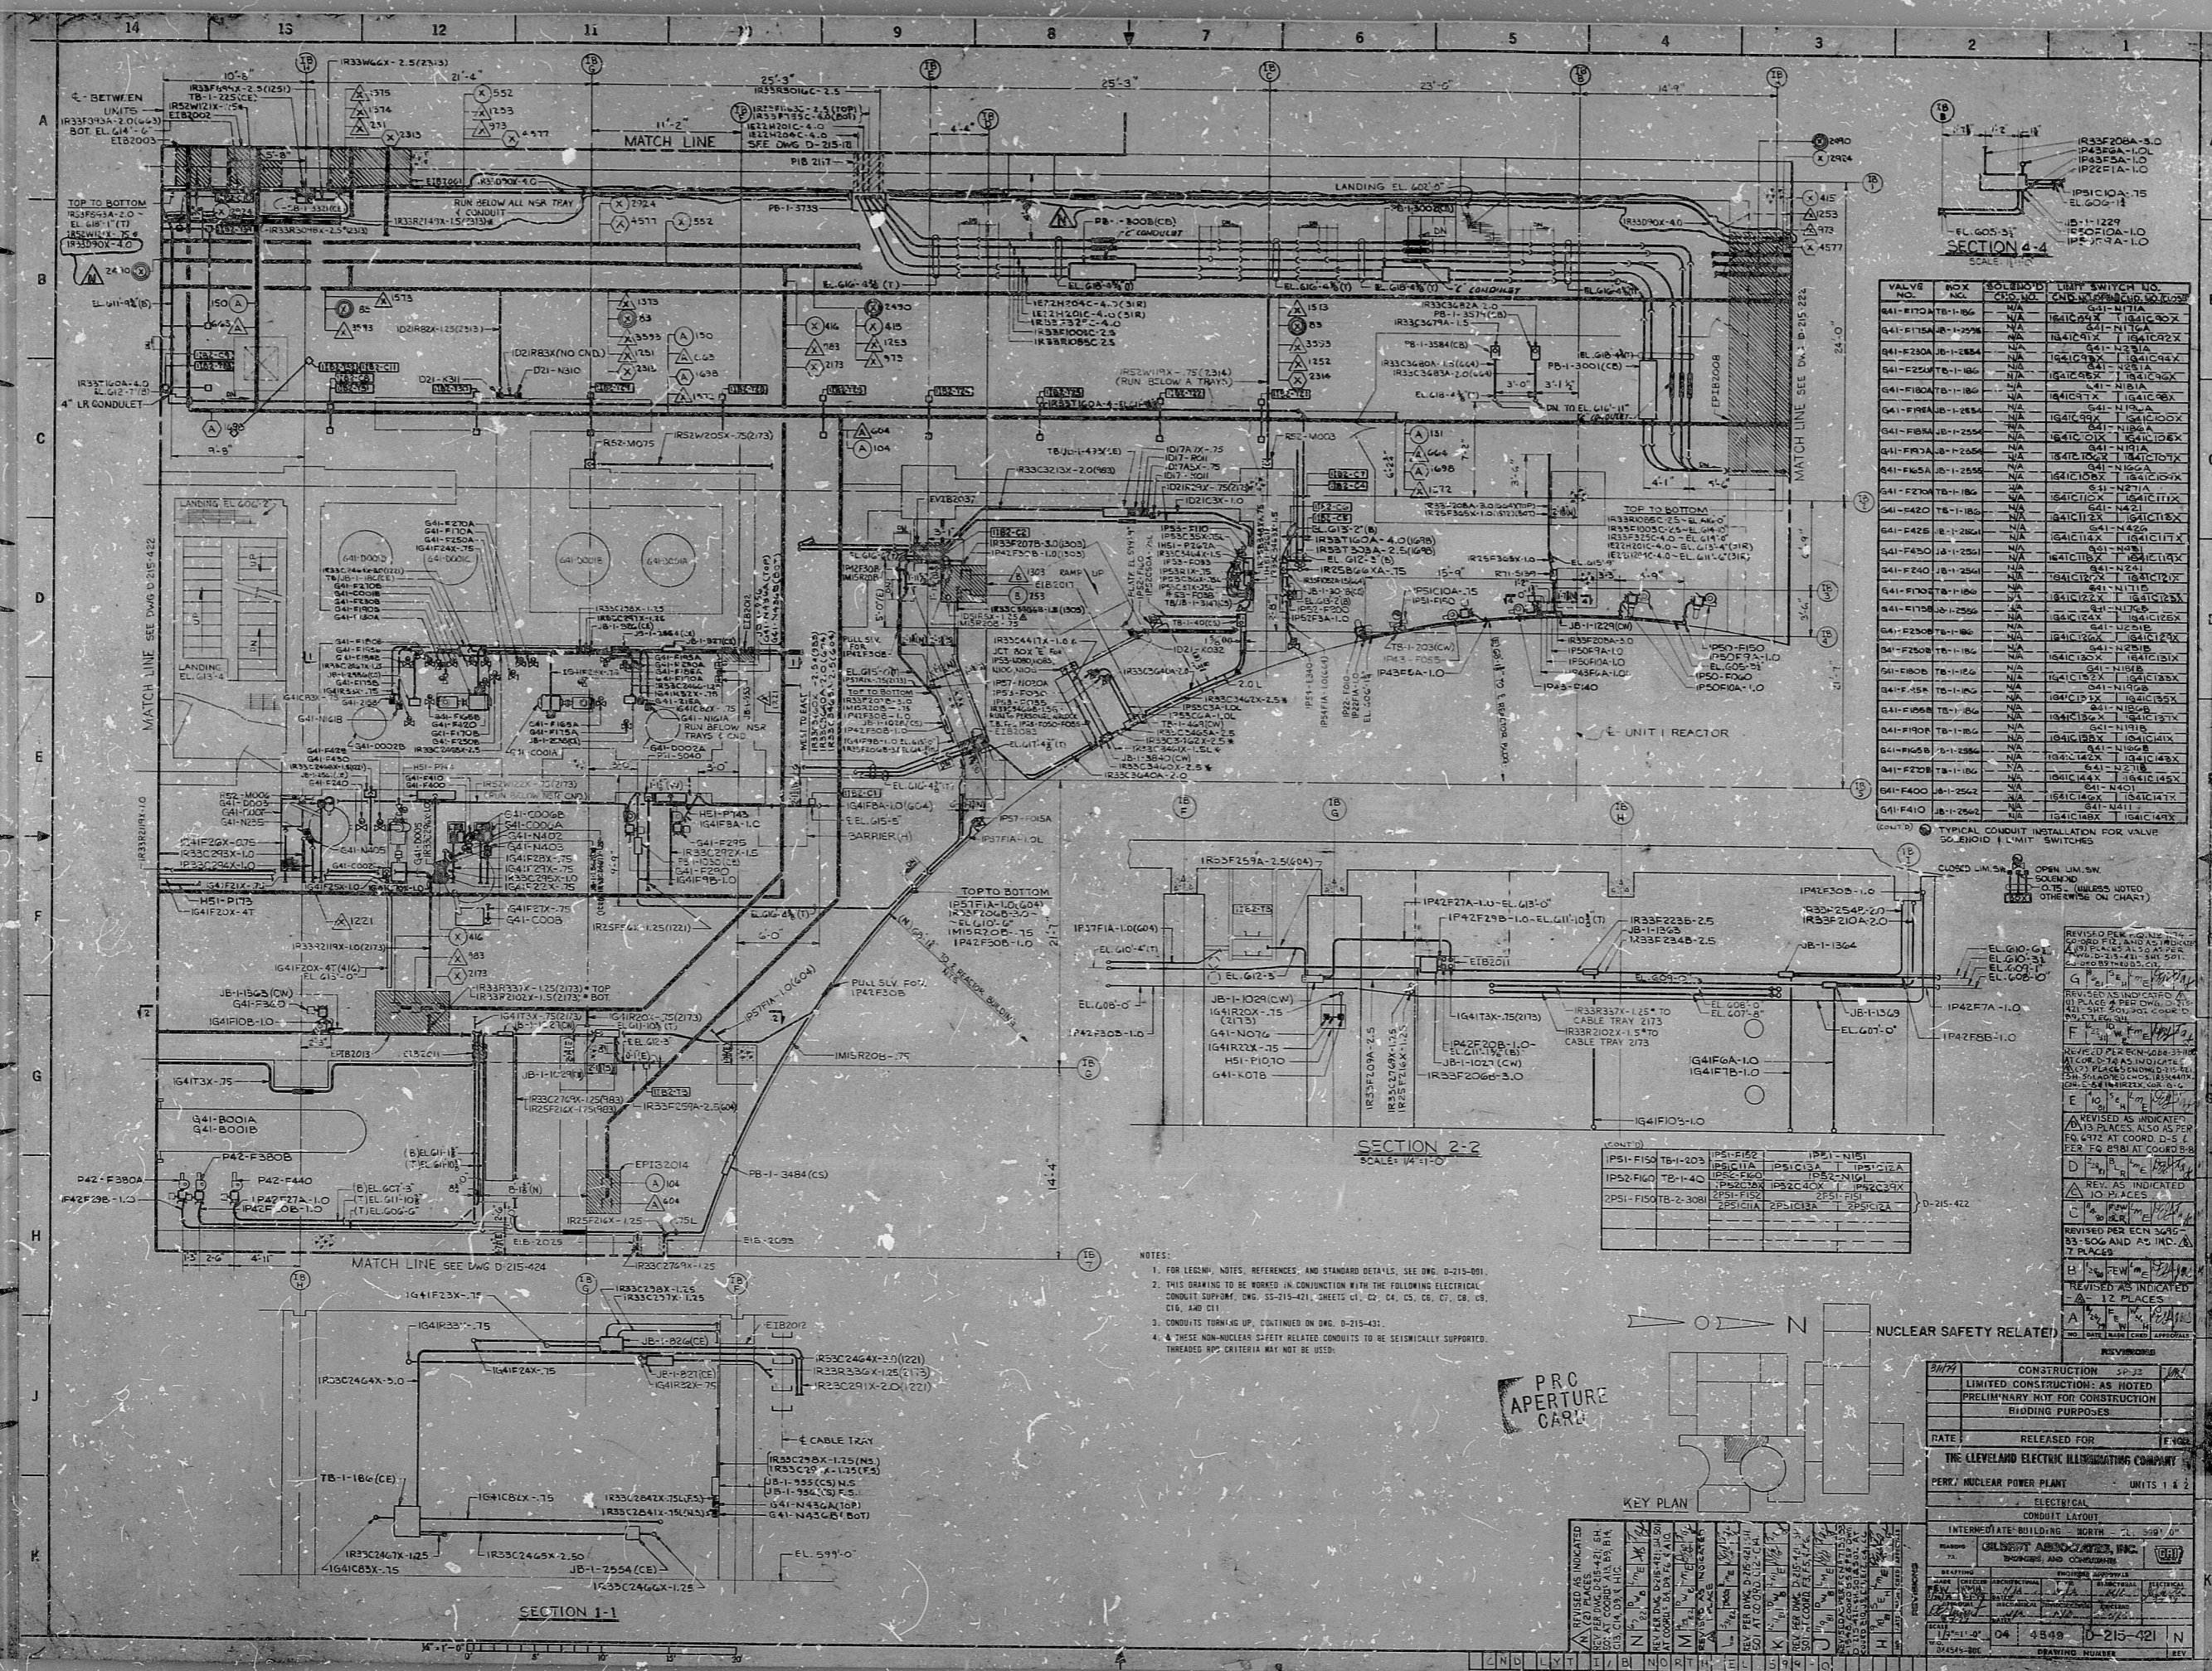

VALVE NO.	BOX NO.	CONDUIT NO.	UNIT SWITCH NO.
G41-F10A	18-186	N/A	G41-N17A
G41-F17A	18-129B	N/A	184102A-X
G41-F20A	18-186A	N/A	184102X
G41-F22A	18-186	N/A	184102A
G41-F10A	18-186	N/A	184102A
G41-F10A	18-234	N/A	184102A
G41-F10A	18-255A	N/A	184102A
G41-F10A	18-255	N/A	184102A
G41-F10A	18-256	N/A	184102A
G41-F10A	18-257	N/A	184102A
G41-F10A	18-258	N/A	184102A
G41-F10A	18-259	N/A	184102A
G41-F10A	18-260	N/A	184102A
G41-F10A	18-261	N/A	184102A
G41-F10A	18-262	N/A	184102A
G41-F10A	18-263	N/A	184102A
G41-F10A	18-264	N/A	184102A
G41-F10A	18-265	N/A	184102A
G41-F10A	18-266	N/A	184102A
G41-F10A	18-267	N/A	184102A
G41-F10A	18-268	N/A	184102A
G41-F10A	18-269	N/A	184102A
G41-F10A	18-270	N/A	184102A
G41-F10A	18-271	N/A	184102A
G41-F10A	18-272	N/A	184102A
G41-F10A	18-273	N/A	184102A
G41-F10A	18-274	N/A	184102A
G41-F10A	18-275	N/A	184102A
G41-F10A	18-276	N/A	184102A
G41-F10A	18-277	N/A	184102A
G41-F10A	18-278	N/A	184102A
G41-F10A	18-279	N/A	184102A
G41-F10A	18-280	N/A	184102A

NOTES:

- FOR LEGEND, NOTES, REFERENCES, AND STANDARD DETAILS, SEE DWG. D-215-001.
- THIS DRAWING TO BE WORKED IN CONJUNCTION WITH THE FOLLOWING ELECTRICAL CONDUIT SUPPLY DWG. NO. 35-215-421, SHEETS C1, C2, C4, C5, C6, C7, C8, C9, C10, AND C11.
- CONDUITS TURN 90°, CONTINUED ON DWG. D-215-431.
- THESE NON-NUCLEAR SAFETY RELATED CONDUITS TO BE SEISMICALLY SUPPORTED. THROUGH ROP CRITERIA MAY NOT BE USED.

PROCEDURE CARD

KEY PLAN

CONSTRUCTION: SP-23

LIMITED CONSTRUCTION: AS NOTED

PRELIMINARY NOT FOR CONSTRUCTION BIDDING PURPOSES

DATE: RELEASED FOR: []

THE CLEVELAND ELECTRIC ILLUMINATING COMPANY

PERK: NUCLEAR POWER PLANT UNITS 1 & 2

ELECTRICAL CONDUIT LAYOUT

INTERMEDIATE BUILDING NORTH "A" 300' 0"

DESIGNED BY: []

DRAWN BY: []

CHECKED BY: []

DATE: 04-8-69 D-215-421 N

27

27

RIDS

82:2100165

