

17

17

11

11

8.5

8.5

8.5


8.5

11

11

17

17

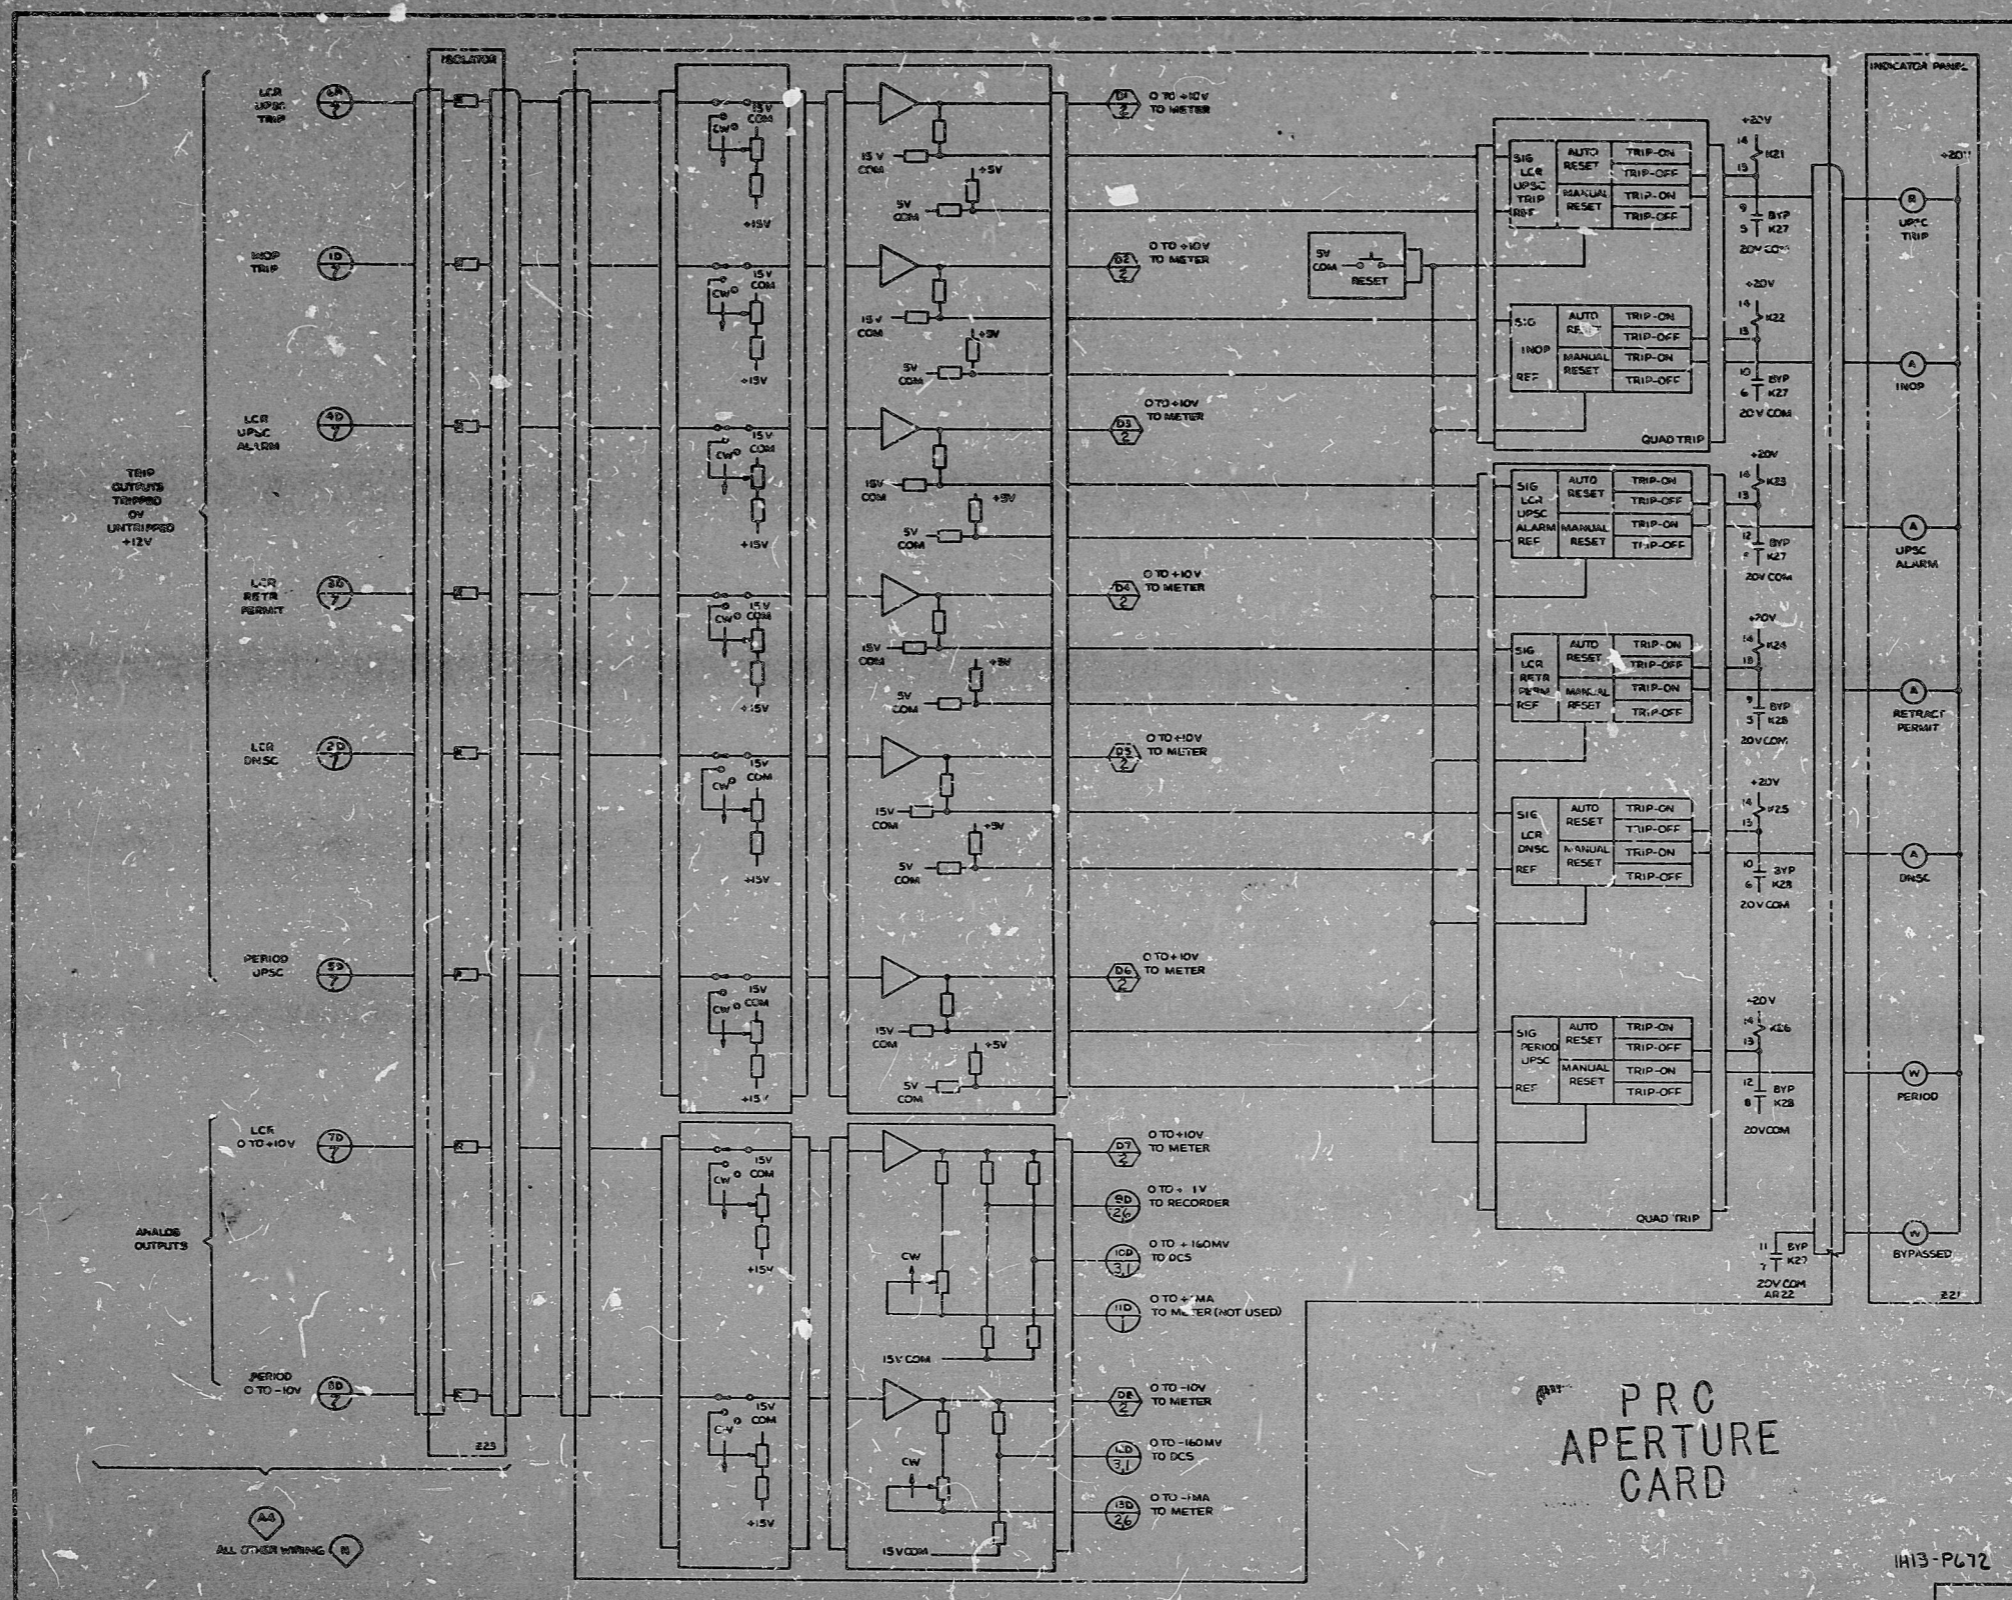

PRC
APERTURE
CARD

INACTIVE FOR NEW DESIGN
GENERAL ELECTRIC 851204
ELEM DIAG 5H.11 REV. 7
START-UP RANGE NEUTRON MON SYS

1H13-PL72

NUCLEAR SAFETY RELATED

THE CLEVELAND ELECTRIC ILLUMINATING CO.

PERRY NUCLEAR POWER PLANT UNIT 1

ELECTRICAL-ELEMENTARY DIAGRAM

START-UP RANGE NEUTRON MONITORING SYSTEM CHANNEL D ALARM SECTION

7-1-77	CONSTRUCTION	2/77
	PRELIMINARY	
	RELEASED FOR	ENGR.

ADDED INACTIVE NOTE PER GE REPT.
READING PA. CLEBERT ASSOCIATES, INC. ENGINEERS AND CONSULTANTS

REV	DATE	BY	CHKD	APPROVALS	DATE	REV	DATE	BY	CHKD	APPROVALS	DATE	REV	DATE	BY	CHKD	APPROVALS	DATE	REV	DATE	BY	CHKD	APPROVALS	DATE	

ELEM DIAG CSIA SRM ALARM SECTION

Rids

82.12140050

