


11  
11  
8.5  
8.5  
11  
17

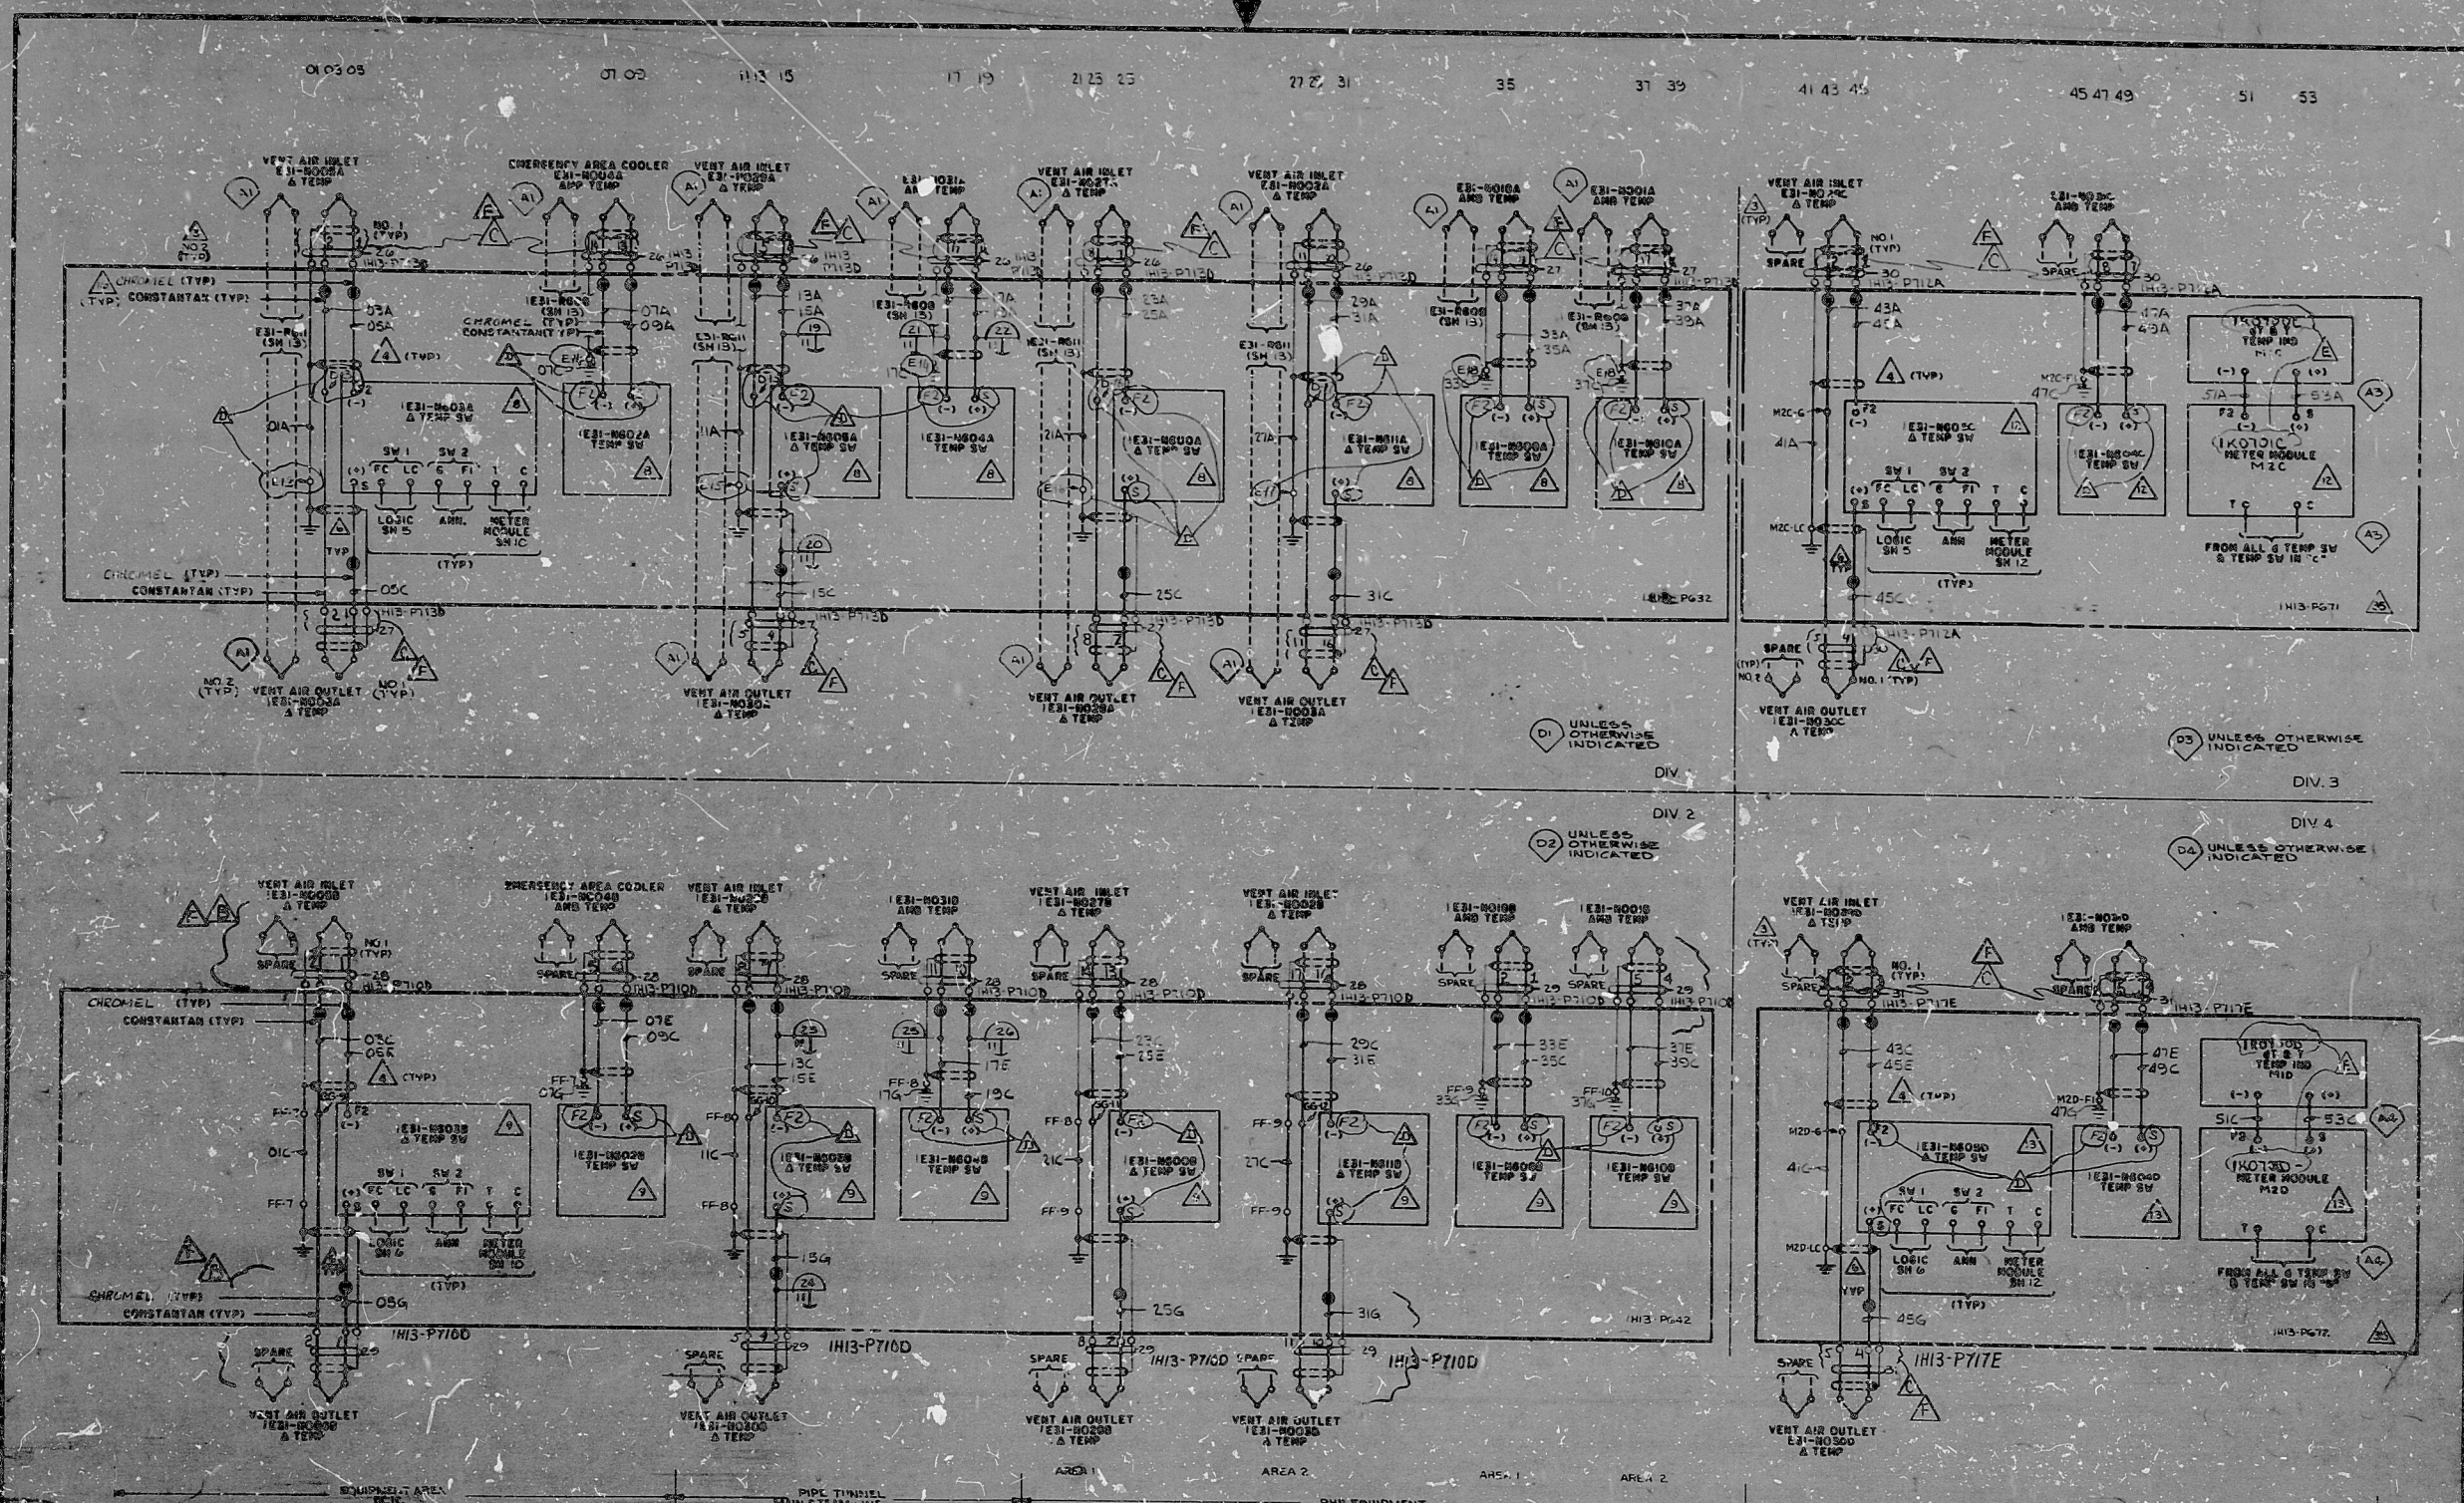

- NOTES**
1. IH3-P710 TERMINATION CABINET  
LINE CODE 25  
LINE CODE 27
  2. IH3-P711 TERMINATION CABINET  
LINE CODE 25  
LINE CODE 27
  3. IH3-P712 TERMINATION CABINET  
LINE CODE 25  
LINE CODE 27
  4. IH3-P713 TERMINATION CABINET  
LINE CODE 25  
LINE CODE 27
  5. IH3-P714 TERMINATION CABINET  
LINE CODE 25  
LINE CODE 27
  6. IH3-P715 TERMINATION CABINET  
LINE CODE 25  
LINE CODE 27
  7. IH3-P716 TERMINATION CABINET  
LINE CODE 25  
LINE CODE 27
  8. IH3-P717 TERMINATION CABINET  
LINE CODE 25  
LINE CODE 27

PRC  
APERTURE  
CARD

NUCLEAR SAFETY RELATED

THE CLEVELAND ELECTRIC ILLUMINATING CO.

PERRY NUCLEAR POWER PLANT UNIT 1

ELECTRICAL-ELEMENTARY DIAGRAM

LEAK DETECTION SYSTEM

TEMPERATURE ELEMENTS

REVISED AS PER GE DWG

LEAK DETECTION SYSTEM  
REVISOR STANDARD PLANT

REV.	NO.	DATE	BY	CHKD.	APP. DATE	REASON	DATE	BY	CHKD.	APP. DATE	REASON
1	1	11/1/80	Y2	RM	DEC 11/1/80	REVISED FITS TERM NOS. PER GE REVISION					
2	2	11/1/80	B	DWS	DEC 11/1/80	ADDED FITS INFORMATION					

ED 11-11-80 ORIGINAL TEMPERATURE ELEMENT

11  
11  
8.5  
8.5  
11  
17



RIDS

8212160622

