



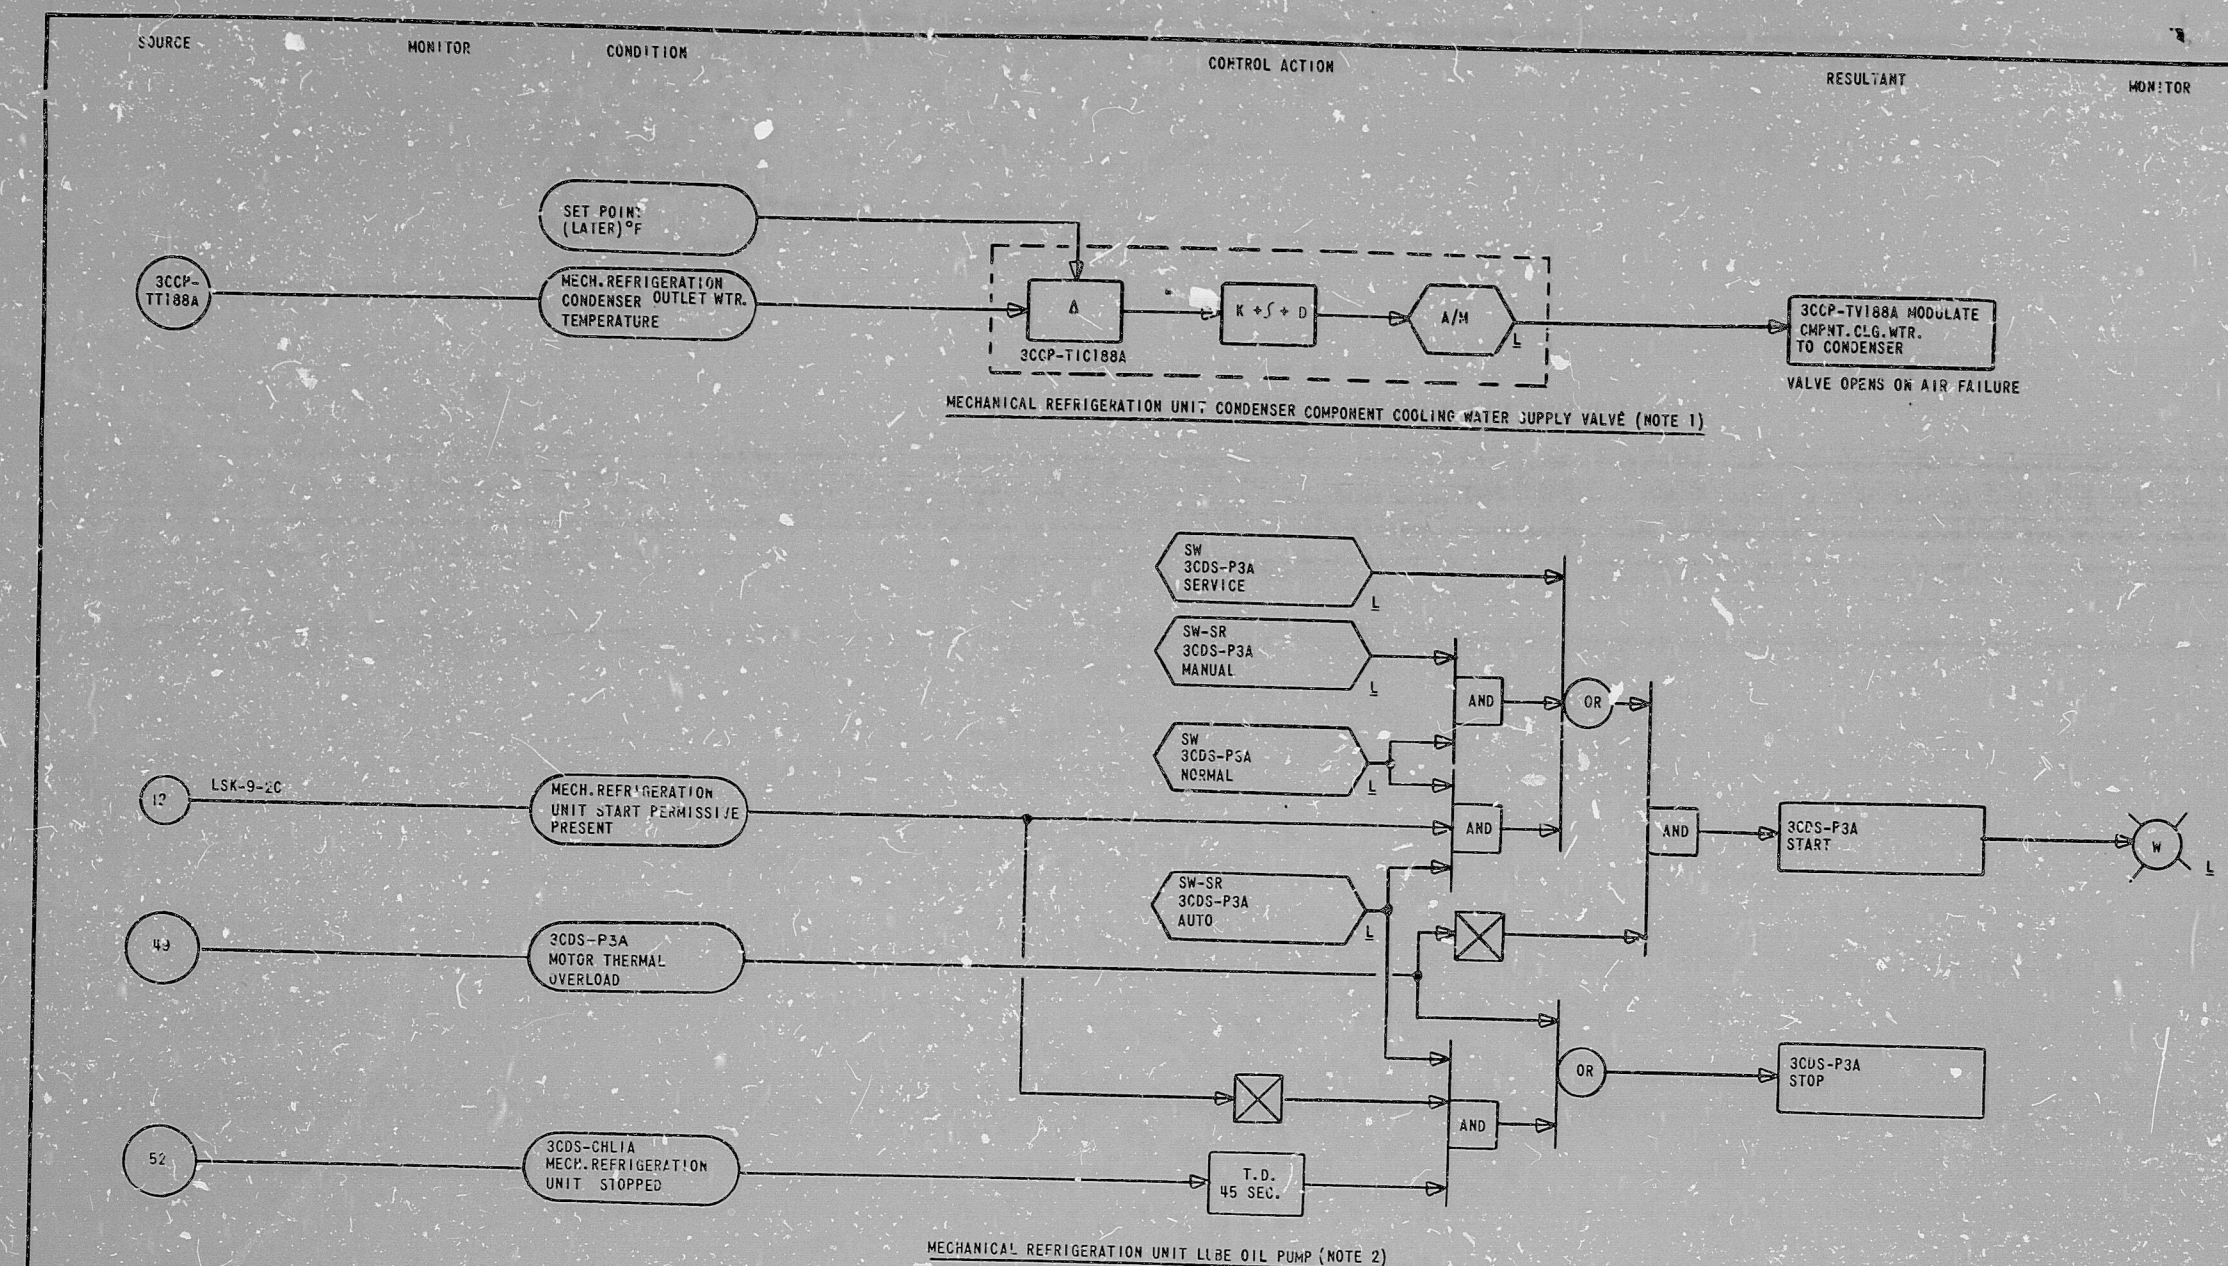

- NOTES:
- CONTROL FOR MECHANICAL REFRIGERATION UNIT CONDENSER COMPONENT COOLING WATER SUPPLY VALVE 3CCP-TV188A IS SHOWN. CONTROL FOR MECHANICAL REFRIGERATION UNIT CONDENSER COMPONENT COOLING WATER SUPPLY VALVE 3CCP-TV188B, 188C IS SIMILAR.
 - CONTROL FOR MECHANICAL REFRIGERATION UNIT 3CDS-P3A IS SHOWN. CONTROL FOR 3CDS-P3B AND 3CDS-P3C ARE SIMILAR.

PRO
APERTURE
CARD



REV. DATE		DESCRIPTION		BY		CHK		APP	
REVISIONS DURING CONSTRUCTION									
NORTHEAST NUCLEAR ENERGY COMPANY SUBSIDIARY OF NORTHEAST UTILITIES									
TITLE: MILLSTONE NUCLEAR POWER STATION - UNIT NO. 3 LOGIC DIAGRAM CHILLED WATER SYSTEM									
6	10/1/78	GENERAL	CH	10/1/78	10/1/78	10/1/78	10/1/78	10/1/78	10/1/78
5	9/1/78	GENERAL	CH	9/1/78	9/1/78	9/1/78	9/1/78	9/1/78	9/1/78
4	8/1/78	GENERAL	CH	8/1/78	8/1/78	8/1/78	8/1/78	8/1/78	8/1/78
3	7/1/78	GENERAL	CH	7/1/78	7/1/78	7/1/78	7/1/78	7/1/78	7/1/78
2	6/1/78	NEW DRAWING	CH	6/1/78	6/1/78	6/1/78	6/1/78	6/1/78	6/1/78

SCALE: 1" = 1'-0"

DATE: 10/1/78

DWG. NO. 25212-28165

STONE & WEBSTER ENGINEERING CORPORATION
BOSTON, MASS.

S & W DWG. NO. 12179-L SK-9-2J

RIDS

8212220081

