


CONTINUED FROM DWG B-208-222 SH 727

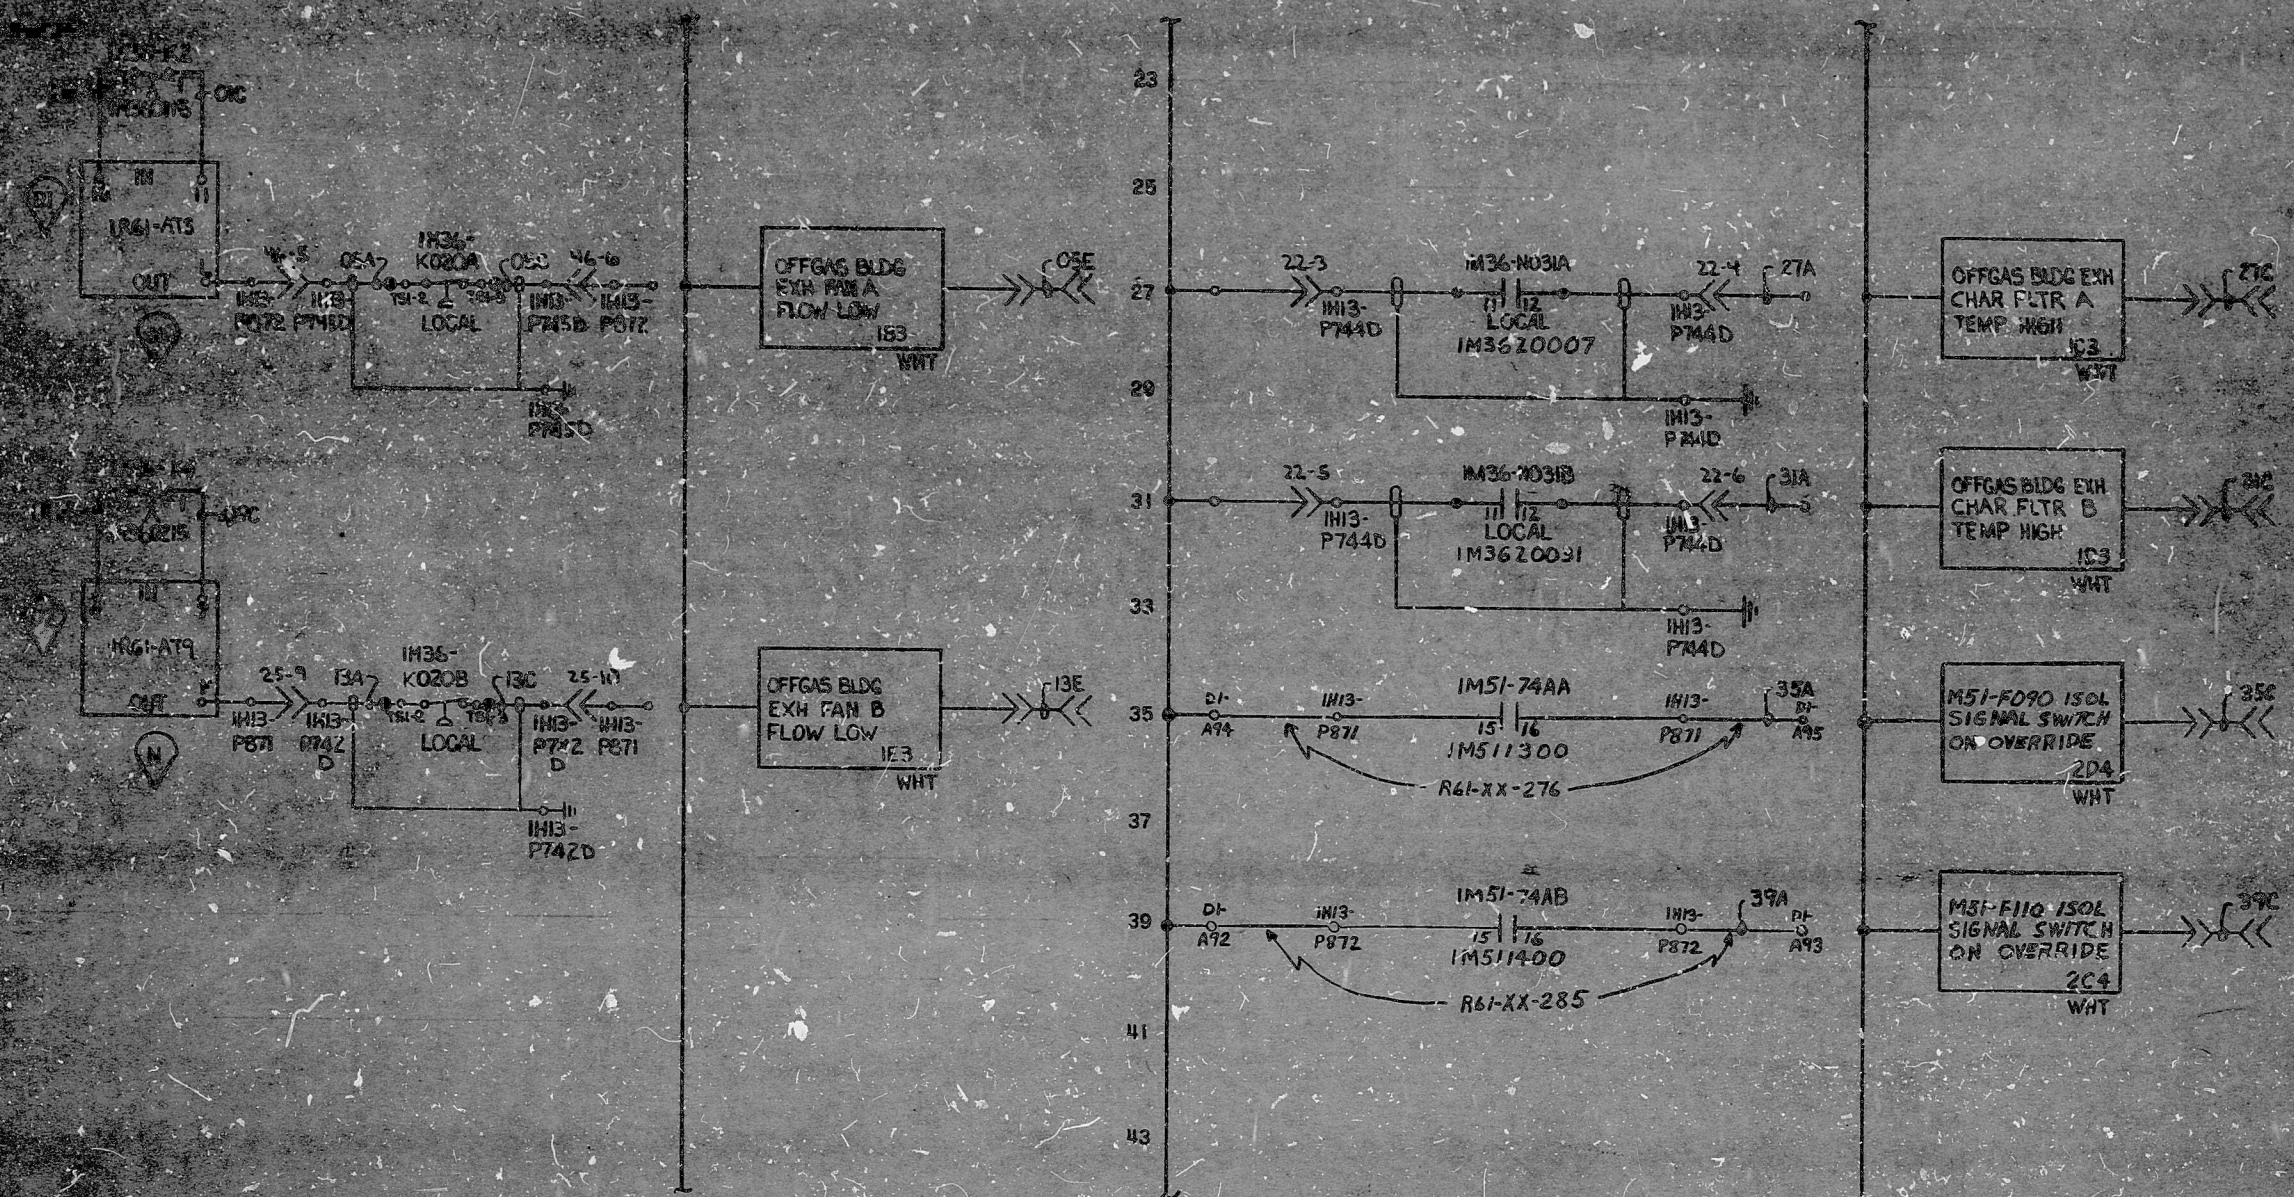

1. ALL TERMINALS ARE TO BE WELDED TO THE PANEL.
 2. ALL WIRING IS TO BE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE.
 3. ALL WIRING IS TO BE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE.
 4. ALL WIRING IS TO BE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE.
 5. ALL WIRING IS TO BE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE.
 6. ALL WIRING IS TO BE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE.
 7. POWER TO ISOLATORS IS SHOWN ON DWG. B-208-222 SHS 925-951

CLASS IE - DIV 1
 CLASS IE - DIV 2

CONTINUED ON TO DWG B-208-222 SH 729

PRC APERTURE CARD

NUCLEAR SAFETY RELATED

THE CLEVELAND ELECTRIC ILLUMINATING CO.

PERMIT LEVEL BAK POWER PLANT (UNIT 1)

FUNCTION - CONTROL SYSTEM

CONTROL ROOM APERTURE CARD

CARD BOARD PANEL (TYPE 200)

NO.	CONSTRUCTION	DATE	RELEASED FOR	BY
1	PRELIMINARY			
2				
3				
4				
5				
6				
7				
8				
9				
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				
21				
22				
23				
24				
25				
26				
27				
28				
29				
30				
31				
32				
33				
34				
35				
36				
37				
38				
39				
40				
41				
42				
43				
44				
45				
46				
47				
48				
49				
50				

21
 11
 8.5"
 8.5"
 11"
 17"

Rids

8212220514

