

17"

11"

8.5"

8.5"

11"

17"

17"


11"

8.5"

8.5"

11"

17"

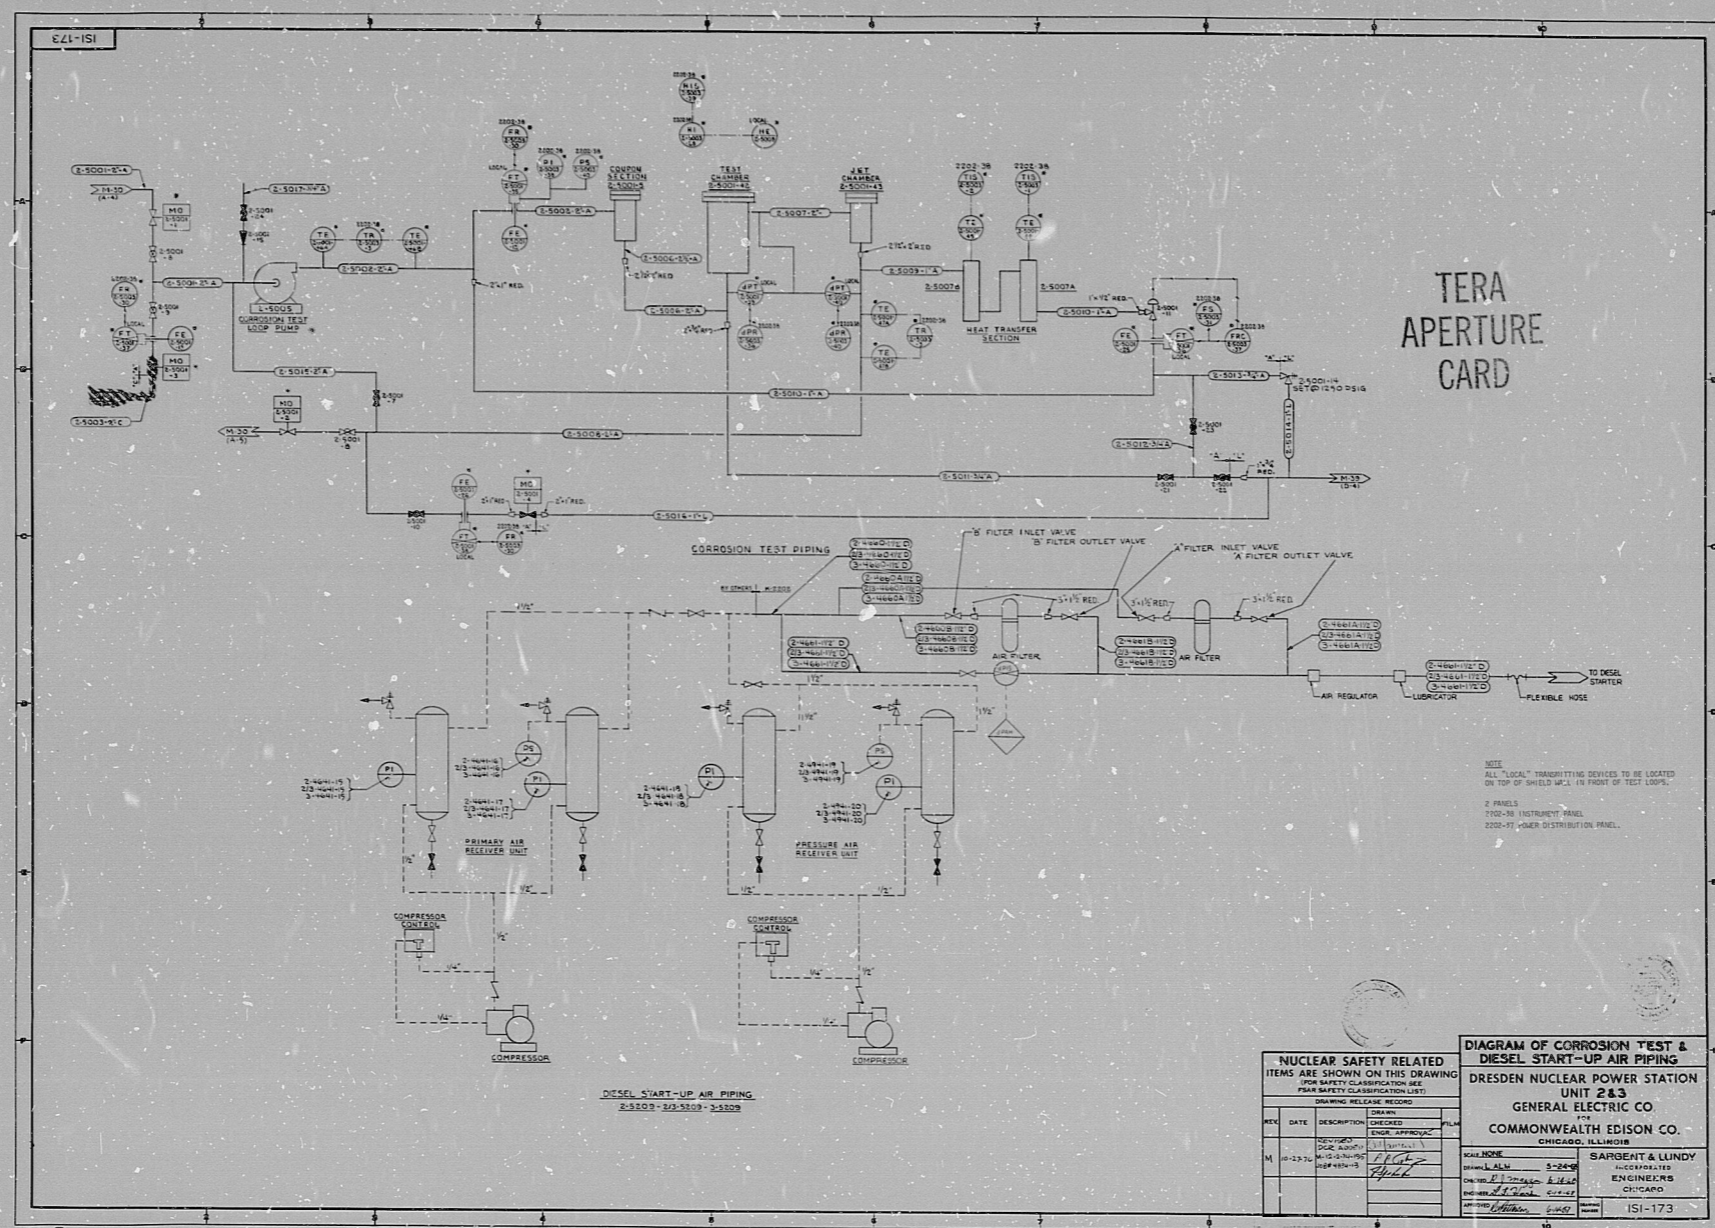

TERA APERTURE CARD

NOTE:
ALL "LOCAL" TRANSMITTING DEVICES TO BE LOCATED
ON TOP OF SHIELD WALL, IN FRONT OF TEST LOOPS.
2 PANELS
700-38 INSTRUMENT PANEL
200-41 POWER DISTRIBUTION PANEL.

DIAGRAM OF CORROSION TEST & DIESEL START-UP AIR PIPING
DRESDEN NUCLEAR POWER STATION
UNIT 2 & 3
GENERAL ELECTRIC CO.
COMMONWEALTH EDISON CO.
CHICAGO, ILLINOIS

REV	DATE	DESCRIPTION	DESIGNED	CHECKED	APPROVED
M	10-12-70	REVISED TO SHOW CORROSION TEST PIPING	[Signature]	[Signature]	[Signature]

SCALE: AS SHOWN
DRAWN BY: [Signature]
CHECKED BY: [Signature]
DATE: 10-12-70

SAUGENT & LINDY
ENGINEERS
CHICAGO

ISI-173

RTS

8107130539

