


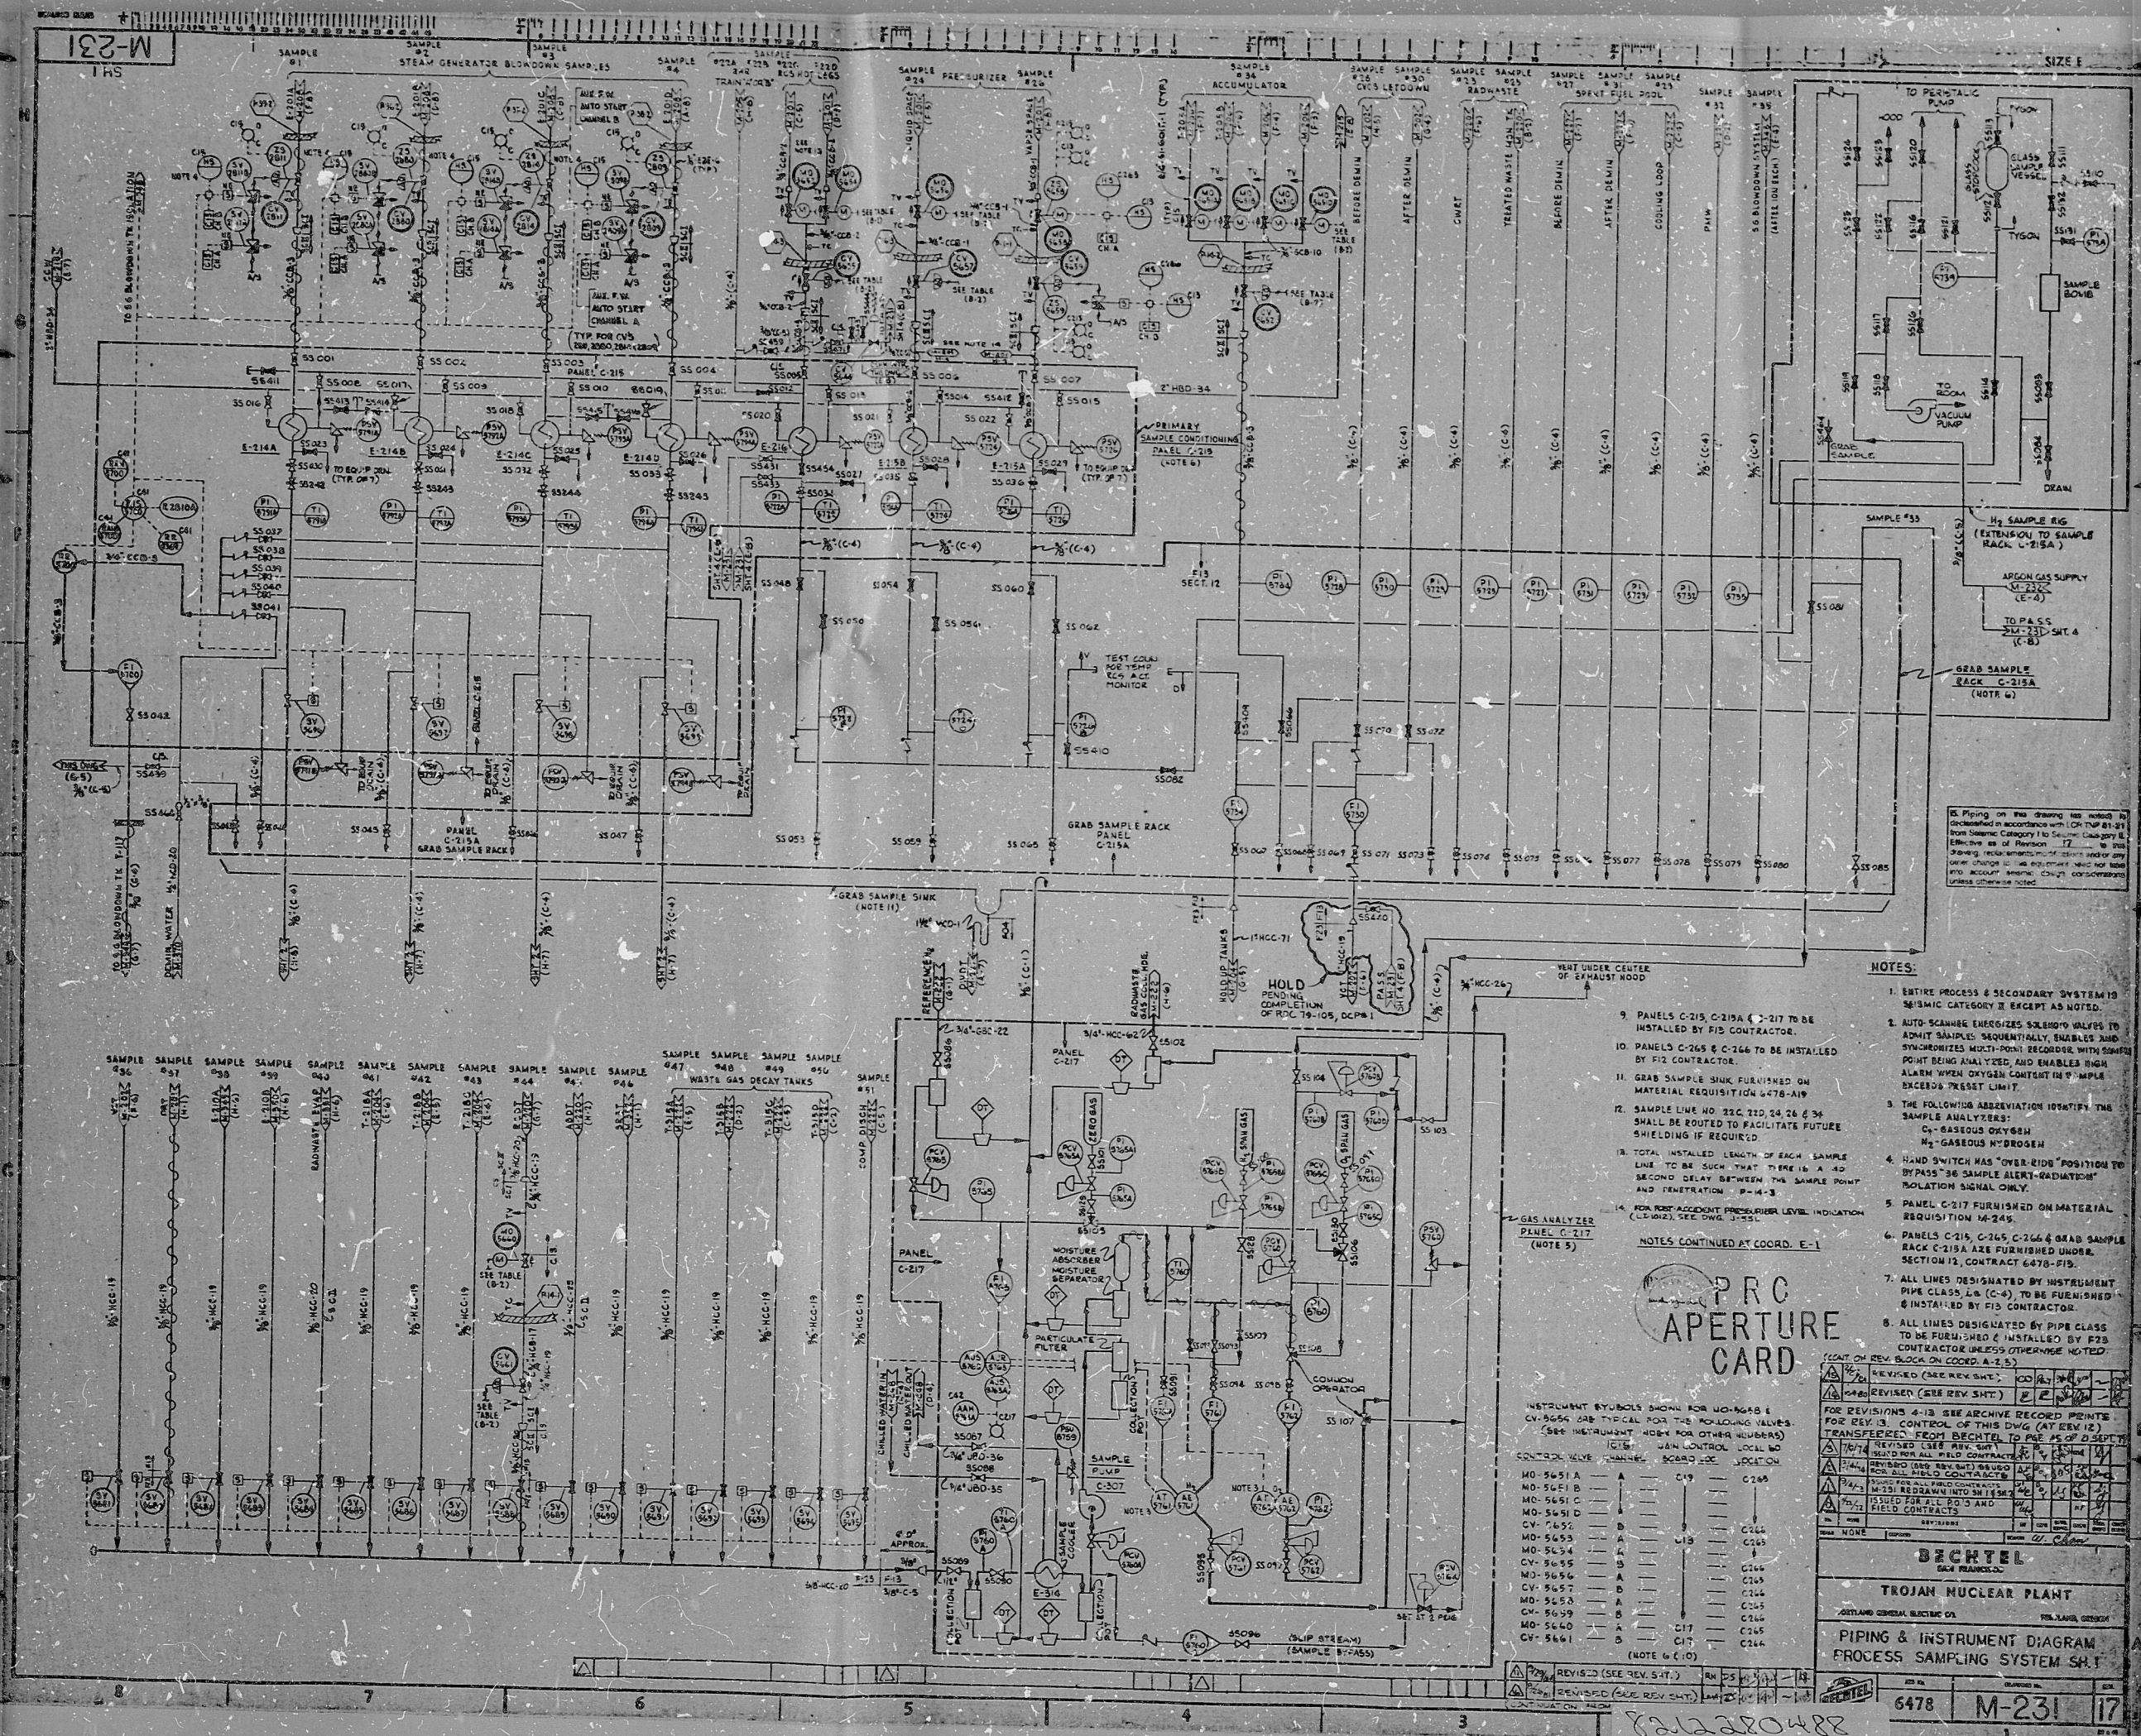

PRC
APERTURE
CARD

1. ENTIRE PROCESS & SECONDARY SYSTEM IS SEMI-MIC CATEGORY II EXCEPT AS NOTED.
2. AUTO-SCANNERS EMERGENCIES SENSORS VALVES TO ADMIT SAMPLES SEQUENTIALLY, TANKS AND SENSORS MONITORS WITH POINT RECORDING WITH SENSITIVE POINT BEING ANALYZED, AND ENABLES HIGH ALARM WHEN Airing CONTENT IN 5" PIPE EXCEEDS PRESET LIMIT.
3. THE FOLLOWING ABBREVIATION IDENTIFY THE SAMPLE ANALYZERS:
C- GASIOUS OXYGEN
M- GASIOUS HYDROGEN
4. HAND SWITCH HAS "OVER-RID" POSITION TO BYPASS "56 SAMPLE ALERT-REDUCTION" ISOLATION SIGNAL ONLY.
5. PANEL C-217 FURNISHED ON MATERIAL REQUISITION M-245.
6. PANELS C-215, C-245, C-266 & BRAD SAMPLE RACK C-215A ARE FURNISHED UNDER SECTION 12, CONTRACT 6478-215.
7. ALL LINES DESIGNATED BY INSTRUMENT PIPE CLASS L6 (C-6) TO BE FURNISHED & INSTALLED BY F13 CONTRACTOR.
8. ALL LINES DESIGNATED BY PIPE CLASS TO BE FURNISHED & INSTALLED BY F23 CONTRACTOR UNLESS OTHERWISE NOTED.

(CONT ON REV. BLOCK ON COVER)

[illegible]

RIDS™

8212280488

