MPL No.1148 1015M | M-1102A

SCALING RULES

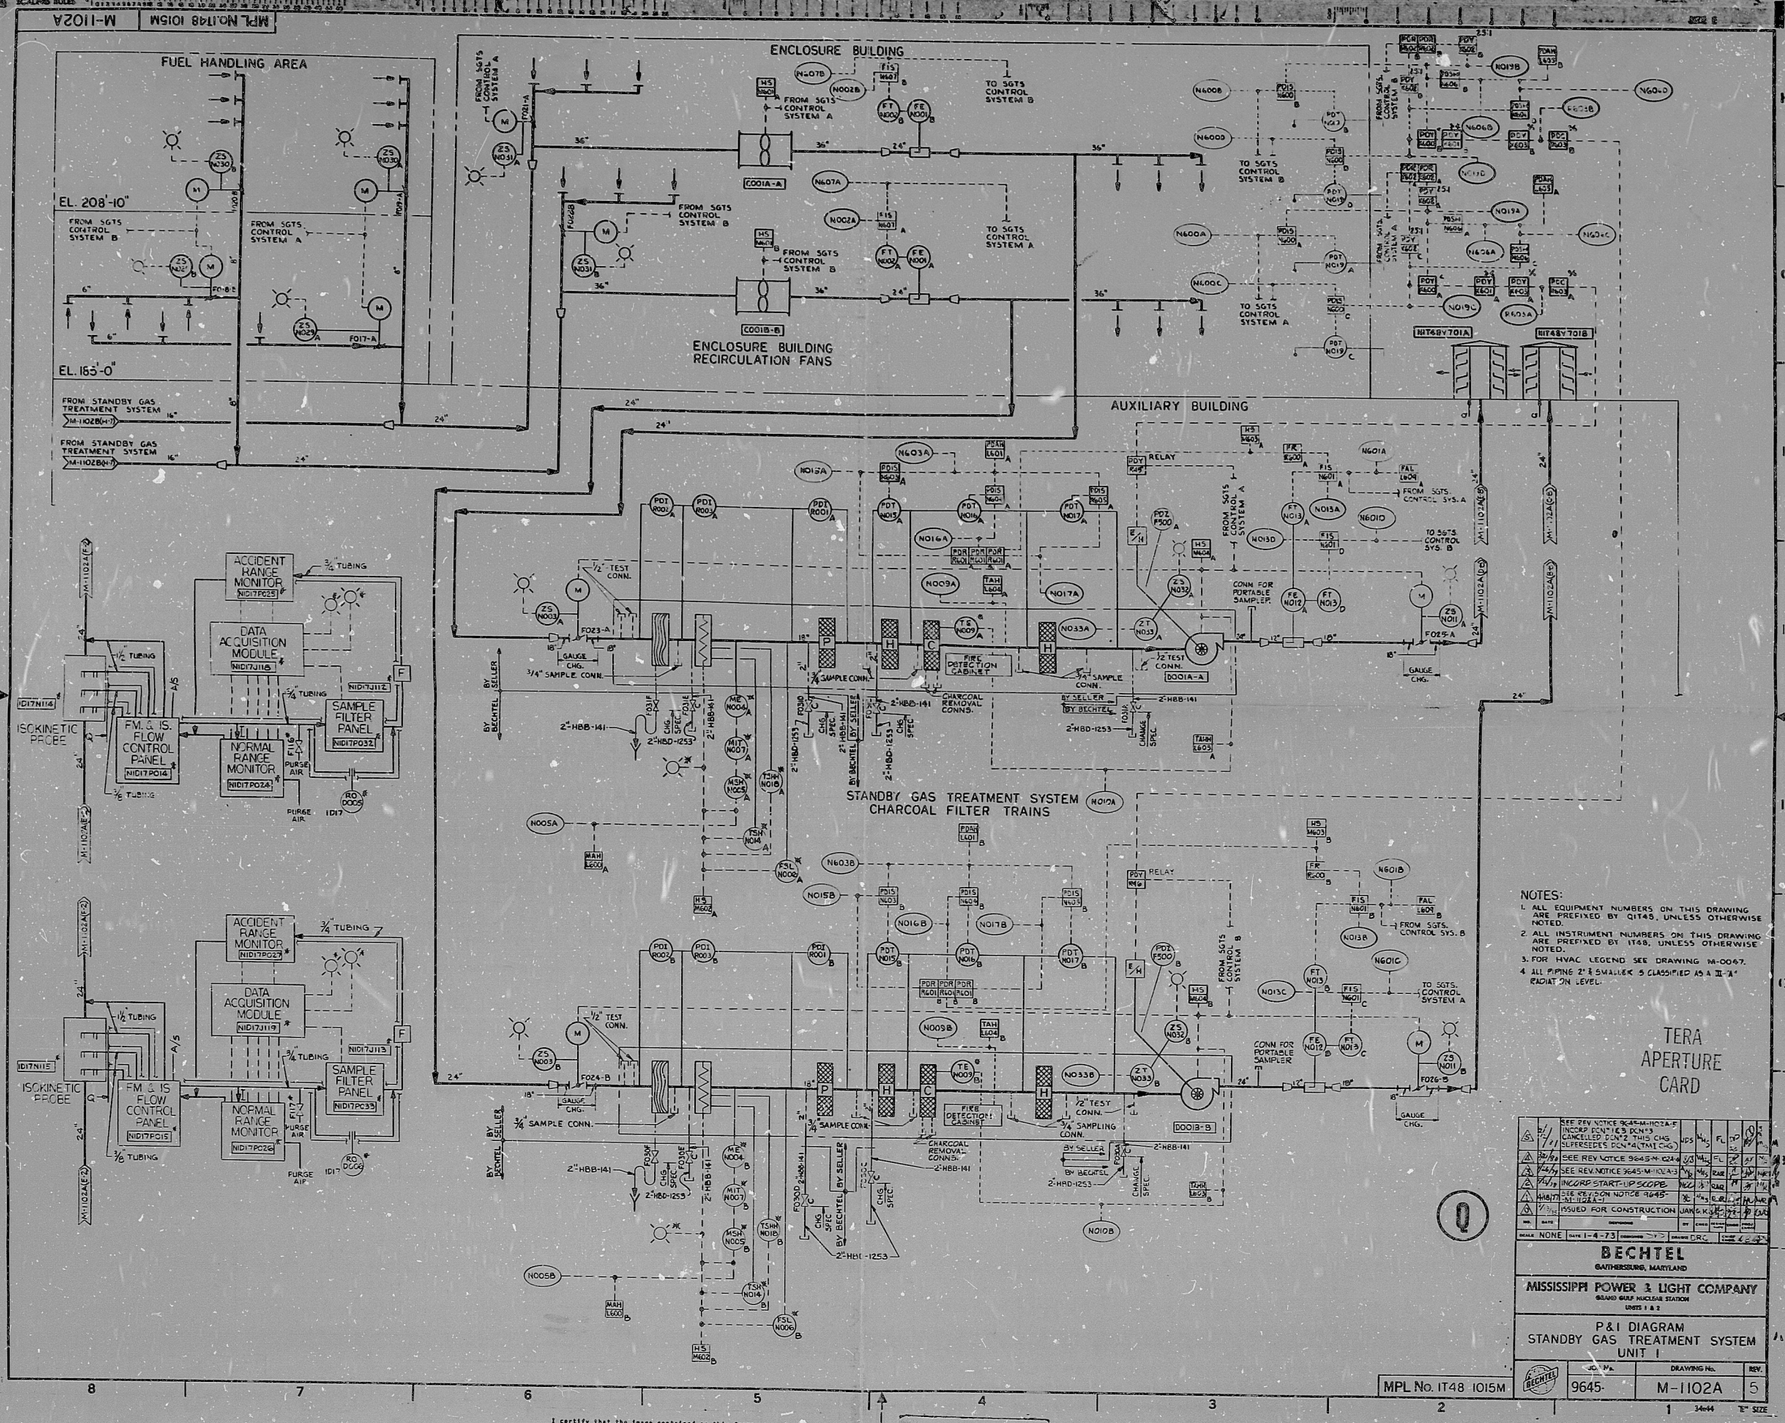

NOTES:
1. ALL EQUIPMENT NUMBERS ON THIS DRAWING ARE PREFIXED BY 1148, UNLESS OTHERWISE NOTED.
2. ALL INSTRUMENT NUMBERS ON THIS DRAWING ARE PREFIXED BY 1148, UNLESS OTHERWISE NOTED.
3. FOR HVAC LEGEND SEE DRAWING M-0067.
4. ALL PIPING 2" & SMALLER IS CLASSIFIED AS A III-A" RADIATION LEVEL.

TERA APERTURE CARD

5	11/1/73	SEE REV NOTICE 9645-M-1102A-5 INCORP PCN'S 8 PCN'S CANCELLED PCN'S THIS CHG SUPERSEDES PCN'S 4 (TMI CHG)	WDS	MAL	FL	AT	AT		
4	10/19/73	SEE REV NOTICE 9645-M-1102A-4	WDS	MAL	CAM	AT	AT		
3	9/14/73	SEE REV NOTICE 9645-M-1102A-3	WDS	MAL	CAM	AT	AT		
2	8/10/73	INCORP START-UP SCOPE	WDS	MAL	FL	AT	AT		
1	6/8/73	SEE REV NOTICE 9645-M-1102A-1	WDS	MAL	CAM	AT	AT		
0	4/6/73	ISSUED FOR CONSTRUCTION	JAM	G.K.	FL	AT	AT		

SCALE NONE | DATE 1-4-73 | DRAWN CRC

BECHTEL
GAITHERSBURG, MARYLAND

MISSISSIPPI POWER & LIGHT COMPANY
GRAND GULF NUCLEAR STATION
UNITS 1 & 2

P&I DIAGRAM
STANDBY GAS TREATMENT SYSTEM
UNIT 1

JOB NO. 9645 | DRAWING NO. M-1102A | REV. 5

MPL No. 1148 1015M

I certify that the image contained on this frame was made in the normal and regular course of business, on the date stated below and that it is an accurate reproduction of the document(s) submitted to microphotic.
DATE 6-6-74 OPERATOR _____ SUPERVISOR _____

30X

8107160521

RIDS-PDR

8107160521

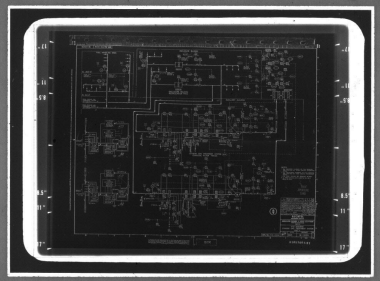

MMM 5824 — FILMSORT® Brand Aperture & Camera Cards and DUPLICARD® Brand Copy Cards — Product of 3M Company, St. Paul, Minn.