

17"

11"

8.5"

8.5"

11"

17"

17"

11"

8.5"


8.5"

11"

17"

RA

The drawings and the design it shows are the property of BECHTEL. They are made, issued and on the contractor's exclusive responsibility. They may not be reproduced, copied, loaned, exhibited, or used except as authorized by the contractor. The contractor shall be responsible for the accuracy of the information contained herein.

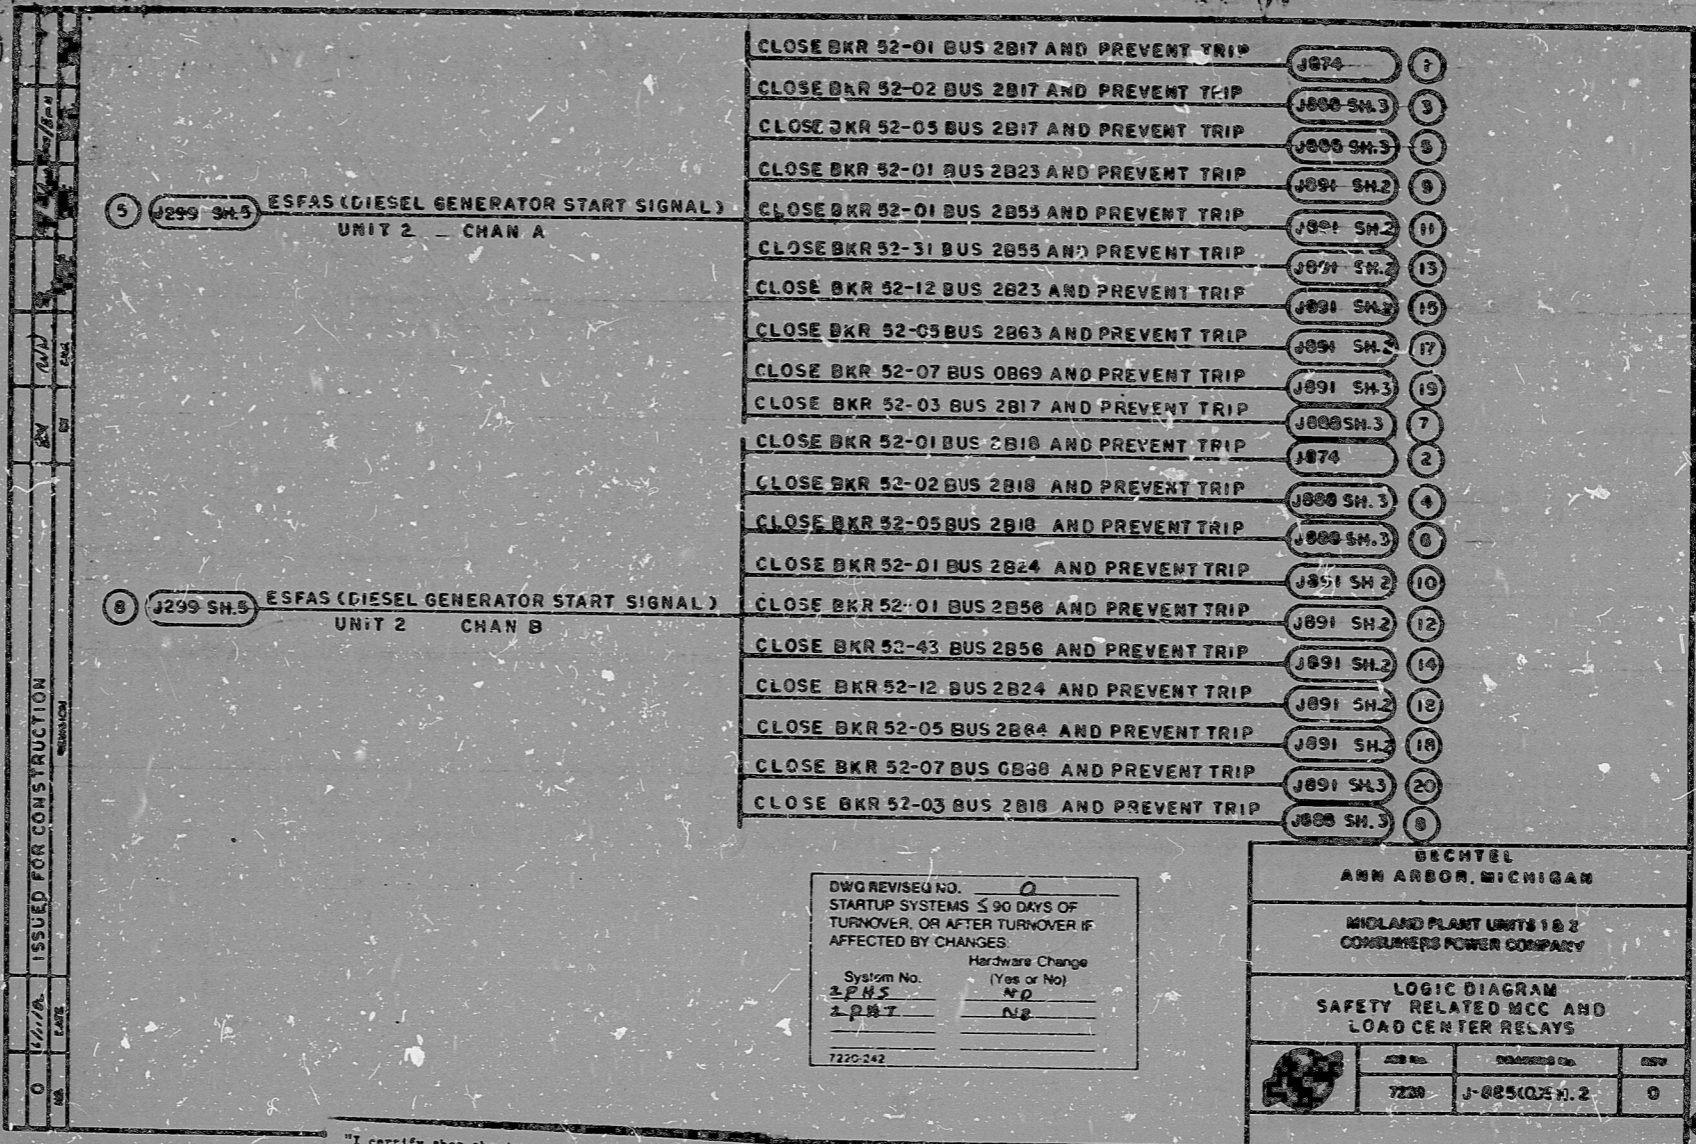

DWG REVISED NO. 0  
 STARTUP SYSTEMS ≤ 90 DAYS OF  
 TURNOVER, OR AFTER TURNOVER IF  
 AFFECTED BY CHANGES

System No.	Hardware Change (Yes or No)
1. PHS	NO
2. PBT	NO

7220-242

**BECHTEL**  
ANN ARBOR, MICHIGAN

MIDLAND PLANT UNITS 1 & 2  
CONSUMERS POWER COMPANY

LOGIC DIAGRAM  
SAFETY RELATED MCC AND  
LOAD CENTER RELAYS

DWG No.	REVISION No.	DATE
7230	J-825(Q2) 1.2	0

"I certify that the image contained on this frame was made in the normal and regular course of business, on the date stated below and that it is an accurate reproduction of the document submitted to the contractor for filing, by Bechtel Power Corporation."

6-15-72 DATE  
 M. G. ... CAMERA OPERATOR  
 J. ... CONTRACTOR'S SUPERVISOR OR MANAGER

16X

PRO APERTURE CARD

RIDS

8302030160

