

17"


11"

8.5"

17"

11"

8.5"

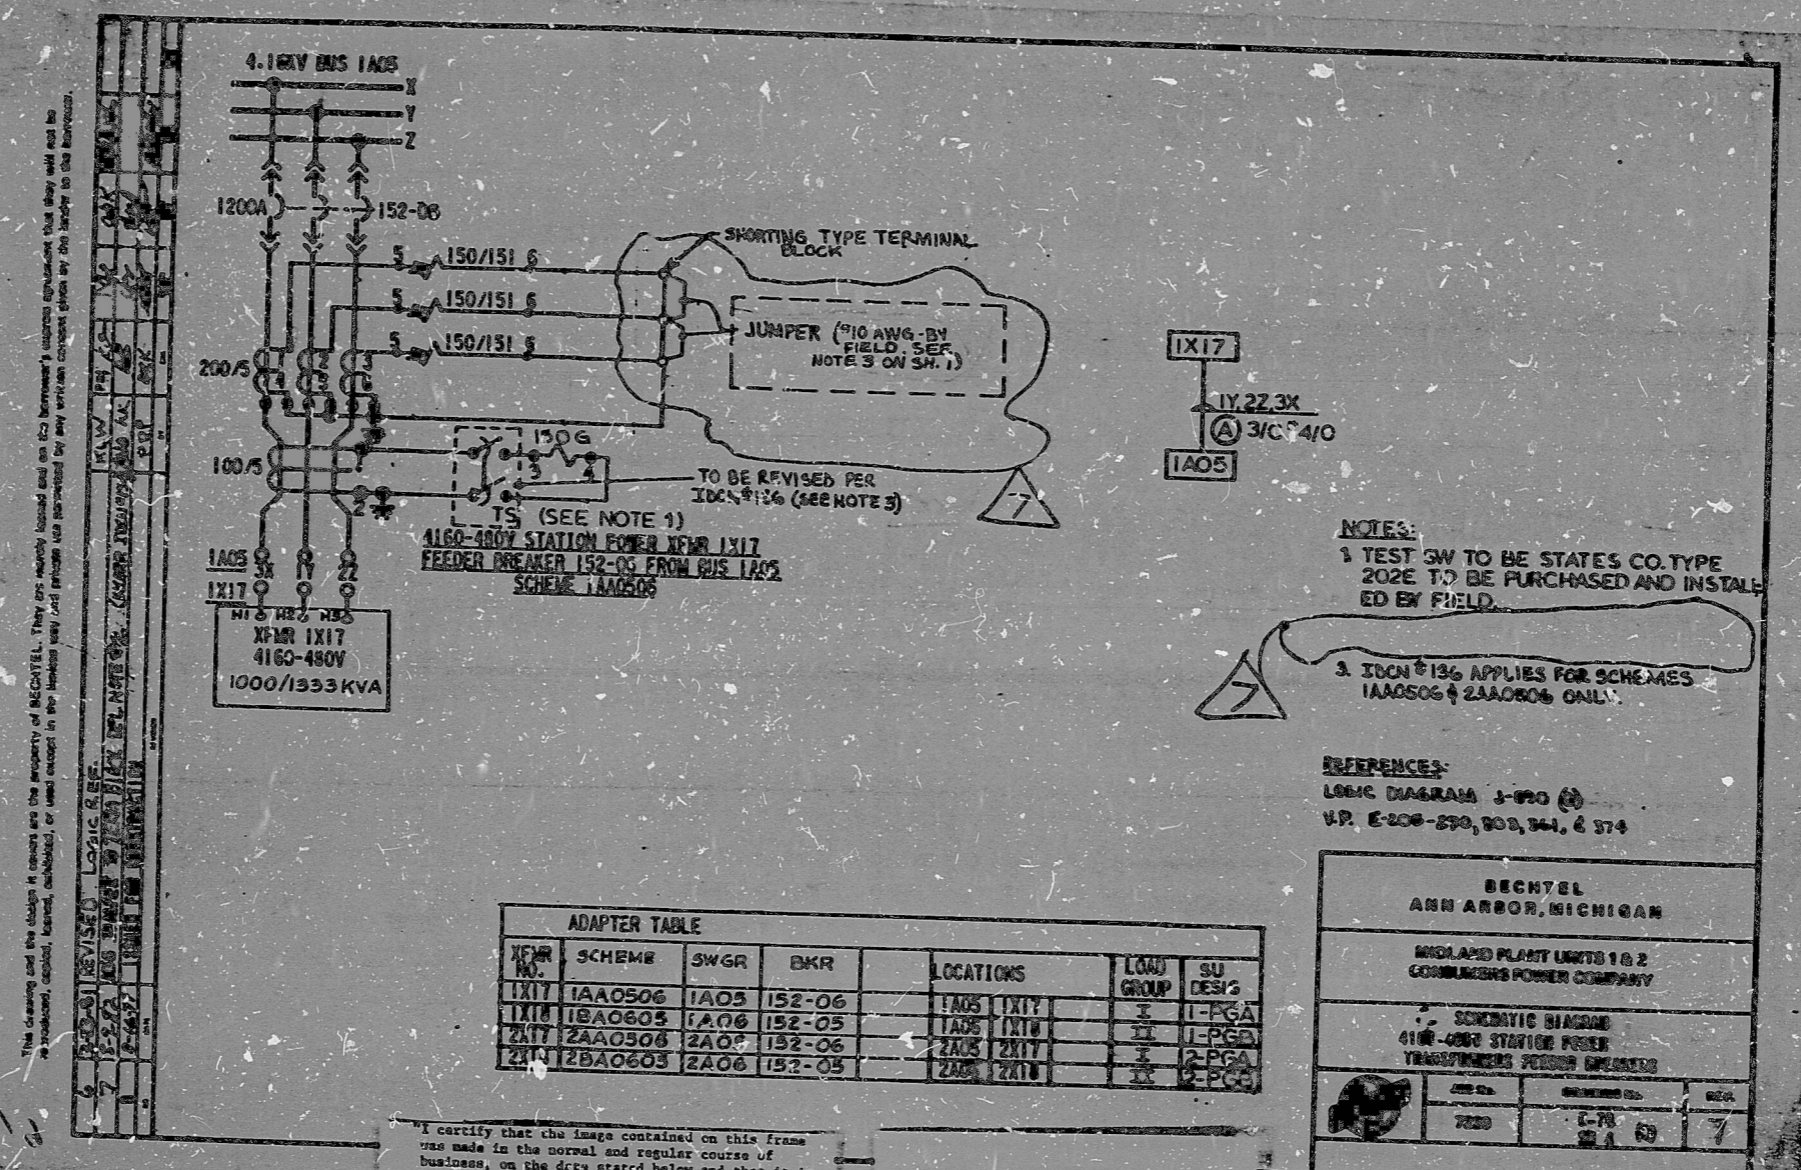

The drawing and the design it covers are the property of BECHTEL. They are hereby loaned and are to be returned to BECHTEL. They are not to be reproduced, copied, loaned, exhibited, or used except in the limited way and for the limited purpose intended by BECHTEL. The drawing is to be returned to BECHTEL.

NOTES:
 1 TEST SW TO BE STATES CO. TYPE 202E TO BE PURCHASED AND INSTALLED BY FIELD.

2 ICON #136 APPLIES FOR SCHEMES 1AA0506 & 2AA0606 ONLY.

REFERENCES:
 LOGIC DIAGRAM 3-790 (C)
 U.P. E-206-270, 303, 341, & 374

FEEDER NO.	SCHEME	SWGR	BKR	LOCATIONS	LOAD GROUP	SU DESIG
1X17	1AA0506	1A05	152-06	1A05 1X17	I	1-PGA
1X18	1BA0603	1A06	152-05	1A06 1X18	II	1-PGA
2X17	2AA0906	2A09	152-06	2A09 2X17	I	2-PGA
2X18	2BA0603	2A06	152-05	2A06 2X18	II	2-PGA

BECHTEL ANN ARBOR, MICHIGAN		
MIDLAND PLANT UNITS 1 & 2 GOVERNORS POWER COMPANY		
SCHEMATIC DIAGRAM 4160-480V STATION POWER TRANSFORMERS FEEDER BREAKERS		
REV. NO.	REVISION	DATE
7000	C-70 S.A. 10	7

I certify that the design contained on this frame was made in the normal and regular course of business, on the day stated below and that it is an accurate reproduction of the document submitted to the contractor for filing, by Bechtel Power Corporation.

8/12/52 DATE
 M. C. ... CAMERA OPERATOR
 J. Ottamer CONTRACTOR'S SUPERVISOR OR MANAGER

16X

PRO APERTURE CARD

8.5"

11"

17"

8.5"

11"

17"

RIDS

8302020516

