

17"

17"

16"

16"

9.5"

9.5"

8.5"


8.5"

11"

11"

17"

17"

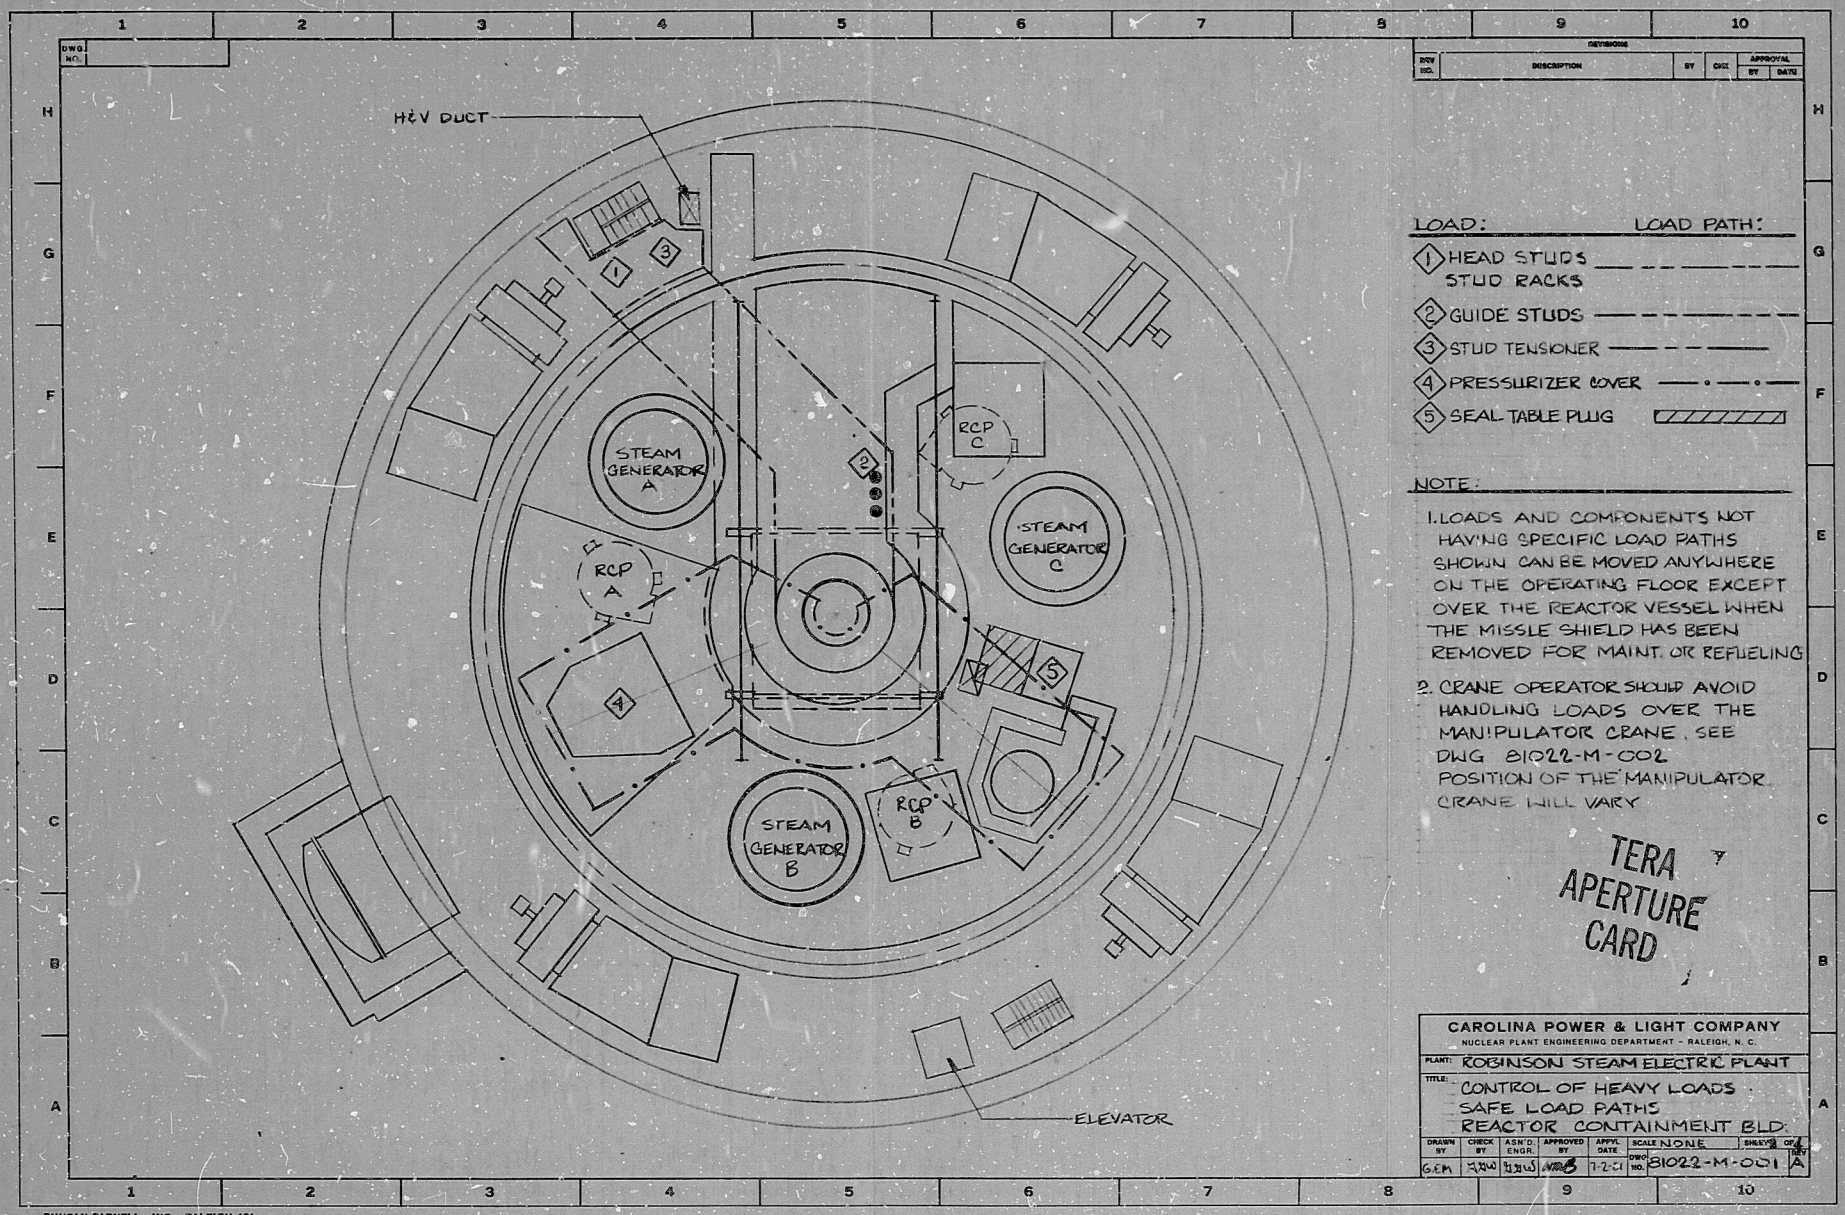

REV	DESCRIPTION	BY	CHK	DATE	APPROVAL

LOAD:	LOAD PATH:
① HEAD STUDS	-----
② GUIDE STUDS	-----
③ STUD TENSIONER	-----
④ PRESSURIZER COVER	-----
⑤ SEAL TABLE PLUG	▨▨▨▨▨

**NOTE:**

- LOADS AND COMPONENTS NOT HAVING SPECIFIC LOAD PATHS SHOWN CAN BE MOVED ANYWHERE ON THE OPERATING FLOOR EXCEPT OVER THE REACTOR VESSEL WHEN THE MIDDLE SHIELD HAS BEEN REMOVED FOR MAINT. OR REFUELING
- CRANE OPERATOR SHOULD AVOID HANDLING LOADS OVER THE MANIPULATOR CRANE. SEE DWG. B1022-M-002 POSITION OF THE MANIPULATOR CRANE WILL VARY

TERA  
APERTURE  
CARD

CAROLINA POWER & LIGHT COMPANY					
NUCLEAR PLANT ENGINEERING DEPARTMENT - RALEIGH, N. C.					
PLANT: ROBINSON STEAM ELECTRIC PLANT					
TITLE: CONTROL OF HEAVY LOADS - SAFE LOAD PATHS REACTOR CONTAINMENT BLD.					
DRAWN BY	CHECKED BY	DESIGNED BY	APPROVED BY	DATE	SCALE
G.E.P.	R.W.	H.W.	J.W.	7-2-61	AS SHOWN

8103170285

DUNCAN-PARNELL, INC., RALEIGH 181

RTDS

8108170285

