
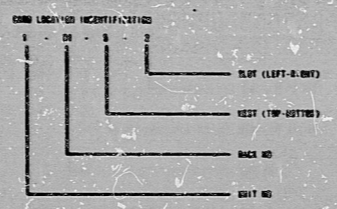
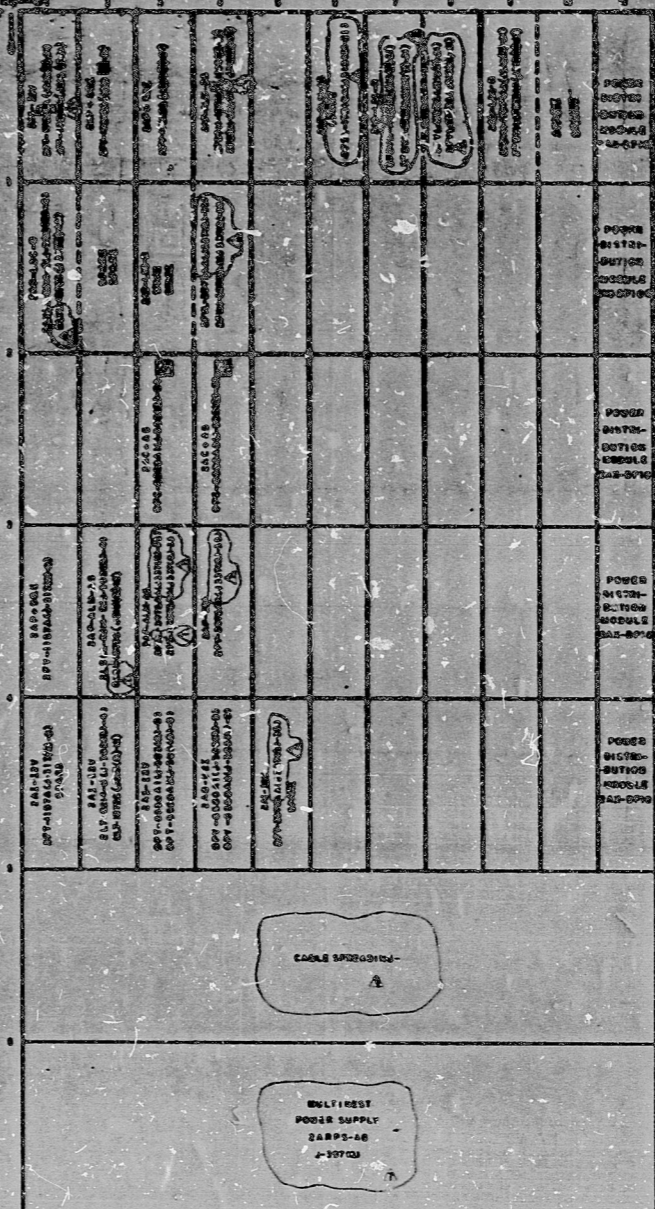


17"
11"
8.5"
8.5"
11"
17"

17"
11"
8.5"
8.5"
11"
17"

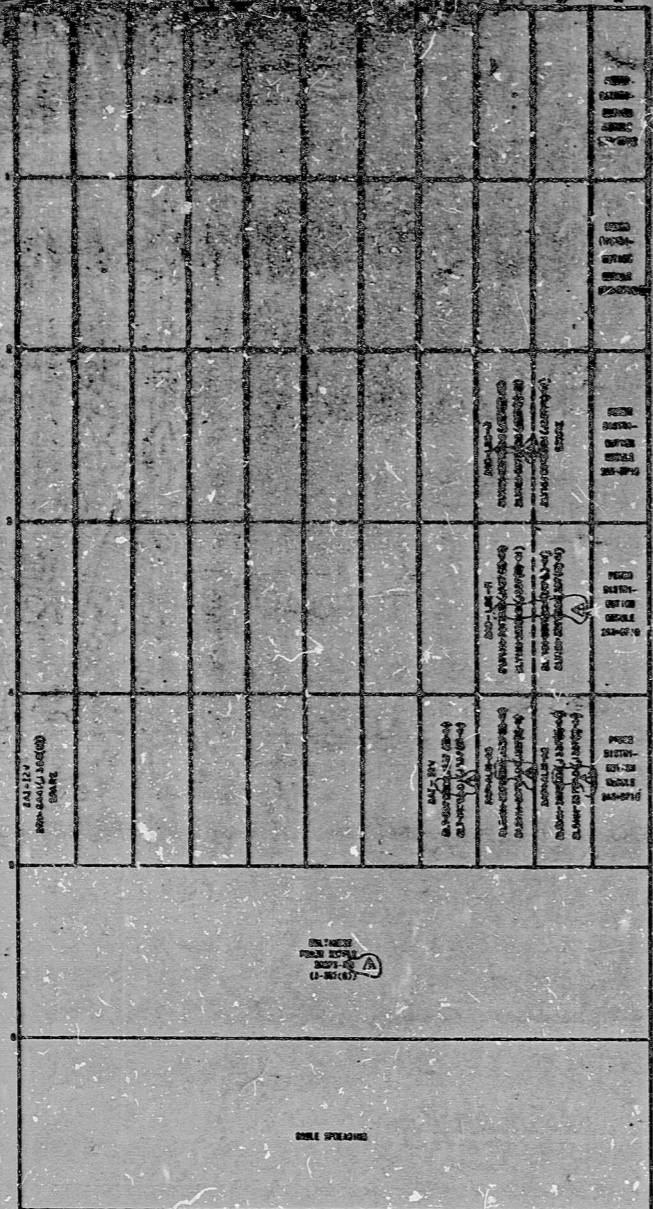

GENERAL NOTES:
 1. THIS DRAWING IS TO BE USED FOR MODULE LOCATION AND AS A REFERENCE TO THE LOOP DIAGRAMS ONLY. FOR EXACT USAGE IN MODULES WITH MULTIPLE INPUTS/OUTPUTS, REFER TO THE SPECIFIC LOOP DIAGRAM.

PRC
 APERTURE
 CARD

NOTES:
 REVISION 0 WAS FORGOTTEN AS SHIPPED

REVISIONS

NO.	DATE	BY	DESCRIPTION
0			

REVISED AS SHOWN	DATE	BY	DESCRIPTION
REMOVED AS SHOWN	DATE	BY	DESCRIPTION
ADDED AS SHOWN	DATE	BY	DESCRIPTION
REMOVED AS INDICATED	DATE	BY	DESCRIPTION
ISSUE FOR IDENTIFICATION	DATE	BY	DESCRIPTION

30X

SECURITY

FIRELAND PLANT UNIT 8
 COMMERCIAL POWER COMPANY

DISTRICT OFFICE - NEW YORK
 DIVISION OF PLANT - (C)

DATE	APPROVED BY	DATE
7/22/60	J. BOSSIGI SM. 4	7

RIDS

8302040309

