


This drawing and the design it covers are the property of BECHTEL. They are hereby loaned and an express agreement that they will not be reproduced, copied, loaned, exhibited, or used except in the limited way and for the limited period permitted by any written consent given by the lender to the borrower.

4	7/7/72	REVISION AND ISSUED
3	03-05-82	REVISED ADAPTER TABLE
0	06-04-80	ISSUED FOR CONSTRUCTION

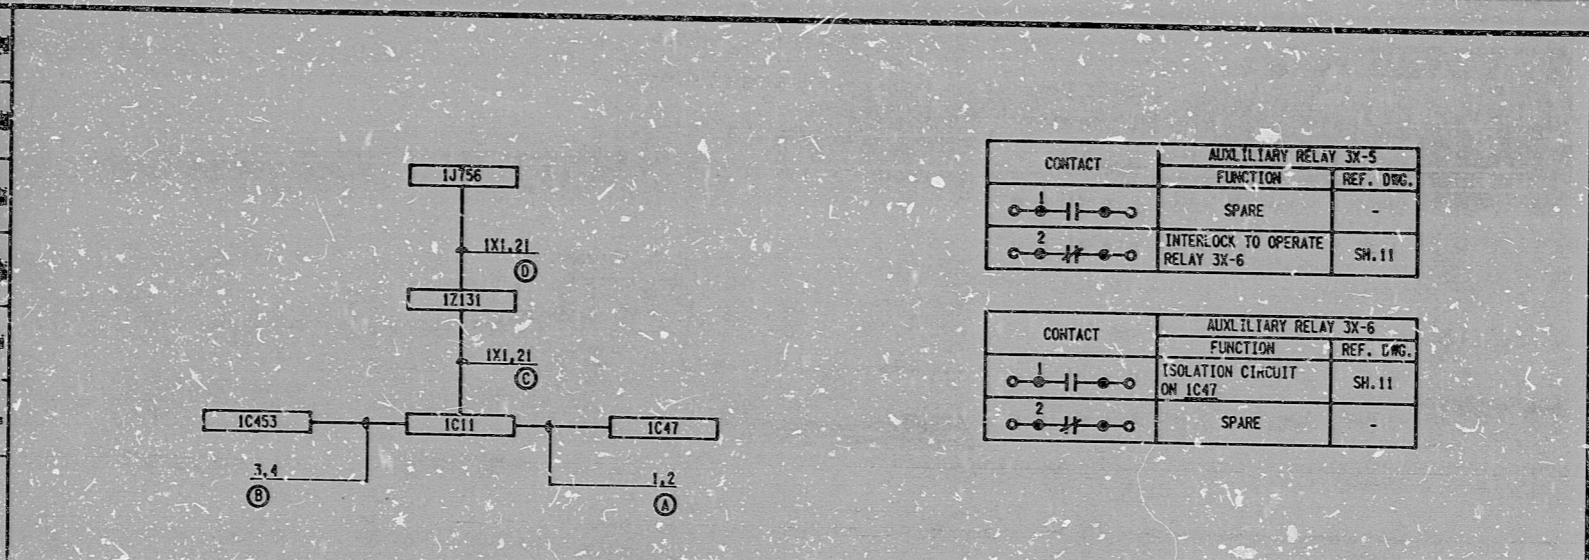

CONTACT	AUXILIARY RELAY 3X-5	
	FUNCTION	REF. DWG.
	SPARE	-
	INTERLOCK TO OPERATE RELAY 3X-6	SH.11

CONTACT	AUXILIARY RELAY 3X-6	
	FUNCTION	REF. DWG.
	ISOLATION CIRCUIT ON 1C47	SH.11
	SPARE	-

STEAM GENERATOR MAIN FEEDWATER ISOLATION VALVES HYDRAULIC PUMP 1P-216A
 SCHEME 18FW129
 S.U. DESIG 1-AEA

SCHEME NO.	INTERLOCK FLAMP	INTERLOCK VALVE	ANNUN. RELAY NO.	ISO. RELAY TERM. NO.	ISO. CAB.	INPUT		OUTPUT		LOCATION		120V PWR PANEL		S.U. DESIG	
						INPUT	OUTPUT	LOC.	LOC.	PNL. NO.	BKR. NO.				
18FW129	1P-216A	1XY-3866A1	A38	2, 13	1C453	B406	H406	1C47	1C453	1J756	1Z131	1C11	Y32	17	1-AEA
18FW130	1P-216B	1XY-3866B1	A38	3, 12	1C453	B407	H407	1C47	1C453	1J761	1Z131	1C11	Y32	17	1-AEA
28FW129	2P-216A	2XY-3966A1	A38	2, 13	2C453	B408	H408	2C47	2C453	2J1029	2Z131	2C11	Y32	17	2-AEA
28FW130	2P-216B	2XY-3966B1	A38	3, 12	2C453	B409	H409	2C47	2C453	2J1034	2Z131	2C11	Y32	17	2-AEA

BECHTEL
 ANN ARBOR, MICHIGAN

MIDLAND PLANT UNITS # 2
 CONSUMERS POWER COMPANY

SCHEMATIC DIAGRAM
 MAIN FW & OTSG BLOWDOWN
 ISOLATION VALVES

JOB NO.	DRAWING NO.	REV.
7220	E-155(Q) SH.12	4

EGS: 08-13-82

I certify that the image contained on this frame was made in the normal and regular course of business on the data stated below and that it is an accurate reproduction of the document submitted to the contractor for filing, by Bechtel Power Corporation.

11-15-82 DATE
 C. Chyba CAMERA OPERATOR
 J. Thomas CONTRACTOR'S SUPERVISOR OR MANAGER

16X

PRO
 APERTURE
 CARD

RIDS

8302070043

