
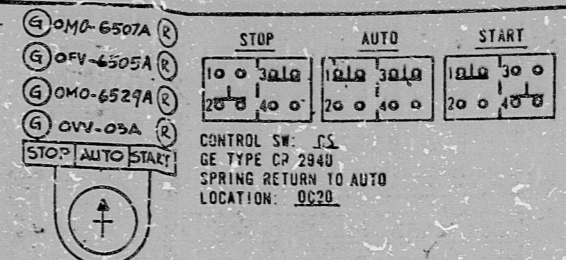


This drawing and the design it covers are the property of BECHTEL. They are hereby loaned to the borrower's service, agreement and they will not be reproduced, copied, loaned, exhibited or used except in the limited way and private use permitted by any written contract given by the lender to the borrower.

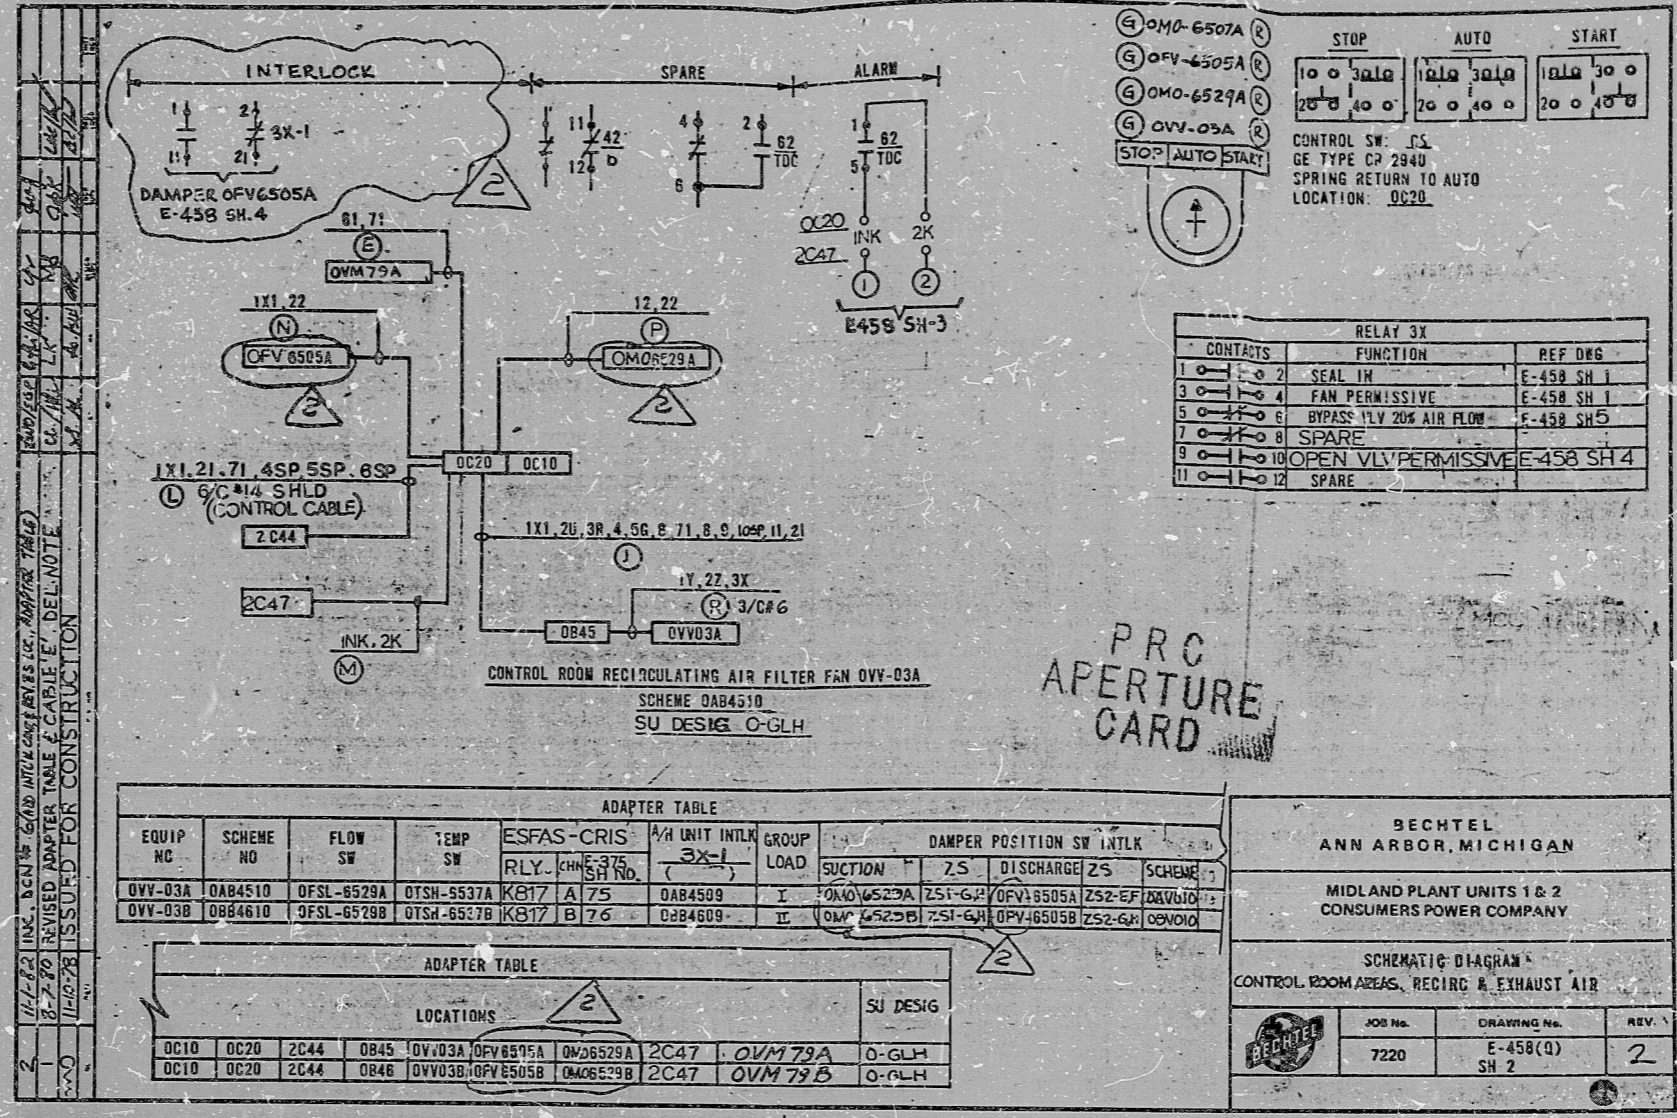

RELAY 3X		
CONTACTS	FUNCTION	REF DWG
1-2	SEAL IN	E-458 SH 1
3-4	FAN PERMISSIVE	E-458 SH 1
5-6	BYPASS VLV 20% AIR FLOW	E-458 SH 5
7-8	SPARE	
9-10	OPEN VLV PERMISSIVE	E-458 SH 4
11-12	SPARE	

PRC
 APERTURE
 CARD

ADAPTER TABLE												
EQUIP NO	SCHEME NO	FLOW SW	TEMP SW	ESFAS-CRIS RLY. CH. E-375 SH NO.	A/H UNIT INTLK (3X-1)	GROUP LOAD	DAMPER POSITION SW INTLK			SCHEME NO		
OVV-03A	OAB4510	OFSL-6529A	DTSH-6537A	K817	A 75	OAB4509	I	OAB4529A	Z51-G-2	OVV-03A	Z52-EF	DAVUTO
OVV-03B	OBB4610	OFSL-6529B	DTSH-6537B	K817	B 76	OAB4609	II	OAB4529B	Z51-G-1	OVV-03B	Z52-GA	OVV010

ADAPTER TABLE										
LOCATIONS										
DC10	DC20	2C44	OB45	OVV03A	OVV03B	OVV03A	OVV03B	OVV03A	OVV03B	SU DESIG
DC10	DC20	2C44	OB45	OVV03A	OVV03B	OVV03A	OVV03B	OVV03A	OVV03B	O-GLH
DC10	DC20	2C44	OB46	OVV03B	OVV03A	OVV03B	OVV03A	OVV03B	OVV03A	O-GLH

BECHTEL
 ANN ARBOR, MICHIGAN

MIDLAND PLANT UNITS 1 & 2
 CONSUMERS POWER COMPANY

SCHEMATIC DIAGRAM
 CONTROL ROOM AREAS, RECIRC & EXHAUST AIR

JOB No.	DRAWING No.	REV.
7220	E-458(1) SH 2	2

RIDS

8302090278

