


17" 8.5" 11" 17"

17" 8.5" 11" 17"

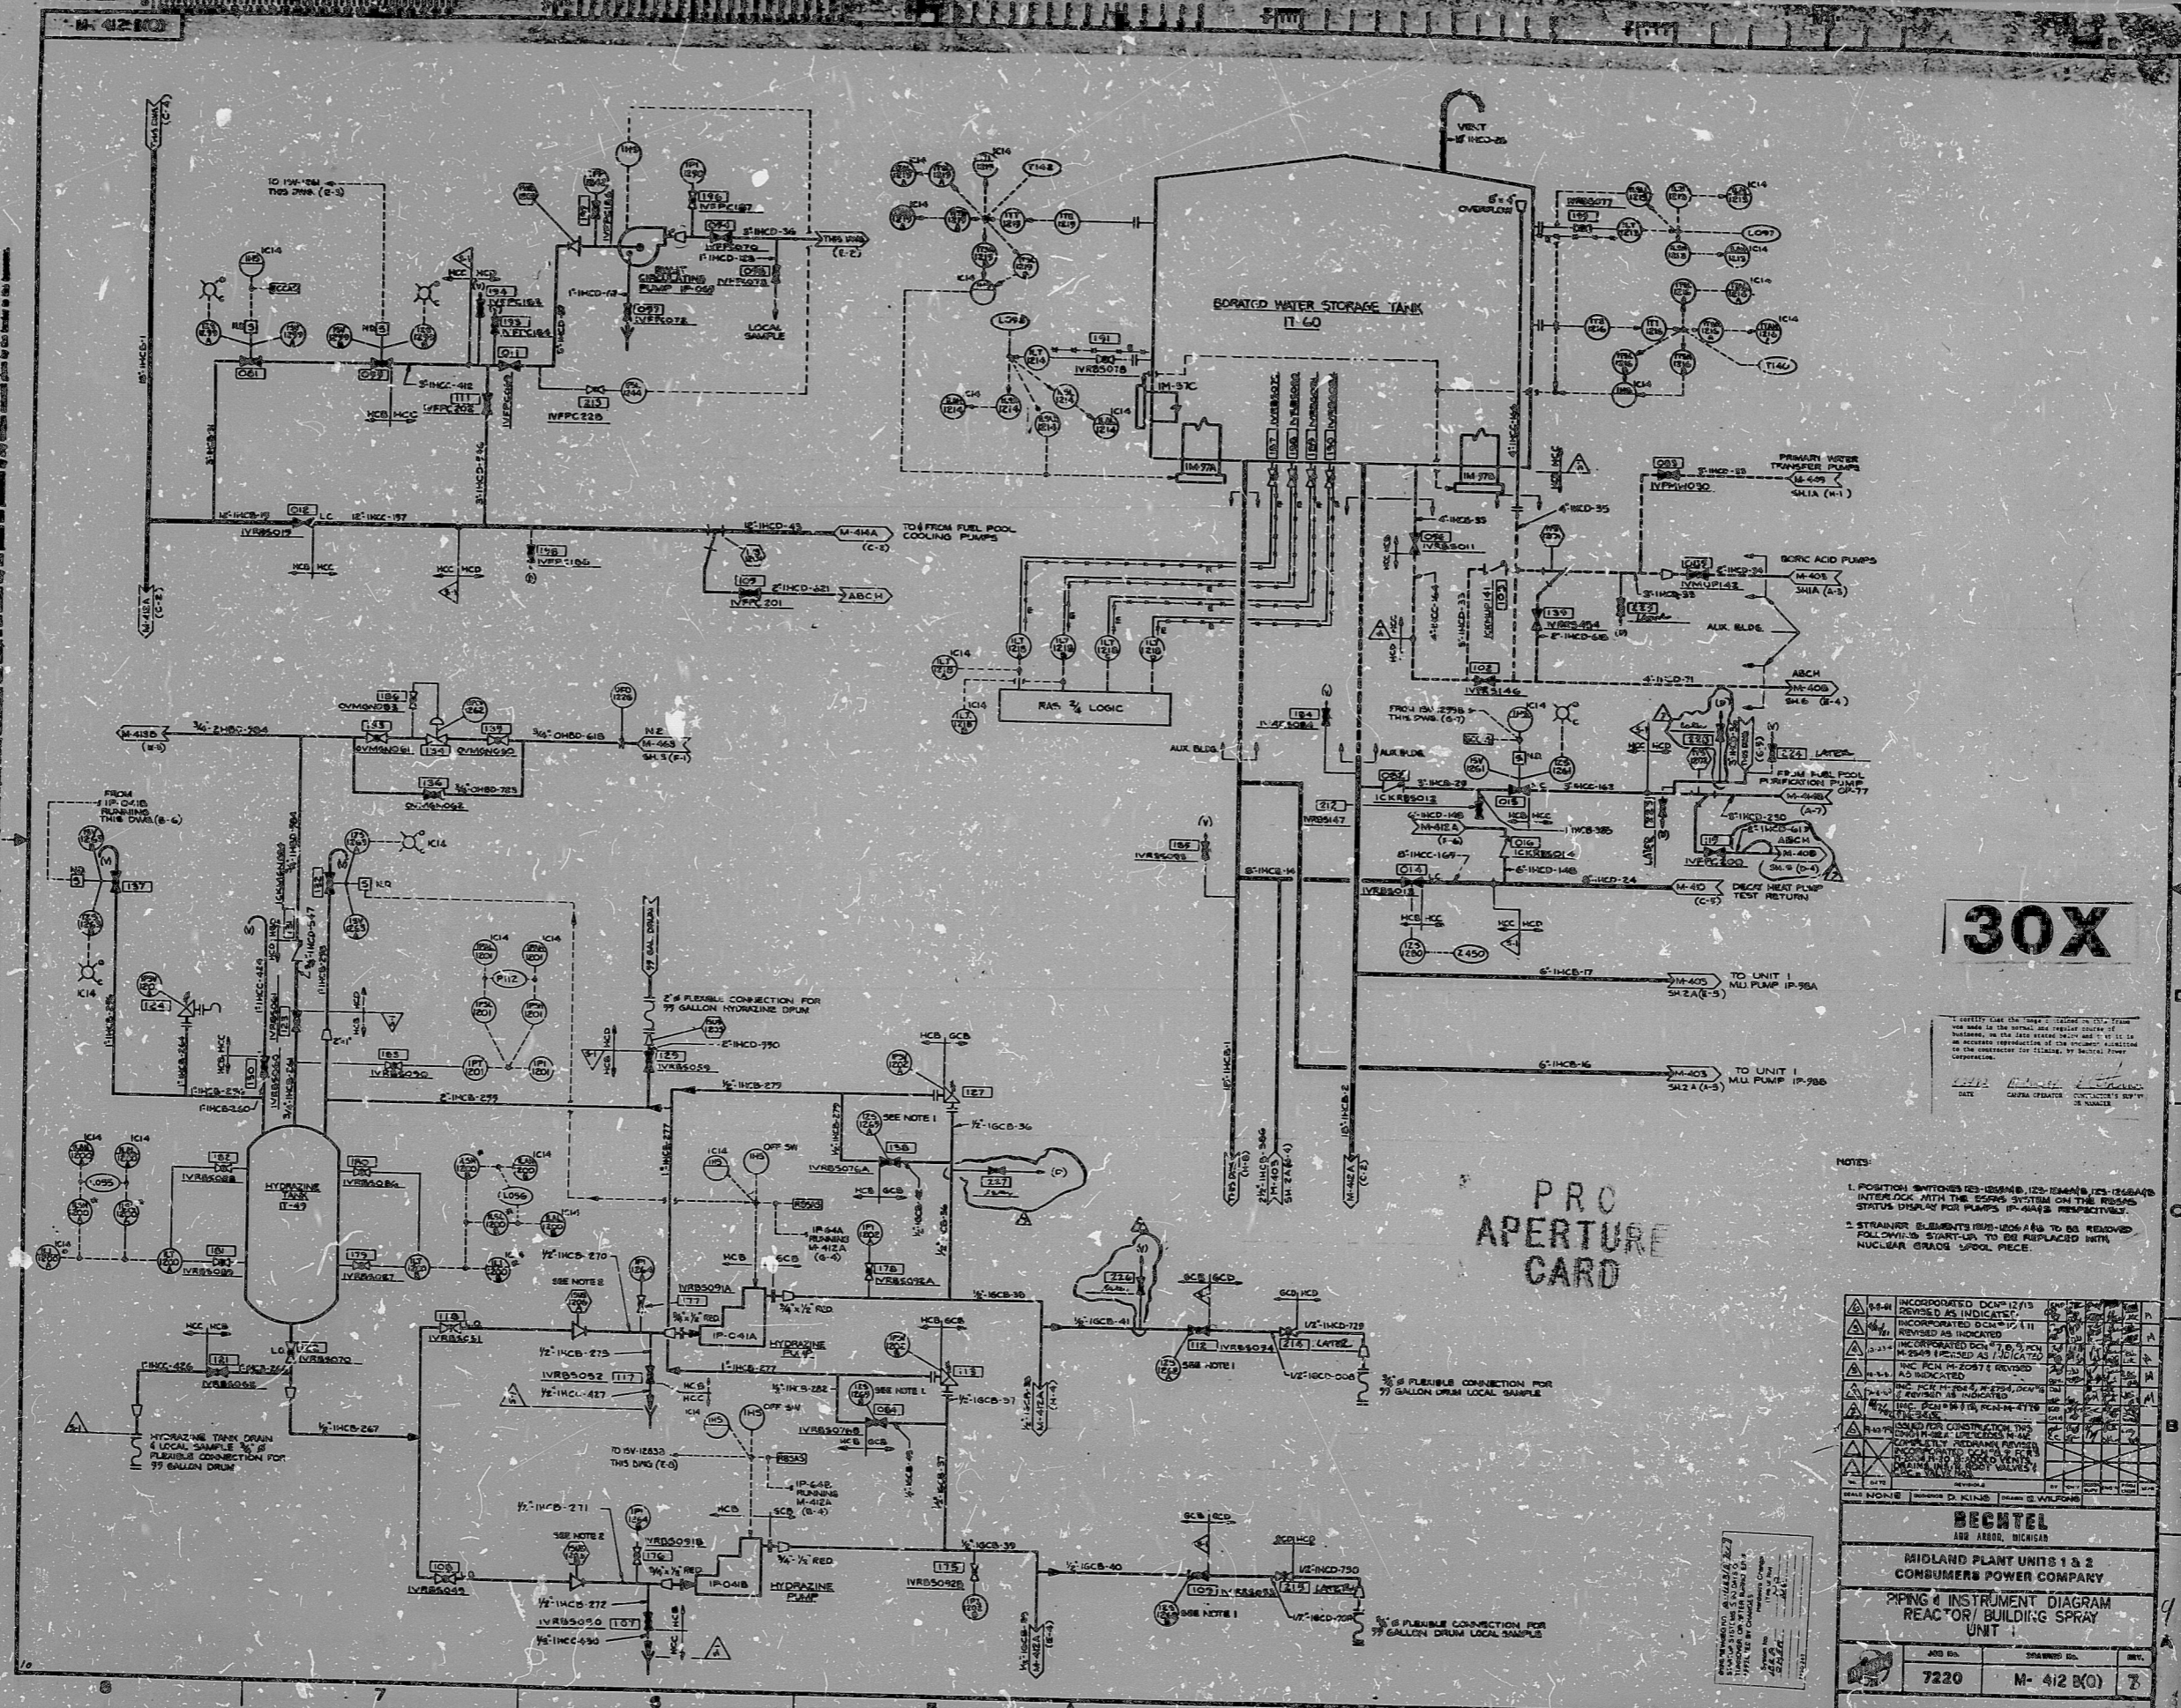

30X

PRO APERTURE CARD

- NOTES:
1. POSITION SWITCHES 123-123A10, 123-123A11, 123-123A12, 123-123A13 INTERLOCK WITH THE 2250V SYSTEM ON THE REACTOR STATUS DISPLAY FOR PUMPS IP-44A, IP-44B, IP-44C RESPECTIVELY.
  2. STRAINER ELEMENTS 123-123A10 & 123-123A11 TO BE REMOVED FOLLOWING STARTUP TO BE REPLACED WITH NUCLEAR GRADE SPool PIECE.

123-123A10	INCORPORATED DCM 12/75	REVISED AS INDICATED
123-123A11	INCORPORATED DCM 12/75	REVISED AS INDICATED
123-123A12	INCORPORATED DCM 12/75	REVISED AS INDICATED
123-123A13	INCORPORATED DCM 12/75	REVISED AS INDICATED
123-123A14	INCORPORATED DCM 12/75	REVISED AS INDICATED
123-123A15	INCORPORATED DCM 12/75	REVISED AS INDICATED
123-123A16	INCORPORATED DCM 12/75	REVISED AS INDICATED
123-123A17	INCORPORATED DCM 12/75	REVISED AS INDICATED
123-123A18	INCORPORATED DCM 12/75	REVISED AS INDICATED
123-123A19	INCORPORATED DCM 12/75	REVISED AS INDICATED
123-123A20	INCORPORATED DCM 12/75	REVISED AS INDICATED

**BECHTEL**  
AND ASSOCIATES, INC.  
MIDLAND PLANT UNITS 1 & 2  
CONSUMERS POWER COMPANY  
PIPING & INSTRUMENT DIAGRAM  
REACTOR BUILDING SPRAY  
UNIT 1

APP. NO.	ISSUED NO.	REV.
7220	M-412 B(0)	3

RIDS

8302990572

