


M-467 SH. 2

SIZE E

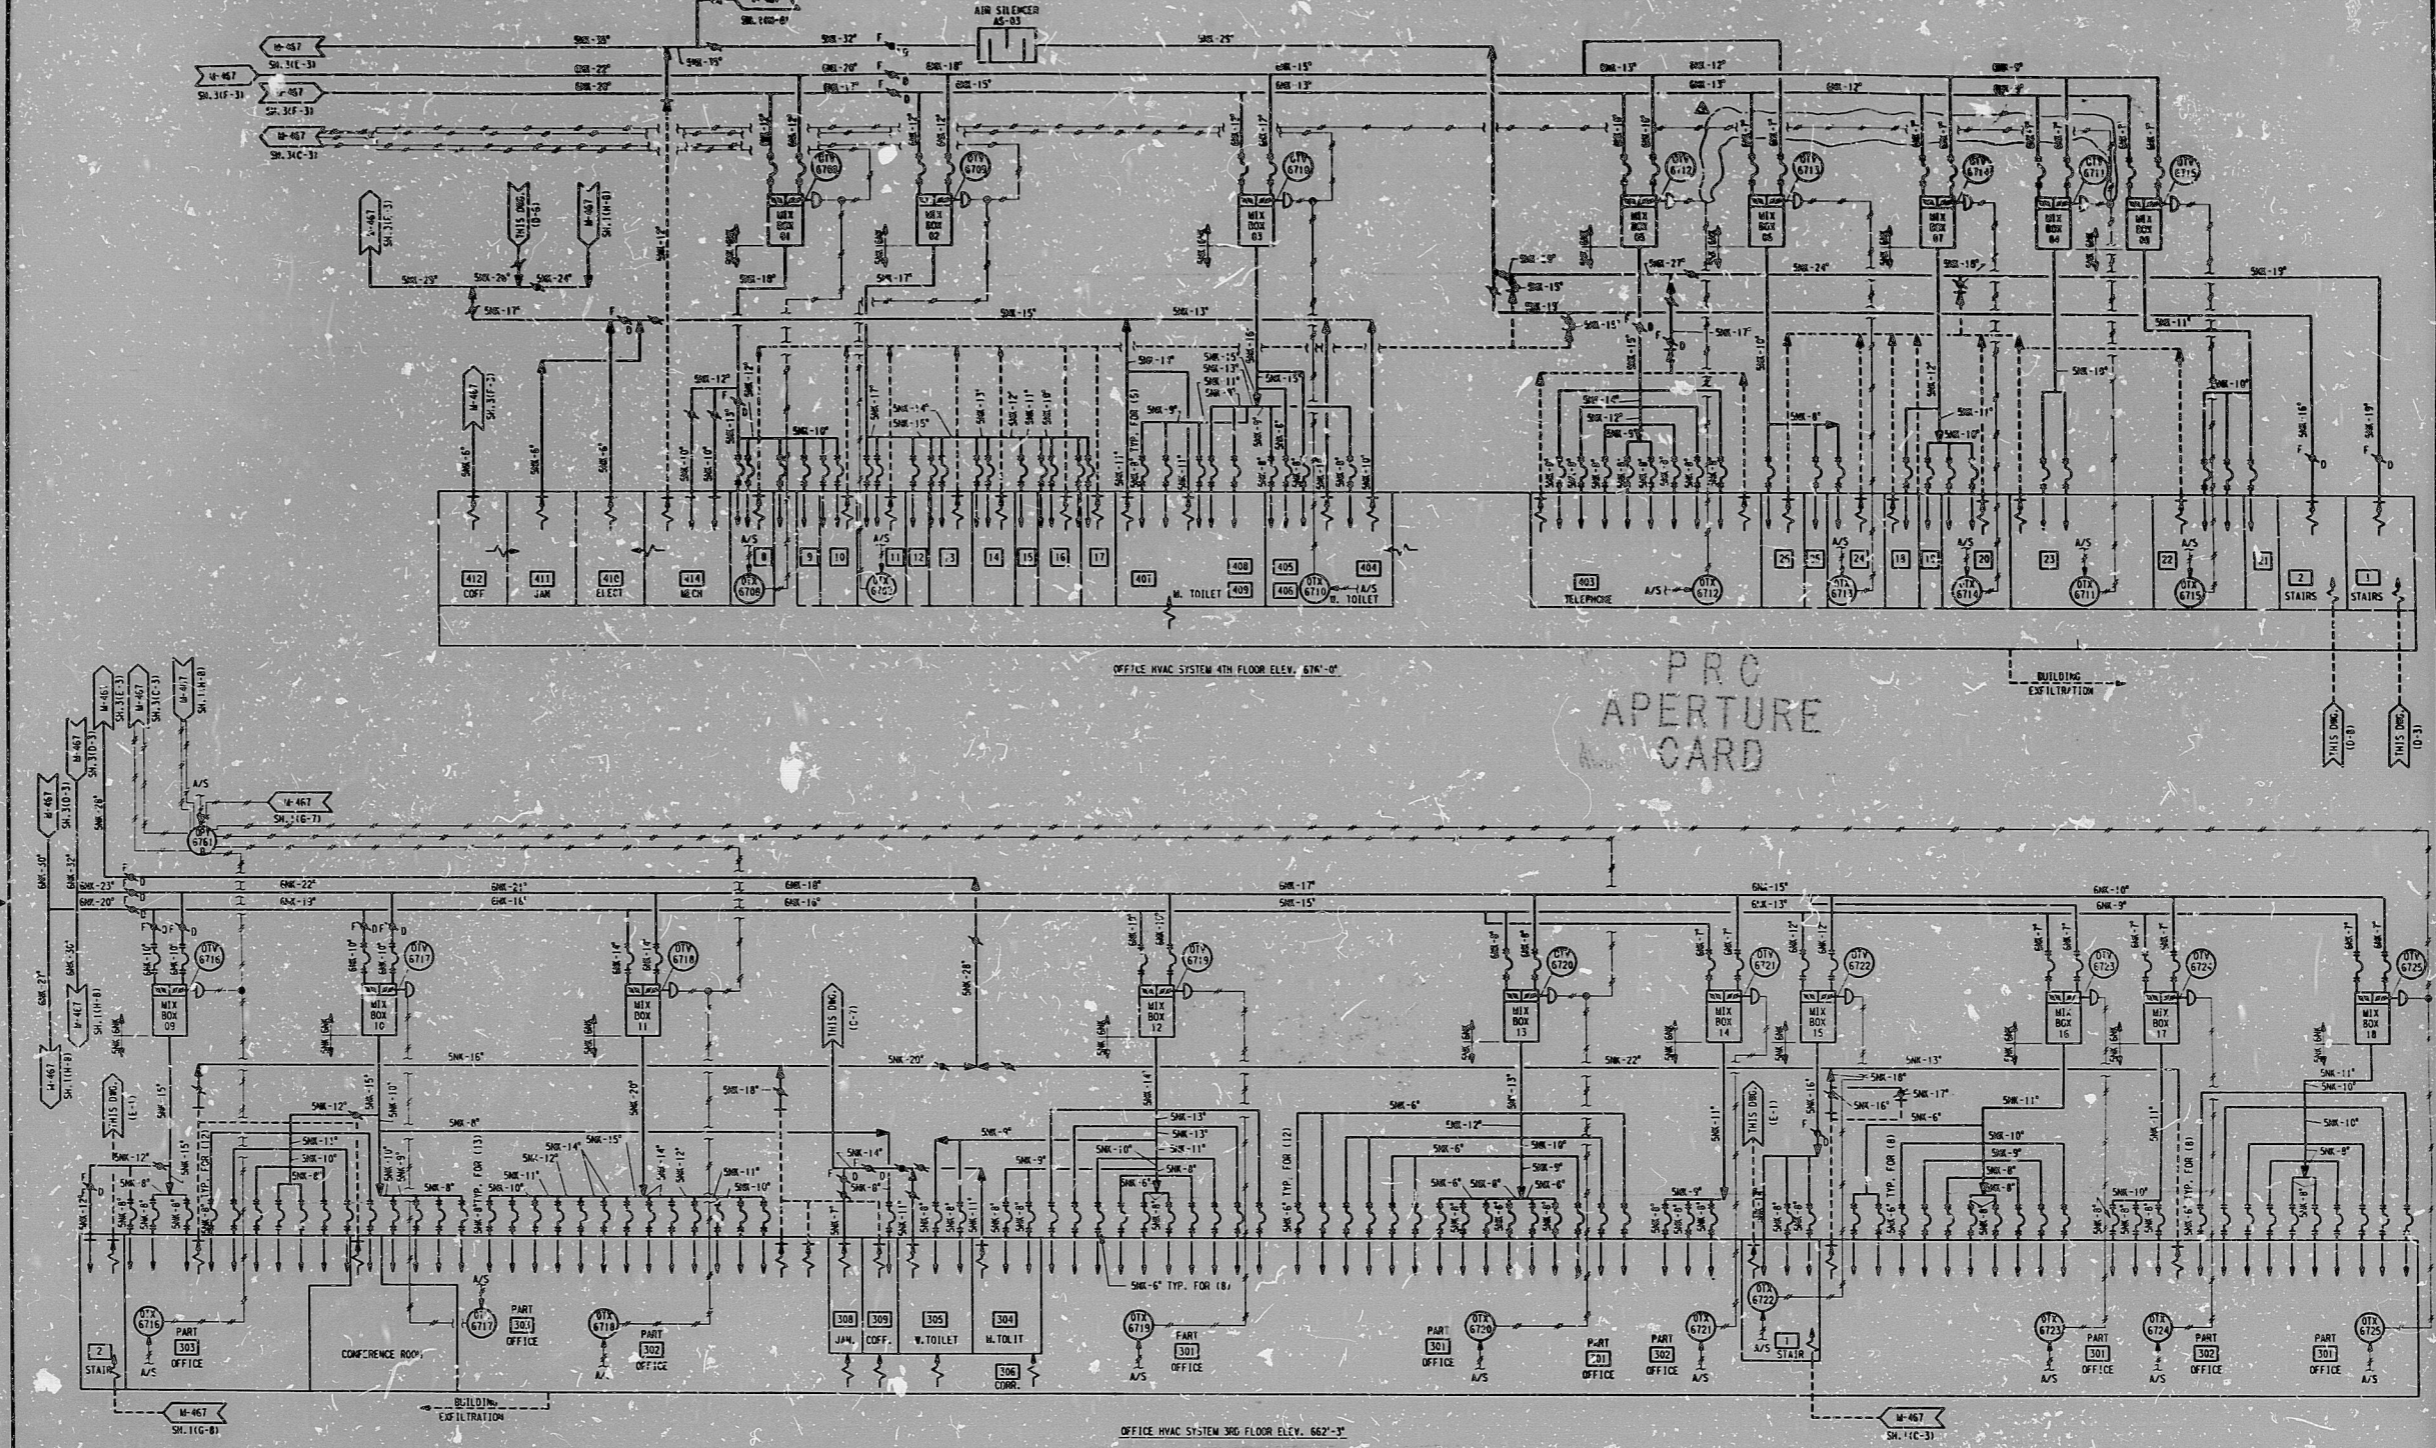

OFFICE HVAC SYSTEM 4TH FLOOR ELEV. 674'-0"

PRO APERTURE CARD

OFFICE HVAC SYSTEM 3RD FLOOR ELEV. 662'-0"

- NOTES
1. M-SYMBOL INDICATES FLEXIBLE CONNECTION.
 2. ALL OUTLETS AND CONNECTIONS TO DIFFUSERS ARE SWE-47 UNLESS OTHERWISE NOTED.
 3. ALL BRANCH OUTLETS TO LIGHT TRIGGER DIFFUSERS CONTAIN BALANCING DAMPERS.

I certify that the data furnished in this form was made in the normal and regular course of an accurate representation of the facts published in the Director of Planning, by Bechtel Power Corporation.

DATE: _____
 OPERATOR: _____
 CONTRACTOR'S REP: _____
 OR MANAGER: _____

30X

REVISIONS

NO.	DATE	DESCRIPTION
1	11/10/67	ISSUED FOR CONSTRUCTION
2	11/10/67	REVISED TO CORRECT CONSTRUCTION
3	11/10/67	REVISED TO CORRECT CONSTRUCTION
4	11/10/67	REVISED TO CORRECT CONSTRUCTION
5	11/10/67	REVISED TO CORRECT CONSTRUCTION
6	11/10/67	REVISED TO CORRECT CONSTRUCTION
7	11/10/67	REVISED TO CORRECT CONSTRUCTION
8	11/10/67	REVISED TO CORRECT CONSTRUCTION
9	11/10/67	REVISED TO CORRECT CONSTRUCTION
10	11/10/67	REVISED TO CORRECT CONSTRUCTION

REVISIONS	REVISIONS	REVISIONS	REVISIONS
1	2	3	4
5	6	7	8
9	10	11	12
13	14	15	16
17	18	19	20
21	22	23	24
25	26	27	28
29	30	31	32
33	34	35	36
37	38	39	40
41	42	43	44
45	46	47	48
49	50	51	52
53	54	55	56
57	58	59	60
61	62	63	64
65	66	67	68
69	70	71	72
73	74	75	76
77	78	79	80
81	82	83	84
85	86	87	88
89	90	91	92
93	94	95	96
97	98	99	100

BECHTEL		
ANN ARBOR, MICHIGAN		
MIDLAND PLANT UNITS 1 & 2		
CONSUMERS POWER COMPANY		
PIPING AND INSTRUMENT DIAGRAM		
HEATING VENTILATING & AIR CONDITIONING		
OFFICE & SERVICE BUILDINGS		
JOB NO.	DRAWING NO.	REV.
7220	M-467 SH. 2	3

17"

11"

8.5"

8.5"

11"

17"

17"

11"

8.5"

8.5"

11"

17"

RIDS

8302140159

