




PLAN AT EL. 838'-0" AND EL. 844'-0"
SCALE 1/8"=1'-0"

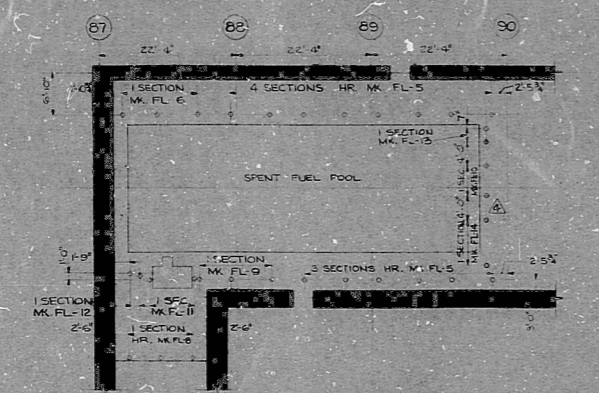


PLAN - SPENT FUEL POOL HANDRAIL
SCALE 1/4"=1'-0"

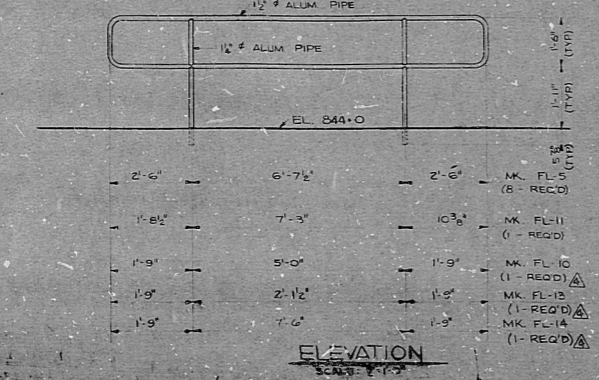


ELEVATION
SCALE 1/4"=1'-0"

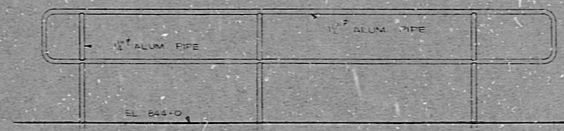

ELEVATION
SCALE 1/4"=1'-0"

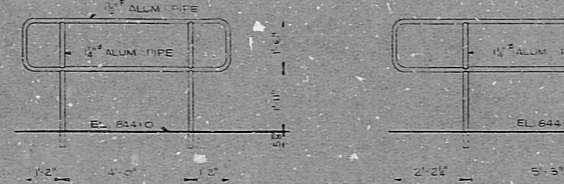

HANDRAIL MK FL 8
SCALE 1/4"=1'-0"

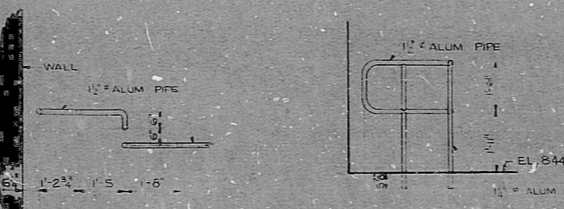

PLAN HANDRAIL MK FL 12
SCALE 1/2"=1'-0"

NOTE: 1. ALL THE SHALL BE ALUMINUM STANDARD BEAMS, TYPE SCHEDULE 40 ALLOY 6061-T6, NOT GALVANIZED.
2. SLEEVES FOR HANDRAIL TO BE GROUTED WITH 1" DIA. FOR 1" DIA. HANDBRAIL REMOVABLE.

NOTES ON CONCRETE MASONRY
1. INSTALL 2" CONC. BLOCK AT PERIMETER OF PURGE EQUIPMENT ROOM (AS SHOWN ON THIS DWG.) FROM EL. 840'-0" TO BOTTOM OF CONC. BEAMS AT EL. 854'-0".
2. SEE DWG. 0-2300A.
3. ALL CONC. BLOCK 2" THICK UNLESS NOTED.

SYMBOLS
CONCRETE BLOCK
CONCRETE BLOCK

NOTE: SYMBOL 713 (C) INDICATES BLOCK WALL TYPE. SEE DWG. 0-2303 FOR ALL THE DESIGNATIONS.

GENERAL NOTES
ITEM 62-2 GREENVILLE CONC. CO. COVERS THE FURNISHING OF CONCRETE LINTELS
ITEM 85-4 COVERS THE FURNISHING OF HANDRAIL

REFERENCE DWGS.
GENERAL ARRANGEMENT - EL. 834'-0" - EL. 844'-0"
CONCRETE DWGS. - 0-2341, 0-2350

G.A. CONDITION 1
BLOCK WALL TYPE 2 ONLY

NOTE: WORK THIS DWG. WITH DWG. 0-2300A+B

DUKE POWER COMPANY
OCONEE NUCLEAR STATION UNITS 1-3
GENERAL ARRANGEMENT
AUXILIARY BUILDING
PLAN AT EL. 838'-0" - EL. 844'-0"
SAFE LOAD PATHS

NO.	REVISIONS	CHG. APPR. DATE	CIVIL	ELEC.	MECH.	INSPECTED

DATE: _____
DWG. NO. 0-2300-P&P

RTPS

8109220685

