


WPPS-3240-G-4007

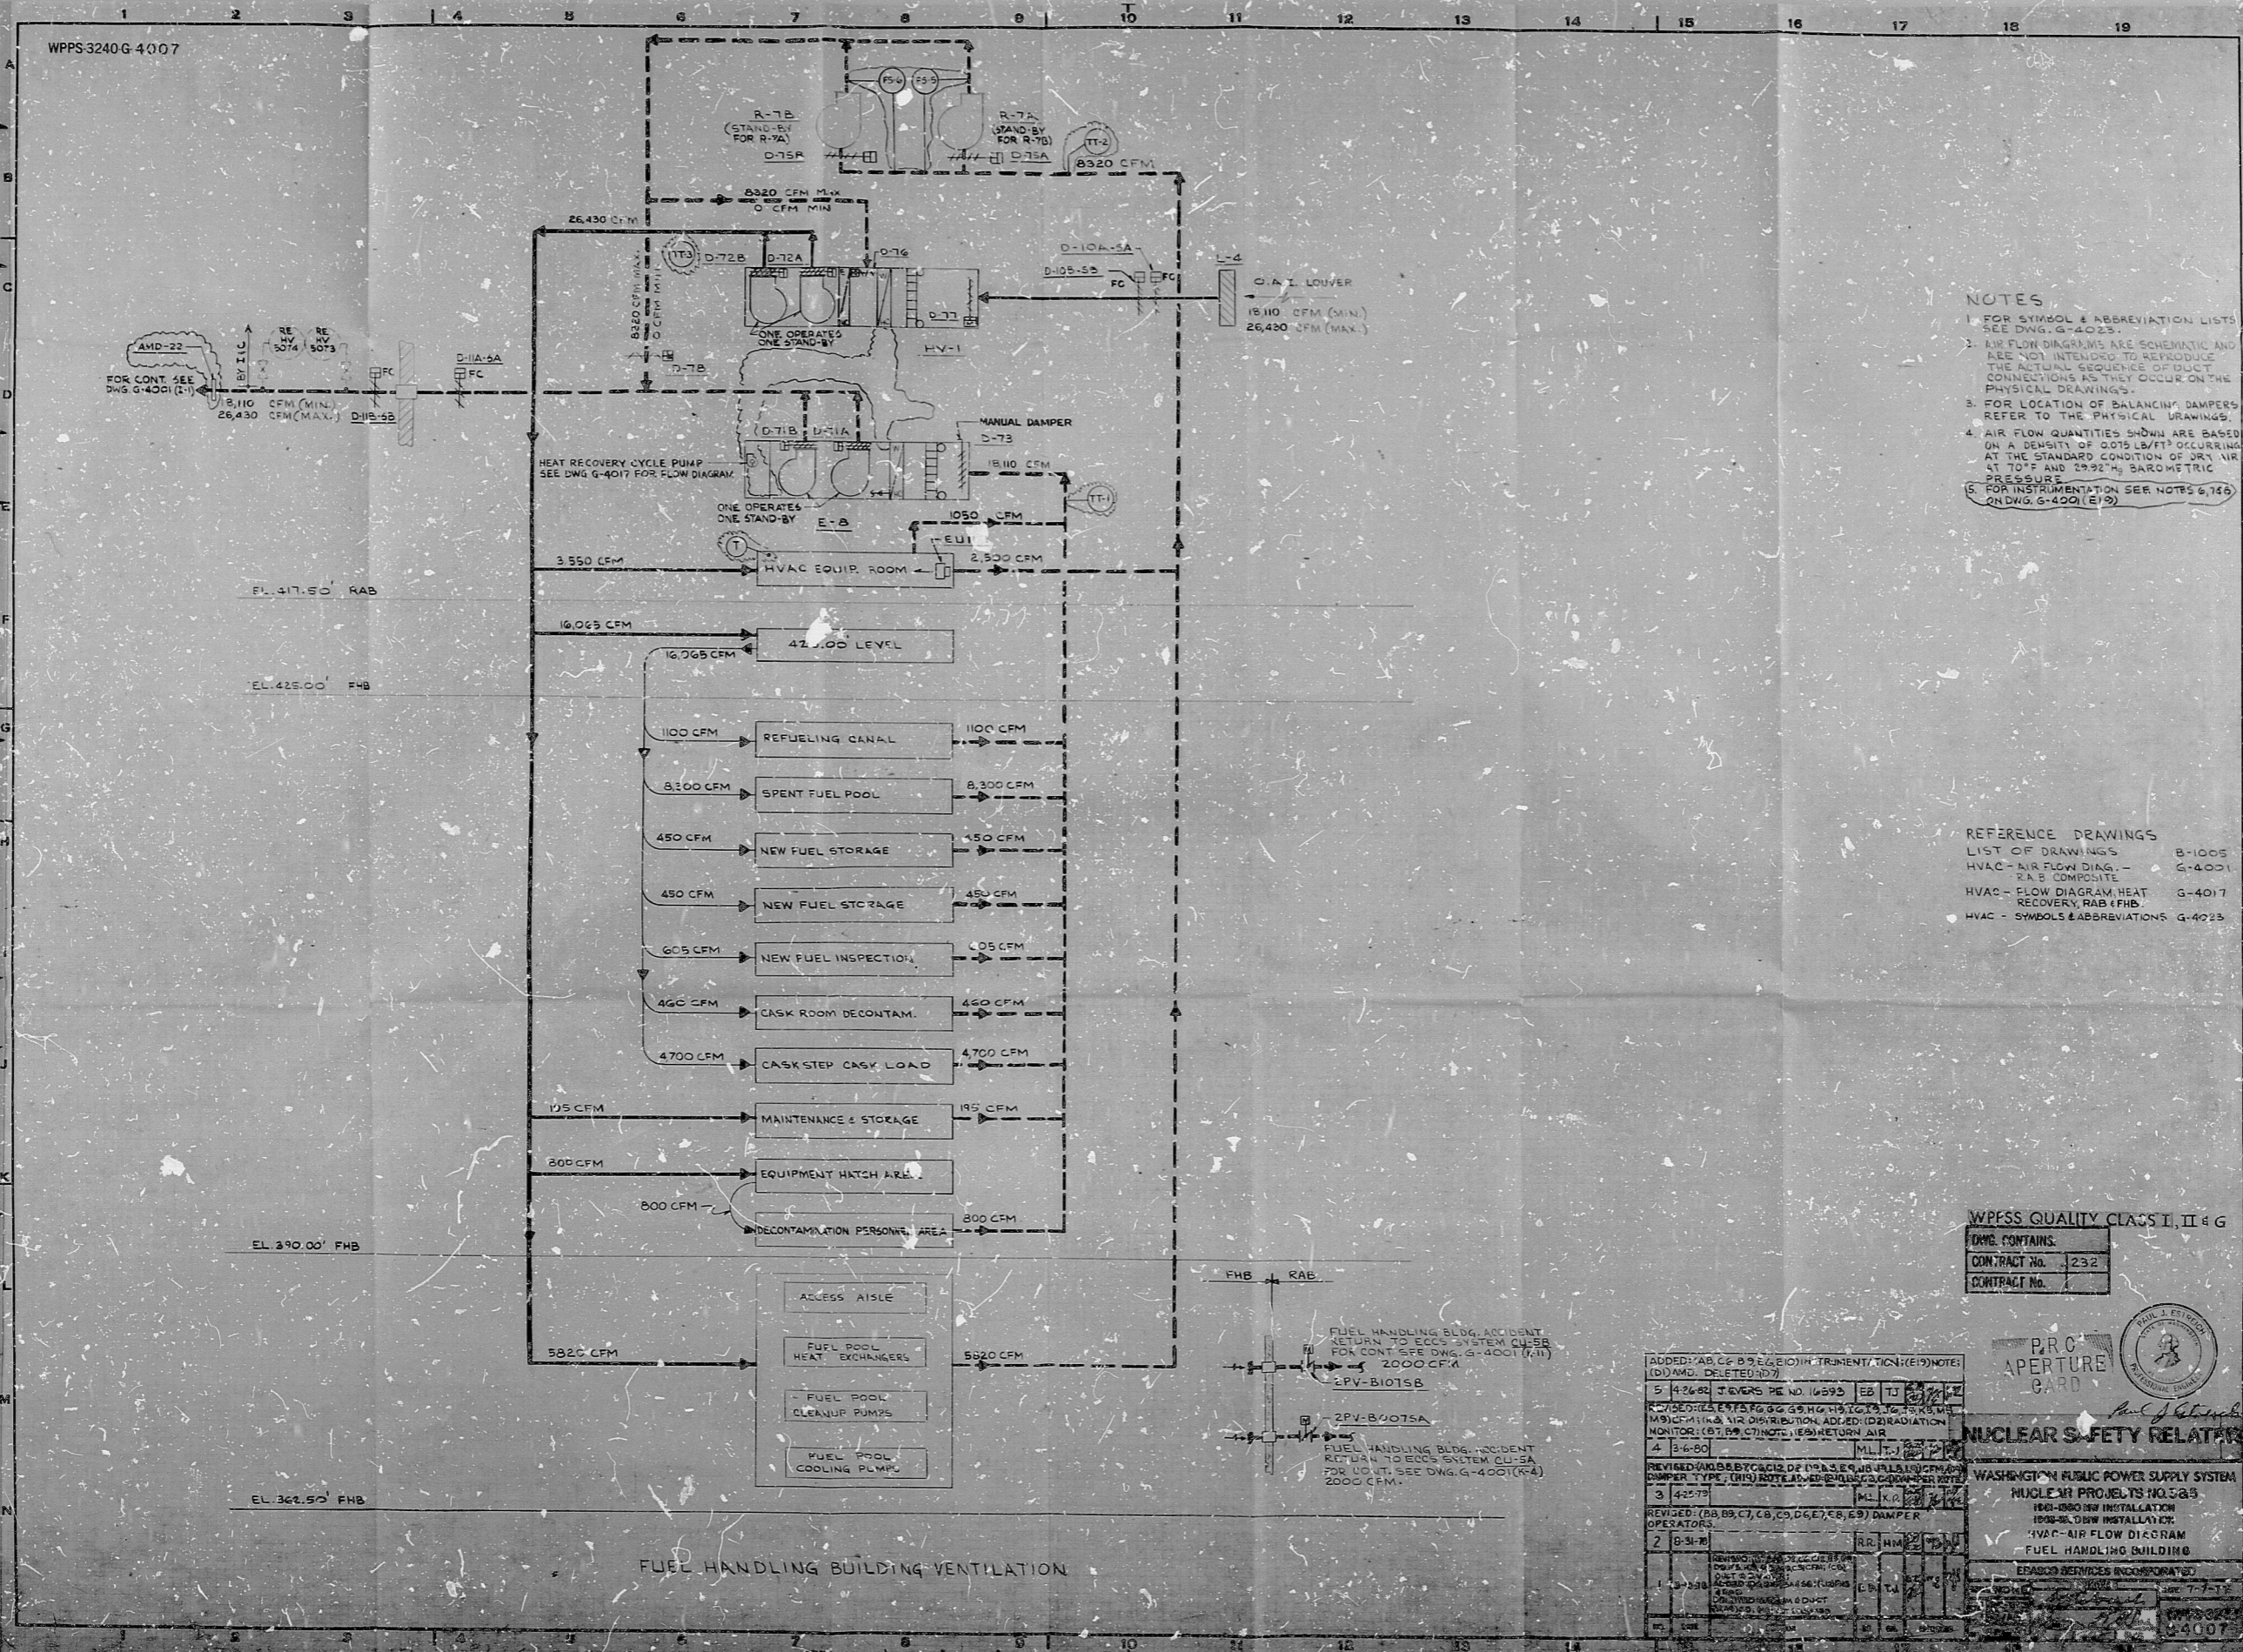

NOTES

1. FOR SYMBOL & ABBREVIATION LISTS SEE DWG. G-4007.
2. AIR FLOW DIAGRAMS ARE SCHEMATIC AND ARE NOT INTENDED TO REPRODUCE THE ACTUAL SEQUENCE OF DUCT CONNECTIONS AS THEY OCCUR ON THE PHYSICAL DRAWINGS.
3. FOR LOCATION OF BALANCING DAMPERS REFER TO THE PHYSICAL DRAWINGS.
4. AIR FLOW QUANTITIES SHOWN ARE BASED ON A DENSITY OF 0.075 LB/FT³ OCCURRING AT THE STANDARD CONDITION OF DRY AIR AT 70°F AND 29.92" Hg BAROMETRIC PRESSURE.
5. FOR INSTRUMENTATION SEE NOTES G-146 AND DWG. G-4007 (E-9).

REFERENCE DRAWINGS

LIST OF DRAWINGS

B-1005
G-4001
G-4017
G-4023

WPPS QUALITY CLASS II, II & G

DWG. CONTAINS
CONTRACT NO. 232
CONTRACT NO.

PRC APERTURE CARD

NUCLEAR SAFETY RELATIONSHIP

ADDED: AB, C, D, E, F, G, H, I, J, K, L, M, N, O, P, Q, R, S, T, U, V, W, X, Y, Z
REMOVED: (BY, C7, C8, C9, C10, C11, C12, C13, C14, C15, C16, C17, C18, C19, C20)
REVISED: (BY, C7, C8, C9, C10, C11, C12, C13, C14, C15, C16, C17, C18, C19, C20)
DATE: 7-7-78
WPPS-3240-G-4007

WASHINGTON NUCLEAR POWER SUPPLY SYSTEM

NUCLEAR PROJECTS NO. 283

1968-1980 NEW INSTALLATION

HVAC-AIR FLOW DIAGRAM

FUEL HANDLING BUILDING

ESABCO SERVICES INCORPORATED

DATE: 7-7-78

WPPS-3240-G-4007

FUEL HANDLING BUILDING VENTILATION

RIDS

8392250467

