


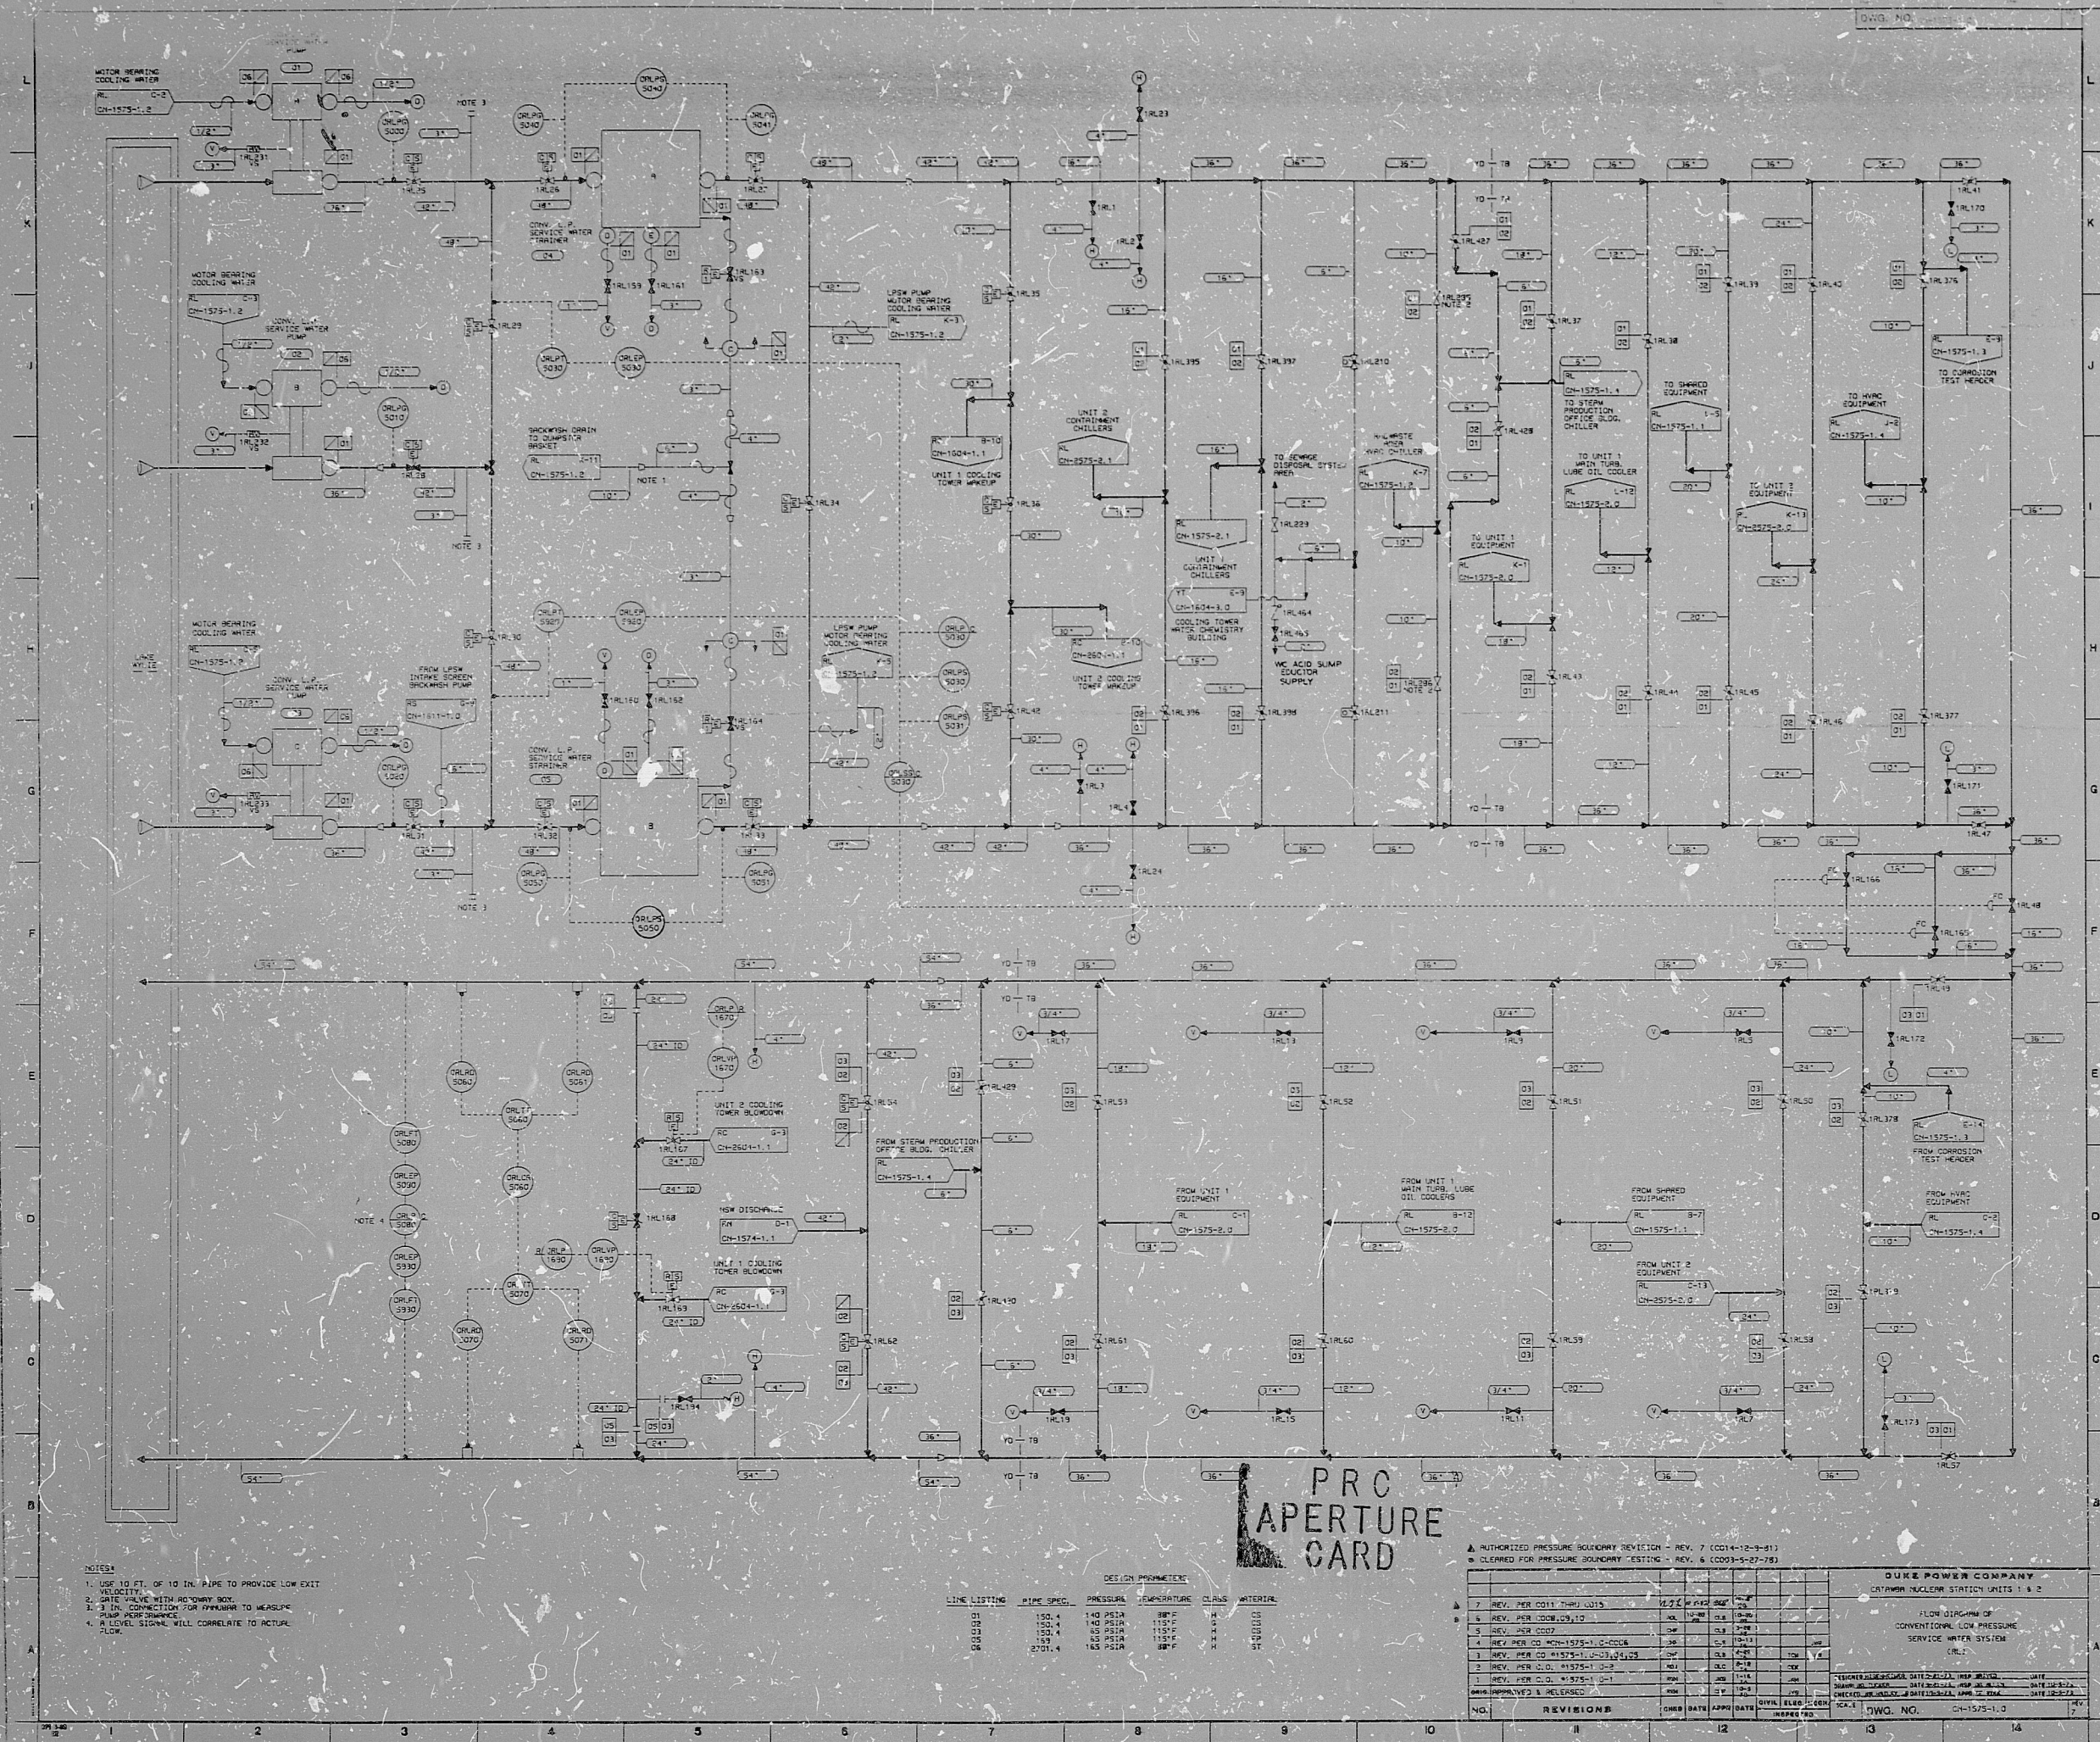

PRC
APERTURE
CARD

AUTHORIZED PRESSURE BOUNDARY REVISION - REV. 7 (CO14-12-9-91)
 CLEARED FOR PRESSURE BOUNDARY TESTING - REV. 6 (CO03-9-27-78)

DUKE POWER COMPANY			
CATMAN NUCLEAR STATION UNITS 1 & 2			
FLOW DIAGRAM OF CONVENTIONAL LOW PRESSURE SERVICE WATER SYSTEM (RL)			
7	REV. PER COIT THRU 1015	10/28/78	REV. 7
6	REV. PER COIT THRU 1010	10/28/78	REV. 6
5	REV. PER COIT THRU 1005	10/28/78	REV. 5
4	REV. PER COIT THRU 1000	10/28/78	REV. 4
3	REV. PER COIT THRU 0995	10/28/78	REV. 3
2	REV. PER COIT THRU 0990	10/28/78	REV. 2
1	REV. PER COIT THRU 0985	10/28/78	REV. 1
0	REV. PER COIT THRU 0980	10/28/78	REV. 0

APPROVED & RELEASED: [Signature]
 NO. [] REVISION [] DATE []
 DESIGNED BY: []
 CHECKED BY: []
 DRAWN BY: []
 DATE: []
 SCALE: []
 SHEET NO.: []
 TOTAL SHEETS: []

8303020412

RIDS

