


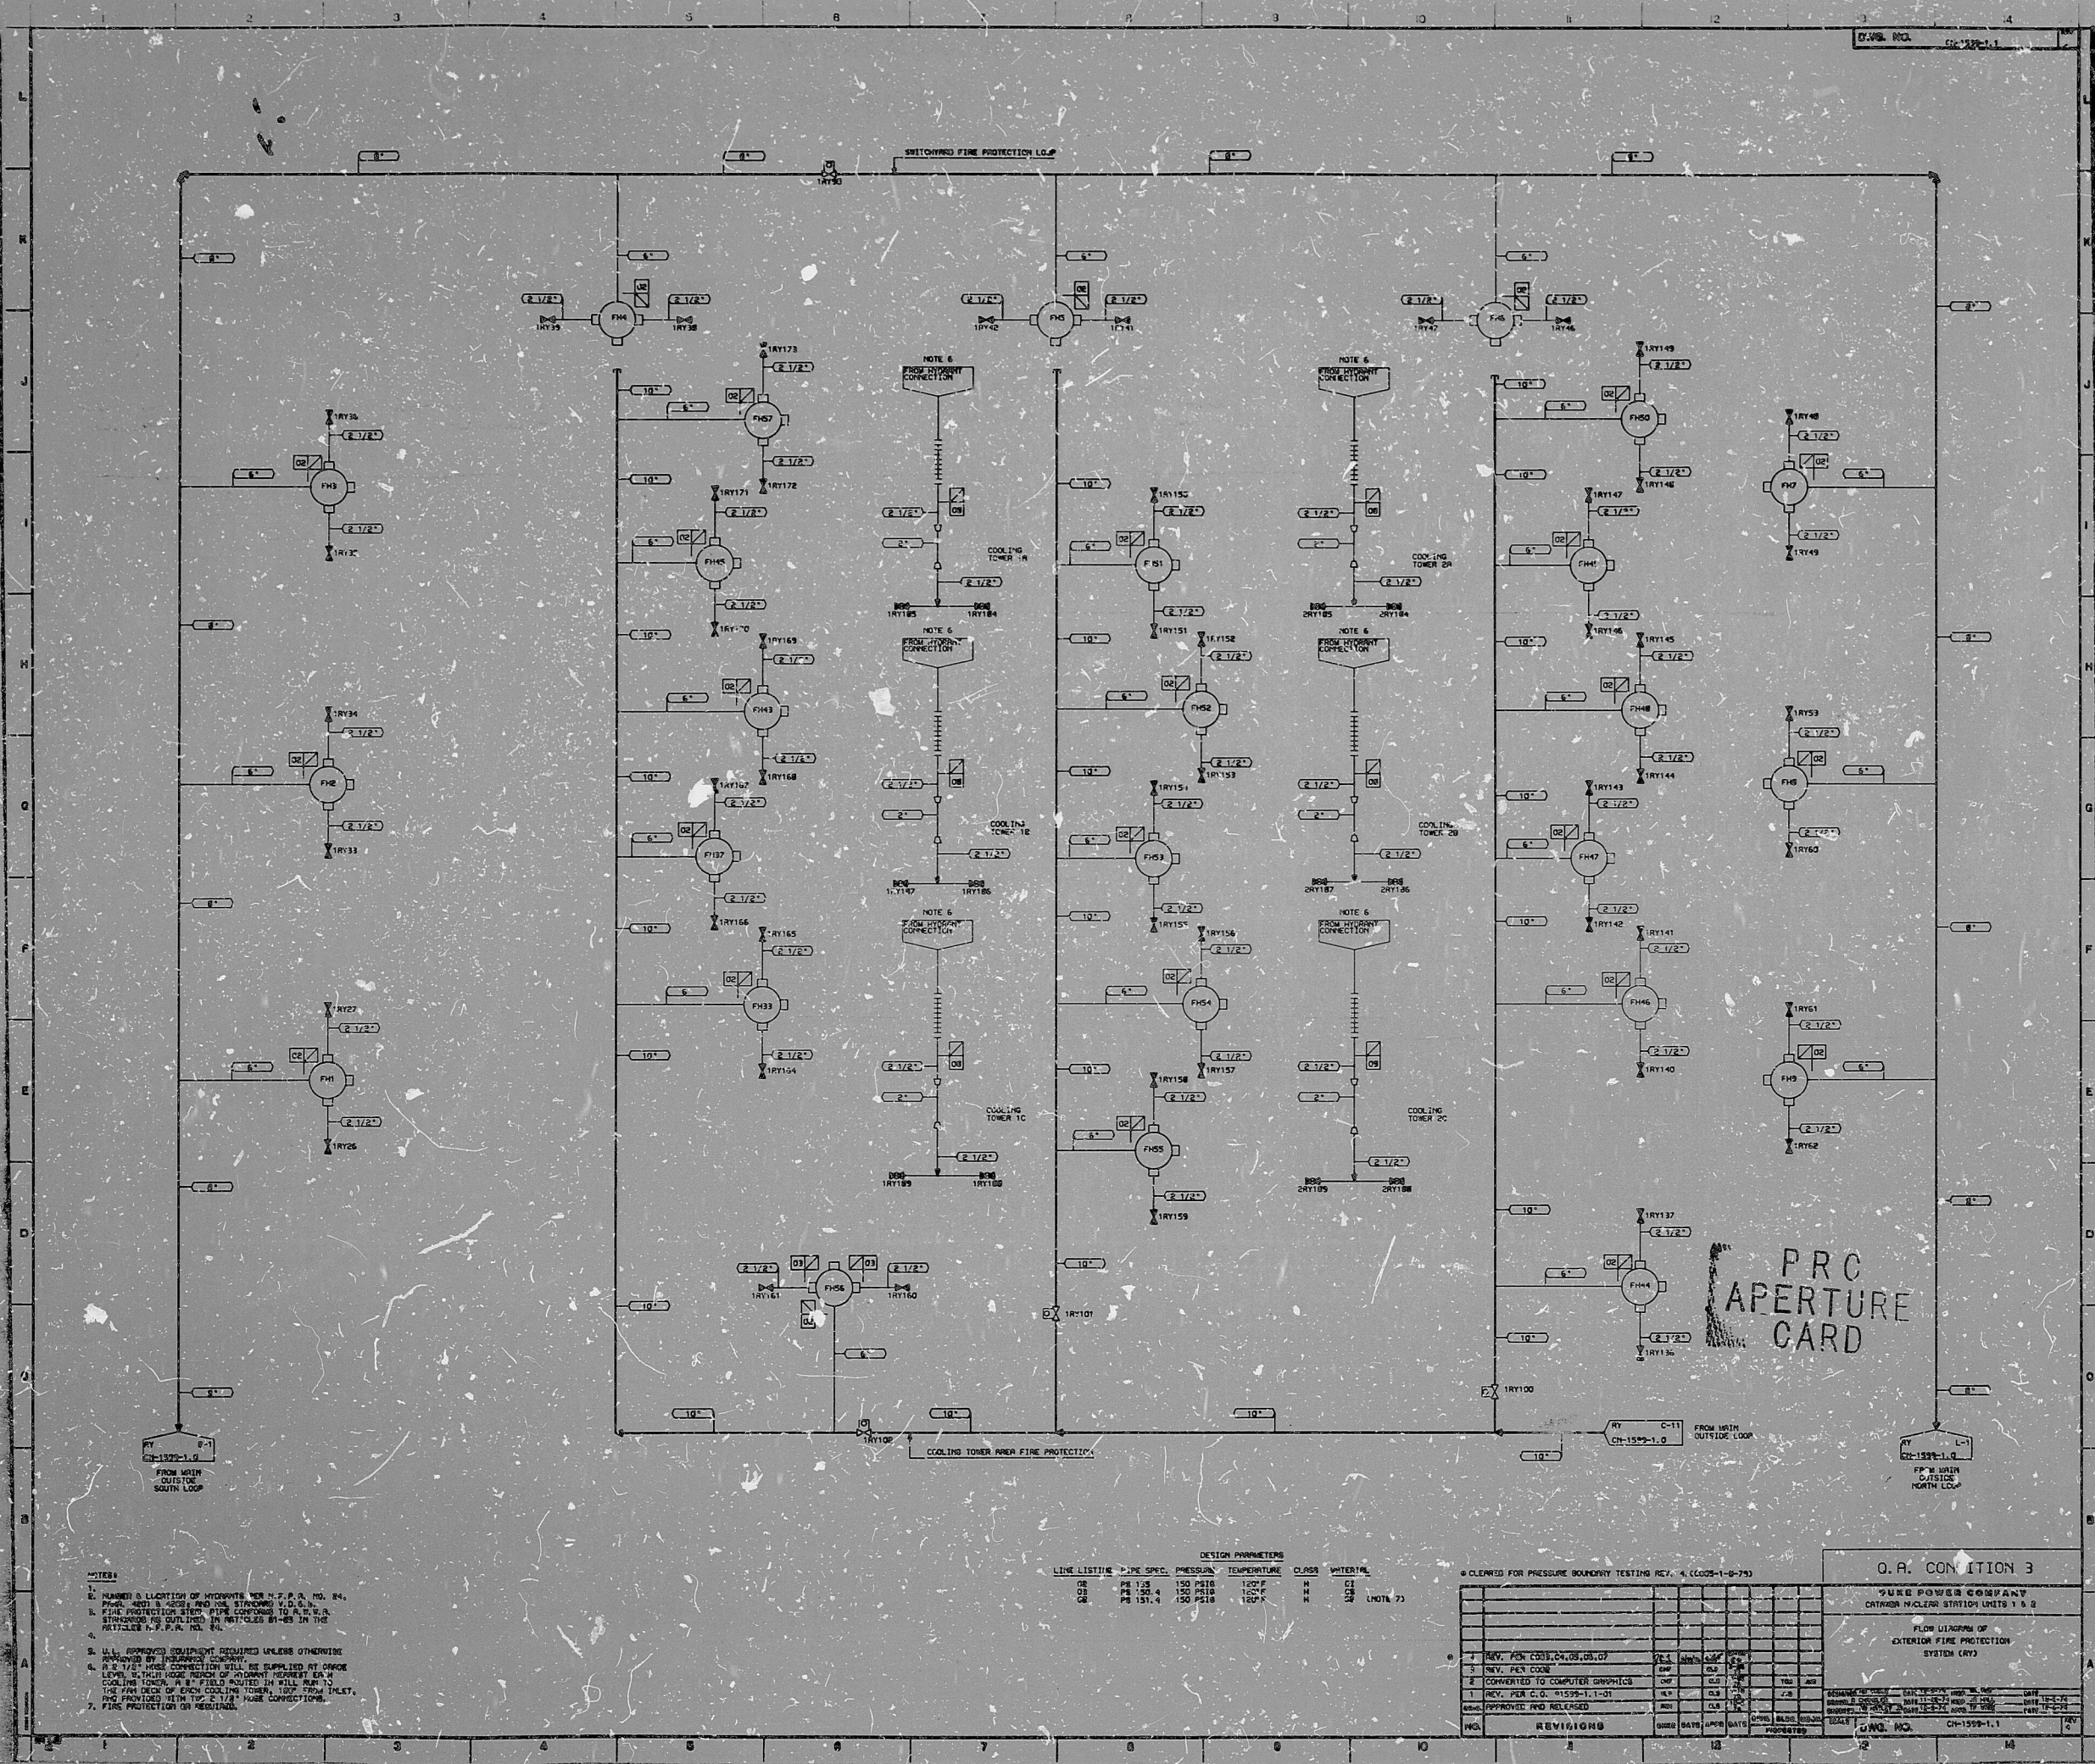

NOTES

1. HAZARD & LOCATION OF HAZARD ARE SHOWN IN P.P.A. NO. 24.
2. FIRE PROTECTION SYSTEM SHALL BE SUPPLIED AT ONCE LEVEL, & SHALL HAVE REACH OF MINIMUM HEIGHT 20' IN COOLING TOWER, & 8' FIELD RADIUS IN FULL RUN TO THE FAN DECK OF EACH COOLING TOWER, 100' FROM INLET, AND PROVIDED WITH TWO 2-1/2" HOSE CONNECTIONS.
3. FIRE PROTECTION ON REQUEST.

DESIGN PARAMETERS					
LINE LISTING	PIPE SPEC.	PRESSURE	TEMPERATURE	CLASS	INTERVAL
01	PS 125	150 PSIG	100°F	H	01
02	PS 150.4	150 PSIG	100°F	H	01
03	PS 151.4	150 PSIG	100°F	H	01

© CLEARED FOR PRESSURE BOUNDARY TESTING REF. 4, (C005-11-0-75)

REV.	DATE	BY	CHKD.	APP'D.	DESCRIPTION
1	REV. FOR C.O. 41599-1.1-01	...	...	...	...
2	CONVERTED TO COMPUTER GRAPHICS	...	...	...	...
3	REV. FOR C.O. 41599-1.1-01	...	...	...	...
4	REV. FOR C.O. 41599-1.1-01	...	...	...	...

D.A. CON. ION 3

YULE P. O. B. S. COMPANY
OUTSIDE NUCLEAR STATION UNITS 1 & 2

FLOW DIAGRAM OF
EXTERIOR FIRE PROTECTION
SYSTEM (REV)

DATE	BY	CHKD.	APP'D.	DESCRIPTION
...	...	...	...	...

RIDS

8303030109

