


TERMINAL BOX # B1015

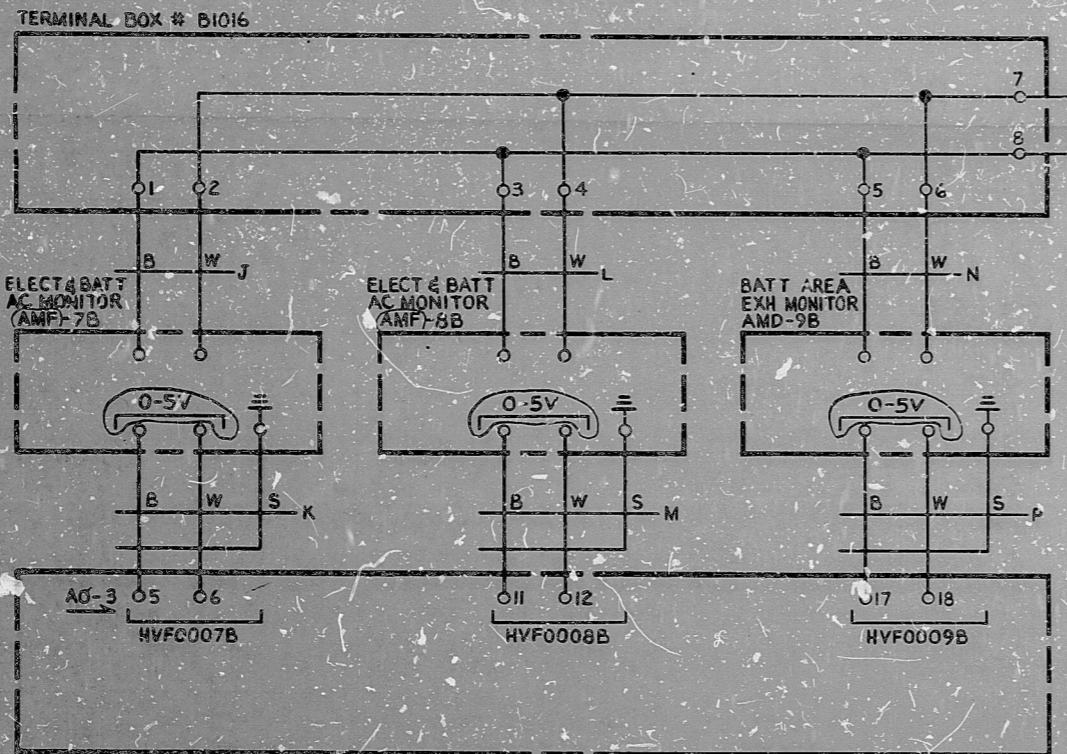

COMP PM6

PRC APERTURE CARD

WPPSS QUALITY CLASS II

5			
4			
3			
2			
1	12-8-81	CH. L. TANENBAUM	APPROVED
REV.	DATE	BY	APPROVED

EBASCO SERVICES INCORPORATED

DIV. CONTROL DR. R.J.P. APPROVED

CH. L. TANENBAUM

DATE JUNE 19, 1981

WASHINGTON PUBLIC POWER SUPPLY SYSTEM

NUCLEAR PROJECTS NO. 3 & 5

CONTROL WIRING DIAGRAM

HVAC MONITORS 4H. 2

WPPS-324C

D-6001

REVISION 2598

RWS

8303030597

