


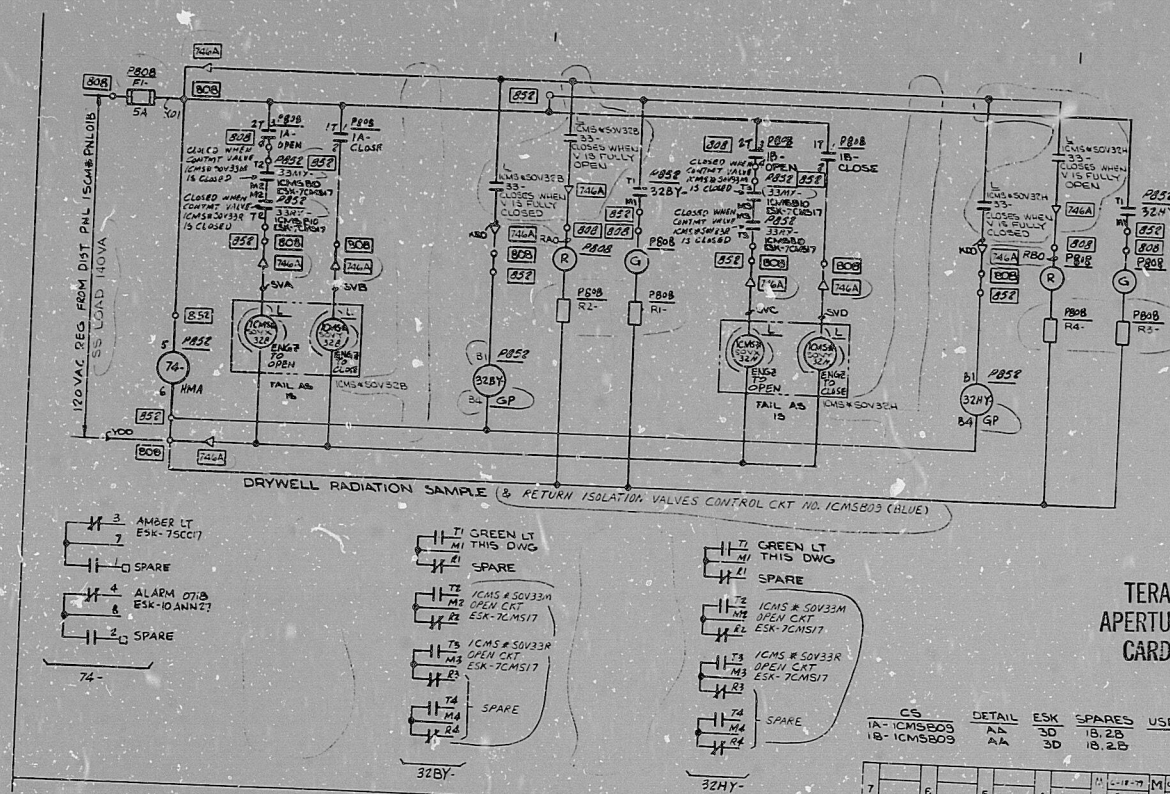

NOTES
1. APPLICABLE LOGIC LSK-35-2.

NUCLEAR SAFETY RELATED
QA CAT I

ELEM DIAG 120VAC CONTROL CIRCUIT
CONTAINMENT ATM MONITORING SYS
RIVER BEND STATION- UNIT 1
GULF STATES UTILITIES COMPANY
BYRON & WATKINS ENGINEERING CORPORATION
12210-ESK-7CMS15

DESIGN CHANGE IN PROGRESS
REISSUE REQUIRED FOR FSAR

SEPIA COPY

R105

8109250365

