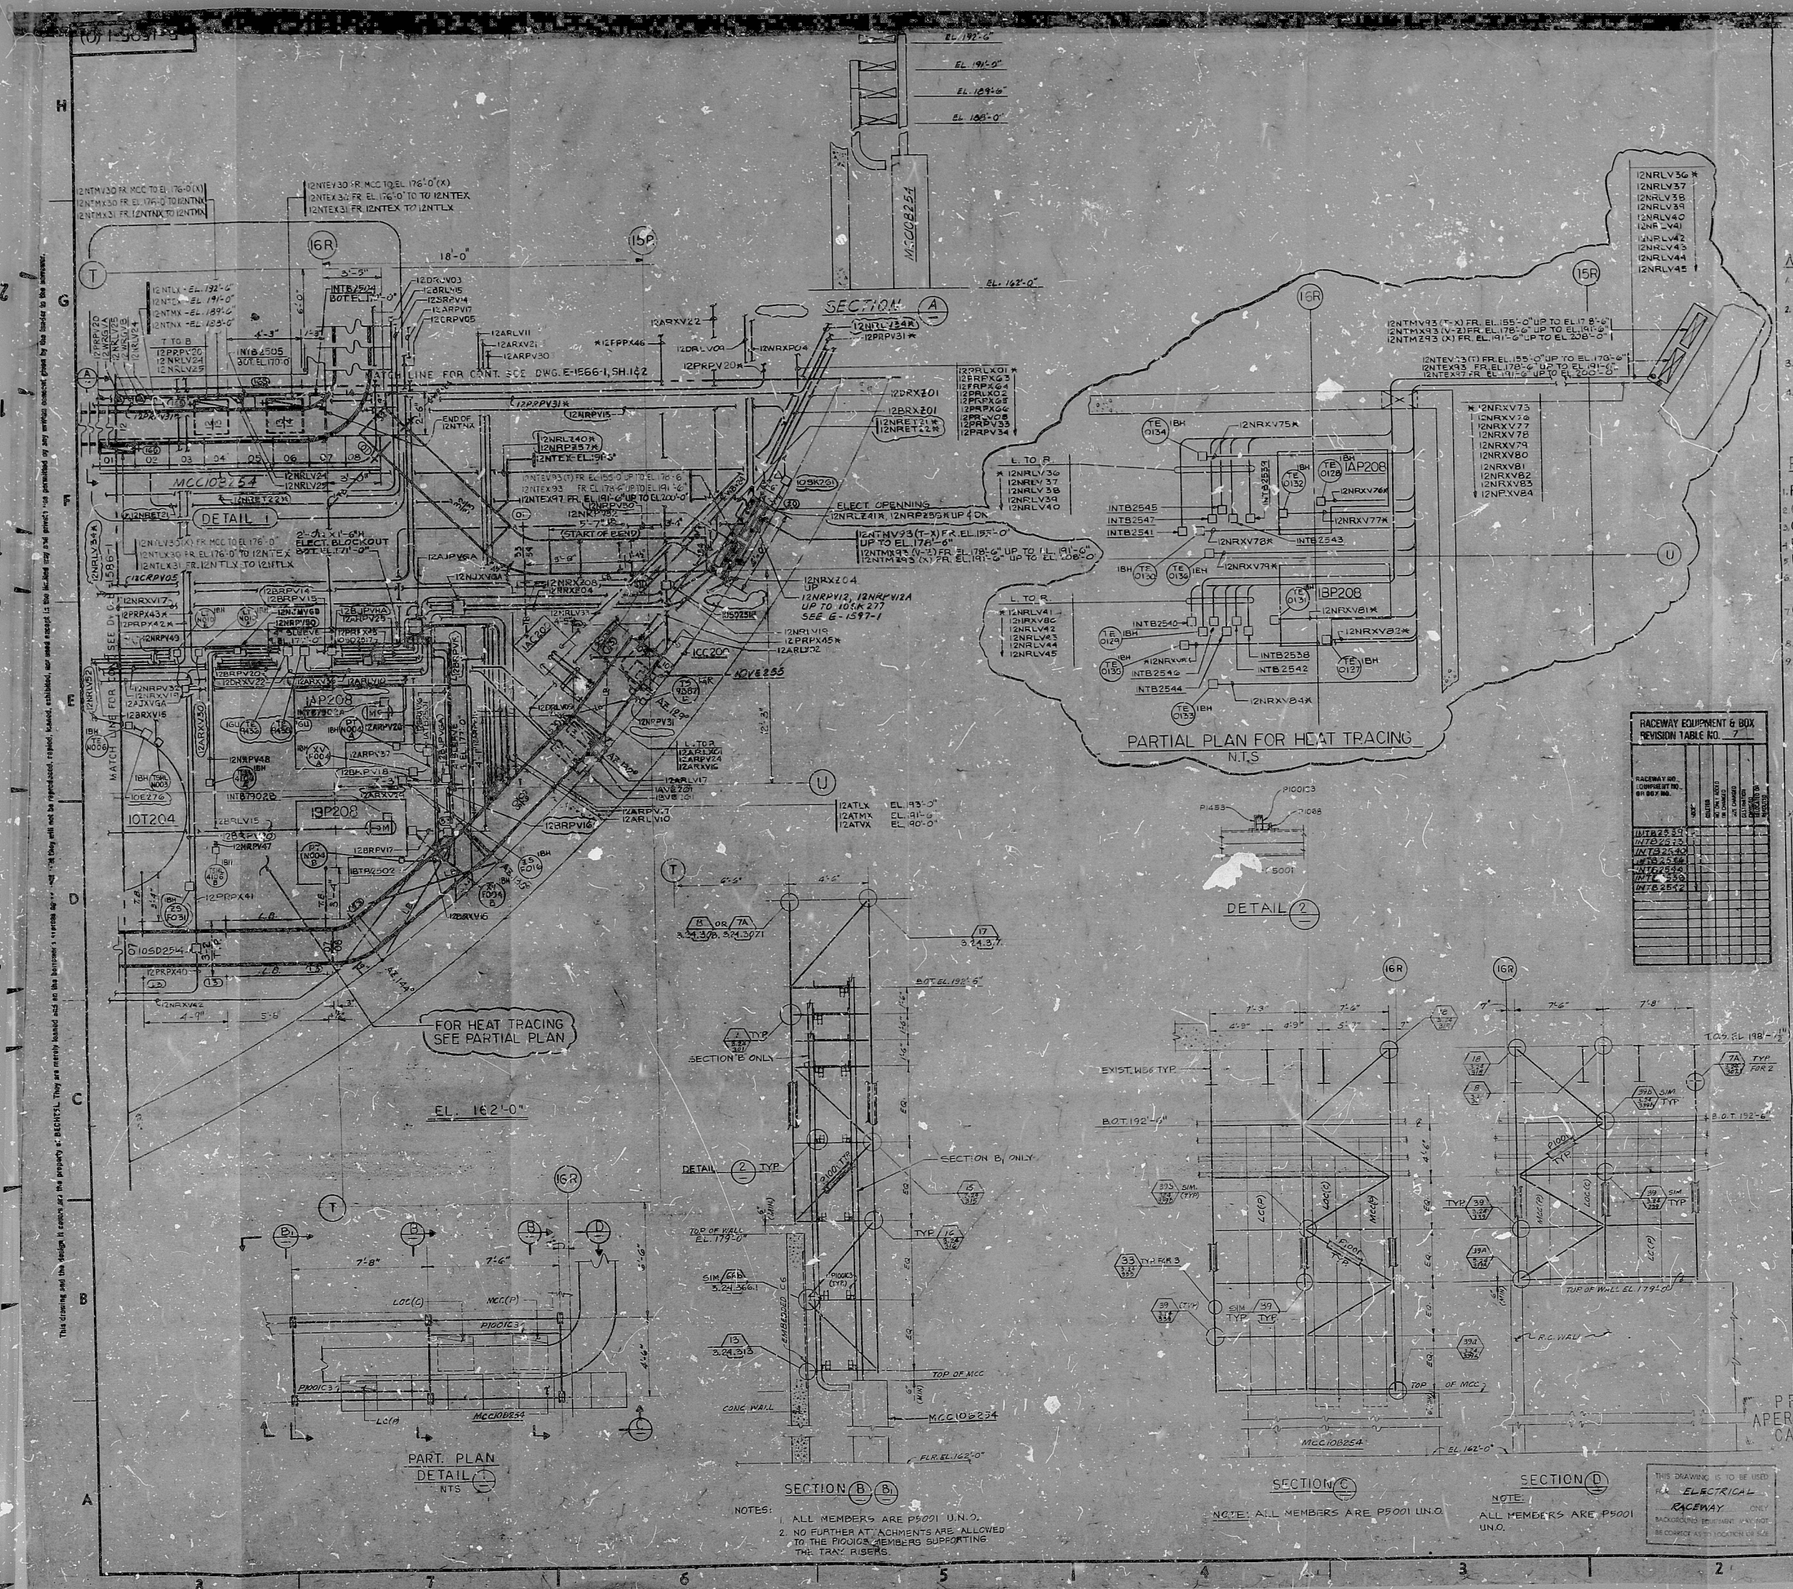
SECTION A
DETAIL 1
PARTIAL PLAN FOR HEAT TRACING
N.T.S
DETAIL 2
FOR HEAT TRACING SEE PARTIAL PLAN
EL. 162'-0"
PART. PLAN DETAIL 1
NTS
SECTION B, B1
SECTION C
SECTION D
NOTE: ALL MEMBERS ARE P5001 U.N.O.
NOTES:
1. ALL MEMBERS ARE P5001 U.N.O.
2. NO FURTHER ATTACHMENTS ARE ALLOWED TO THE P1001C3 MEMBERS SUPPORTING THE TRAY RISERS.
MATCH LINE FOR CONT. SEE DWG. E-1566-1, SH. 1&2
MCC10B254
10T204
19P208
ELECT. OPENNING
ELECT. BLOCKOUT
RACEWAY EQUIPMENT & BOX REVISION TABLE NO. 7
RACEWAY EQUIPMENT & BOX REVISION TABLE NO. 7
THIS DRAWING IS TO BE USED FOR ELECTRICAL RACEWAY ONLY
BECHTEL
SAN FRANCISCO
PUBLIC SERVICE ELECTRIC AND GAS COMPANY
HOPE CREEK GENERATING STATION
RACEWAY PLAN
REACTOR BLDG. AREA 19
PLAN AT EL. 162'-0"
JOB No. 10855
DRAWING No. E-1596-1
REV. 7
PLANT KEY PLAN
NOTES:
1. ALL CABLE TRAYS ARE 24", UNLESS SHOWN OTHERWISE.
2. CLASS I.E. RACEWAY-TRAY & CONDUIT, ETC. ARE IDENTIFIED FOR "C" LISTED INSTALLATION BY LETTERS A, B, C, D, W, X, Y OR Z IN THE THIRD CHARACTER OF THE RACEWAY NUMBER.
3. ALL FIRE DETECTORS ARE MOUNTED ON THE CEILING.
4. FOR INSTALLATION DETAIL OF NON-STANDARD ELBOWS FOR CABLE TRAYS, SEE DWG E-1426-0, SH. 3, 24, 38B.
REFERENCE DRAWINGS
1. F-1905-1 — PIPING
2. C-0813-1 — CIVIL-STRUCTURAL
3. C-0647-1 —
4. P-9195-1 — HEATING & VENTILATING
5. P-8105-1 — PLUMBING
6. E-1426-0 — RACEWAY NOTES, SYMBOLS & DETAILS
7. C-0813-1 — STRUCTURAL STEEL FLOOR FRAMING PLAN
8. J-J1905-1 — INSTRUMENT LOCATION
9. P-0046-1 — EQUIP. LOCATION
ISSUED FOR CONSTRUCTION

PDR RIDS

8402060592