



J-57-0 SH. 13

LOGIC CABINET DC 652

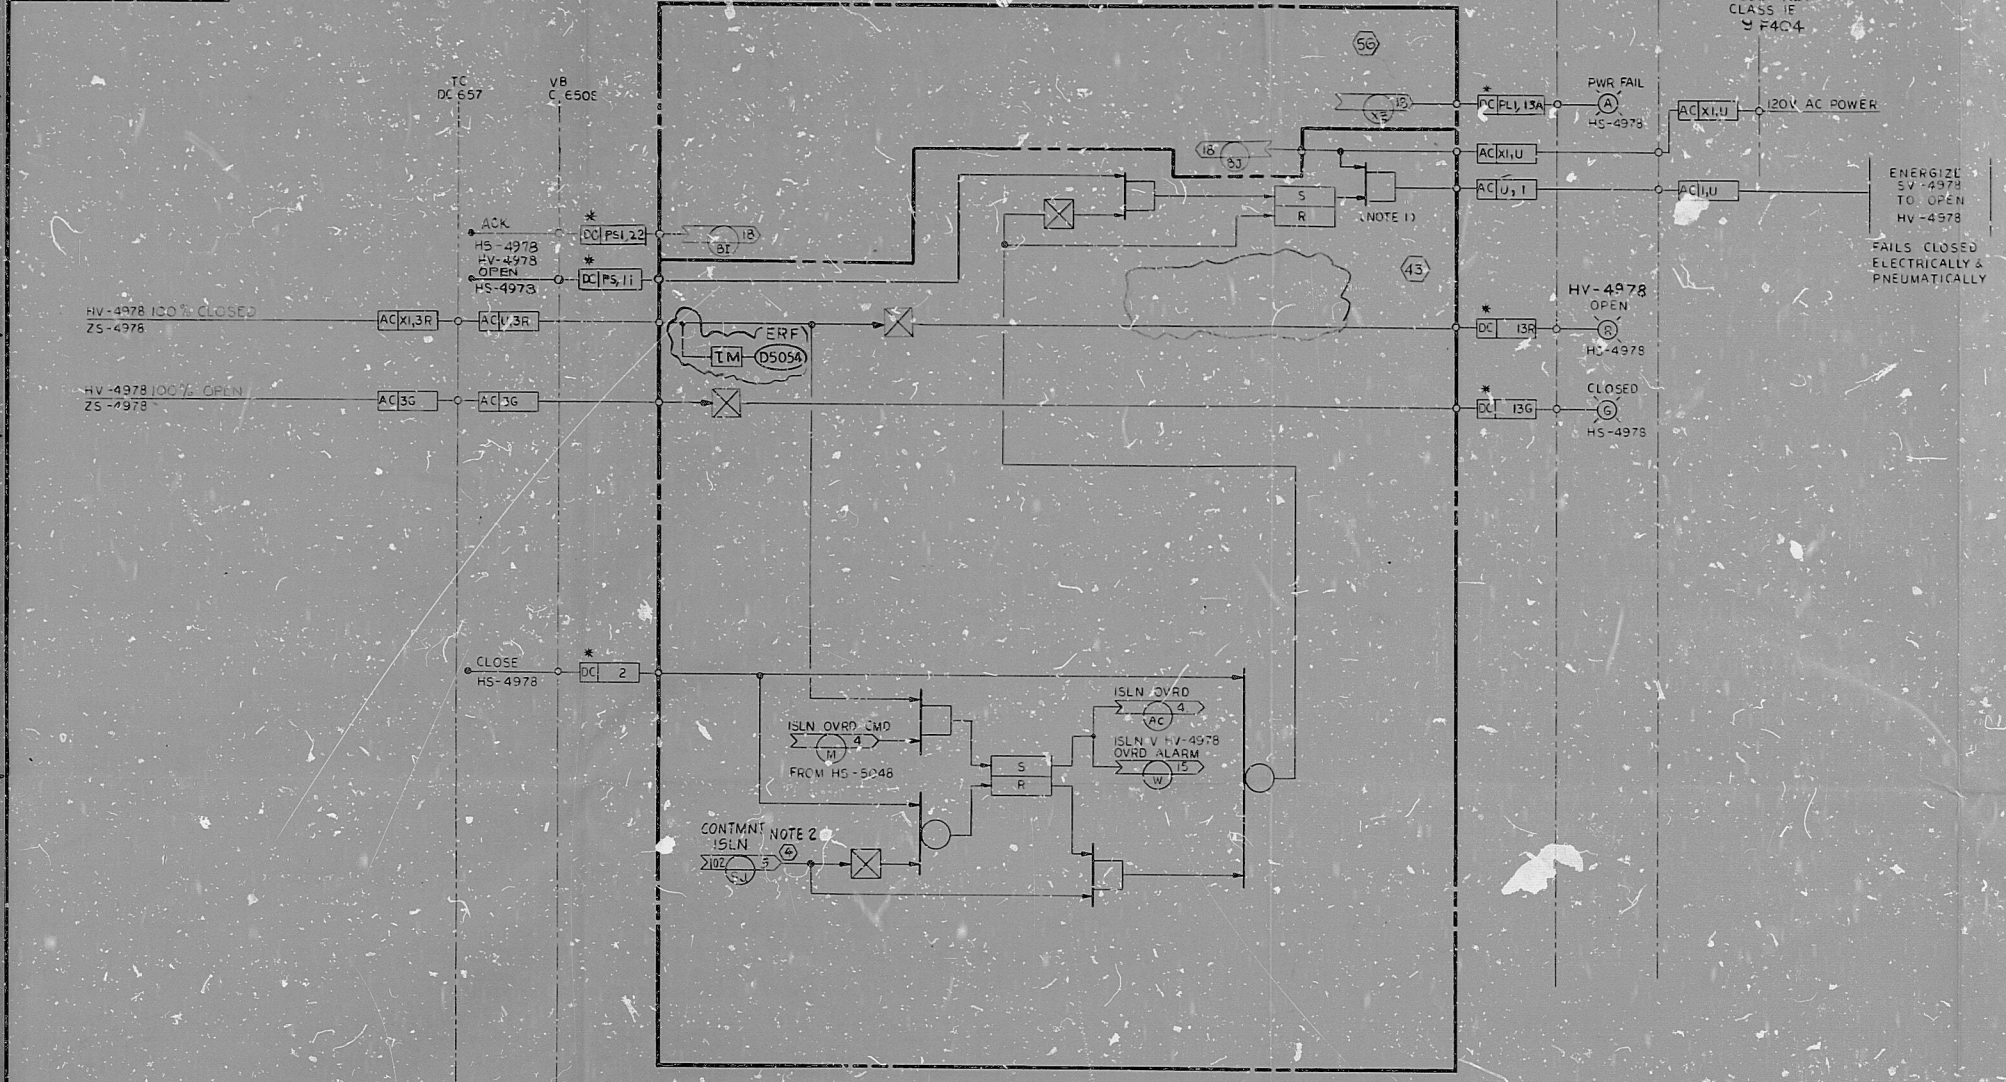

ISOLATION VALVE HV-4978
CLASS IE CHANNEL D

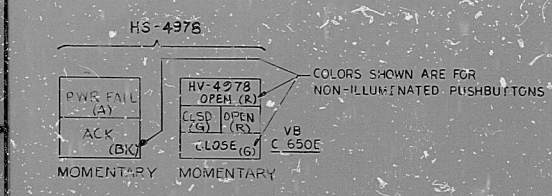

NOTES:

1. THIS "AND" GATE IS FORMED BY A CONTACT OF THE OUTPUT RELAY WHICH SWITCHES POWER SUPPLIED BY WIRE NO. X1.
2. CIRCUIT NO. APPLIES TO AND ORIGINATES ON J-102-0.

PRO APERTURE CARD

10/63	INCORPORATED DCN #11	DESIGNED	BY	DATE
11/72	DESIGN FREEZE ISSUE	DESIGNED	BY	DATE
1/74	REVISED SALES INTERFACE AS NOTED	DESIGNED	BY	DATE
4/74	INC DCN #1	DESIGNED	BY	DATE
1/77	REVISED AS NOTED	DESIGNED	BY	DATE
7/77	ISSUED FOR CONSTRUCTION	DESIGNED	BY	DATE
REVISIONS				
No.	DATE	BY	CHKD	ENGR
1				
2				
3				
4				
5				
6				
7				
8				
9				
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				
21				
22				
23				
24				
25				
26				
27				
28				
29				
30				
31				
32				
33				
34				
35				
36				
37				
38				
39				
40				
41				
42				
43				
44				
45				
46				
47				
48				
49				
50				
51				
52				
53				
54				
55				
56				
57				
58				
59				
60				
61				
62				
63				
64				
65				
66				
67				
68				
69				
70				
71				
72				
73				
74				
75				
76				
77				
78				
79				
80				
81				
82				
83				
84				
85				
86				
87				
88				
89				
90				
91				
92				
93				
94				
95				
96				
97				
98				
99				
100				

BECHTEL
SAN FRANCISCO

PUBLIC SERVICE ELECTRIC AND GAS COMPANY
MOPE CREEK GENERATING STATION

LOGIC DIAGRAM CONTAINMENT ATMOSPHERE CONTROL			
REACTOR BLDG. N2 SUPPLY ISLN VALVE			
JOB No.	DRAWING No.	REV.	
10855	J-57-0	SH-13	5 Q

SU-65

22 x 34 "D" SIZE

PDR RIDS

84 02 07 04 71

