


J-52-0 SHT. 7

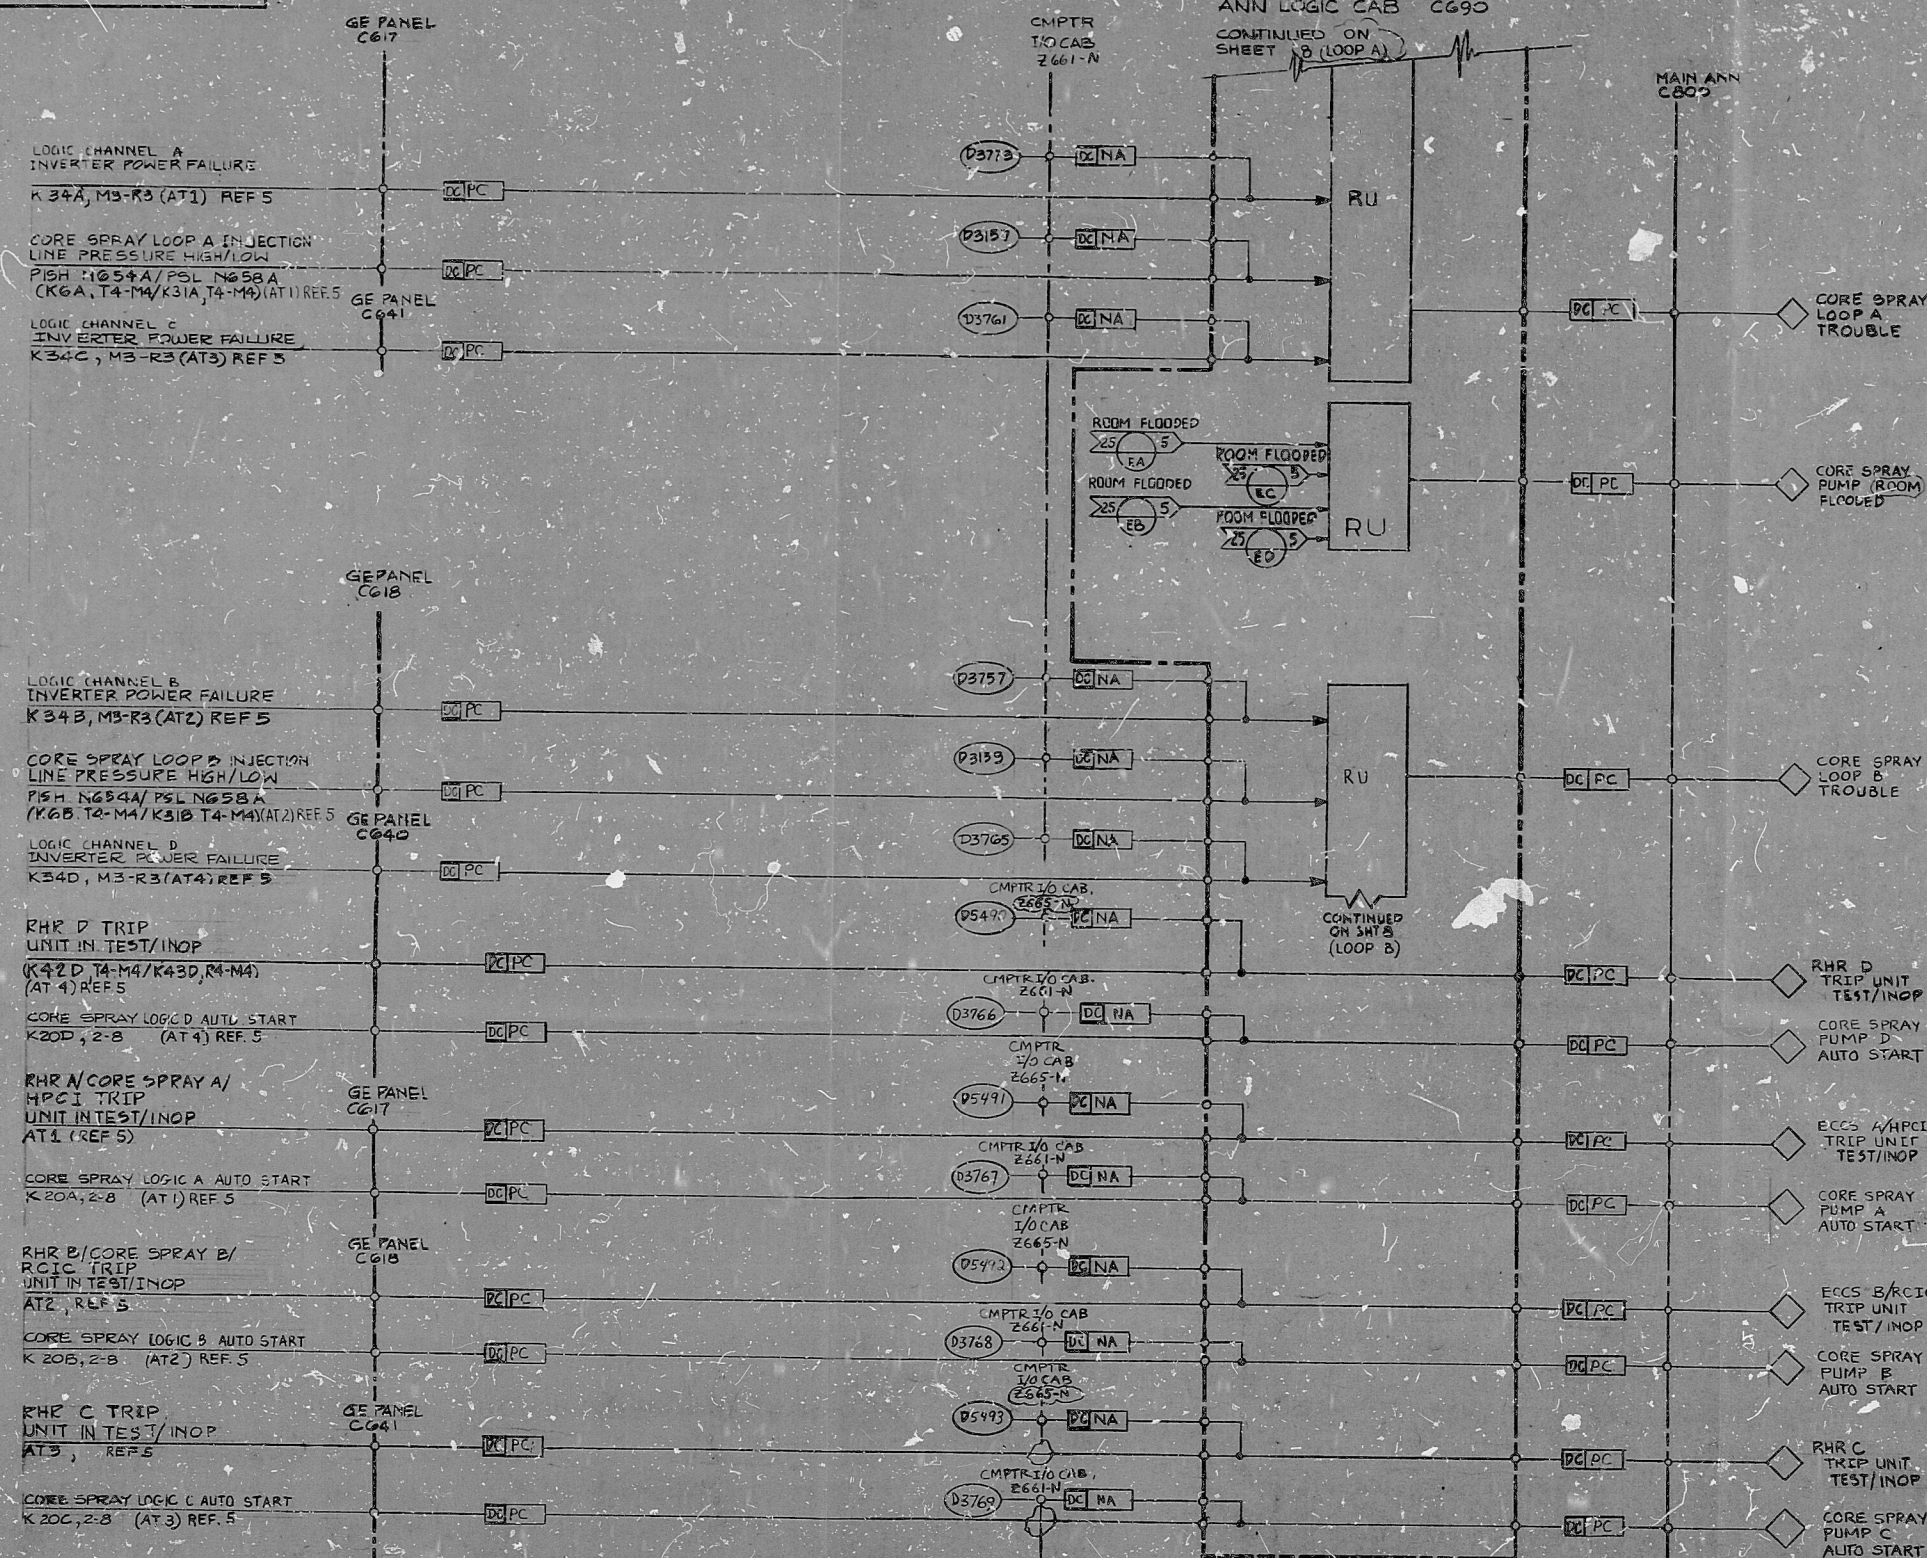

CORE SPRAY SYSTEM ALARMS

NO.	DATE	REVISION	BY	CHKD	RECHK	APPV	REAPPV
1	1/1/83	CHANGED COMP I/O CAB NO.	...	...	...	...	...
2	1/1/83	ENCLOS. ANN. WINDOW. SCHEMATIC GROUPING CHANGES. REV. AS NOTED	...	...	...	...	...
3	1/1/83	REVISED FOR ALARM PHILOSOPHY CHANGE	...	...	...	...	...
4	1/1/83	DESIGN FREEZE ISSUE	...	...	...	...	...
5	1/1/83	REDRAWN TO SHOW REVISED BAILEY INTERFACE	...	...	...	...	...
6	1/1/83	ISSUED FOR CONSTRUCTION	...	...	...	...	...
S I G N E D							
DEGTEL SAN FRANCISCO PUBLIC SERVICE ELECTRIC AND GAS COMPANY HOPE CREEK GENERATING STATION							
LOGIC DIAGRAM CORE SPRAY SYSTEM CORE SPRAY ALARMS							
JOB NO.	DRAWING NO.	REV.					
10055	J-52-0 SHT 7	5					

PDR RID

84020800 86

