


STOP SPRING RETURN TO NORM (SQ D CLASS 9001 TYPE (KS-57BH2))

NORM



START



NOTE

1. INDICATING LIGHTS TO BE SQUARE D CO. TYPE K, CLASS 9001 KP-38R9 (RED) OR KP-38G9 (GRN) AS REQ'D.

LOCAL CONTROL STATION (NOTE 1)

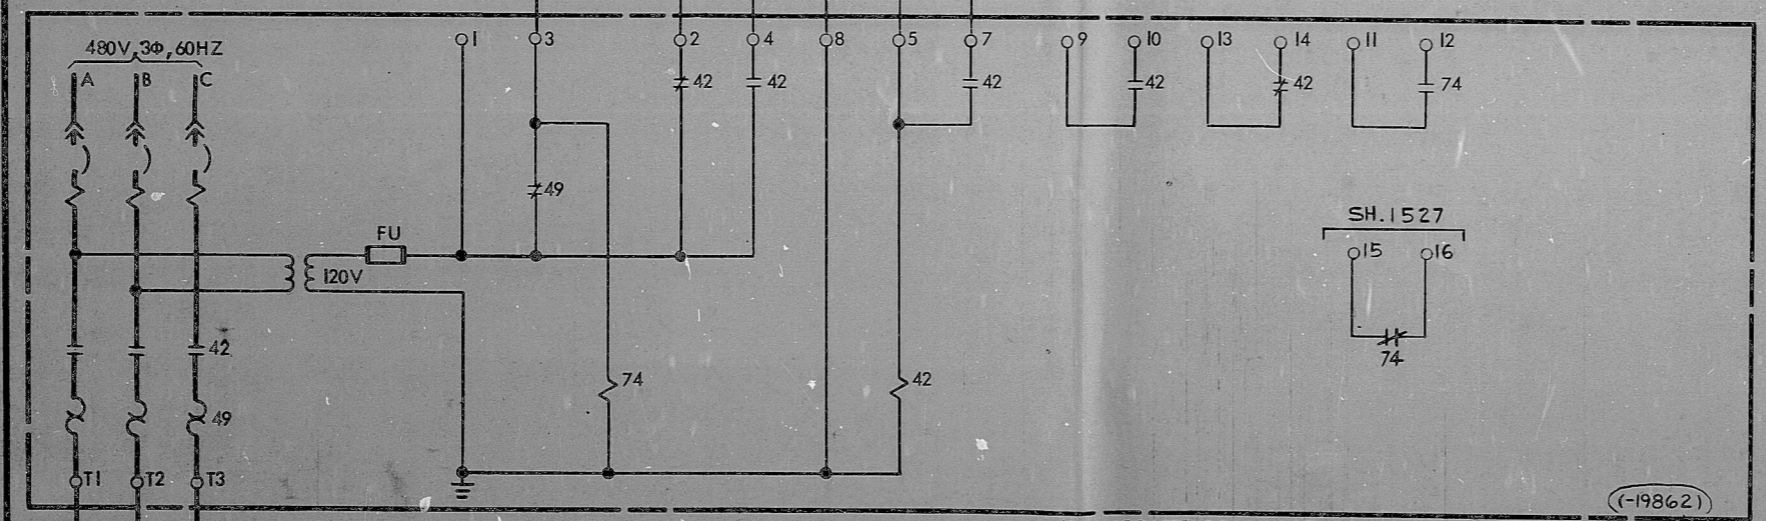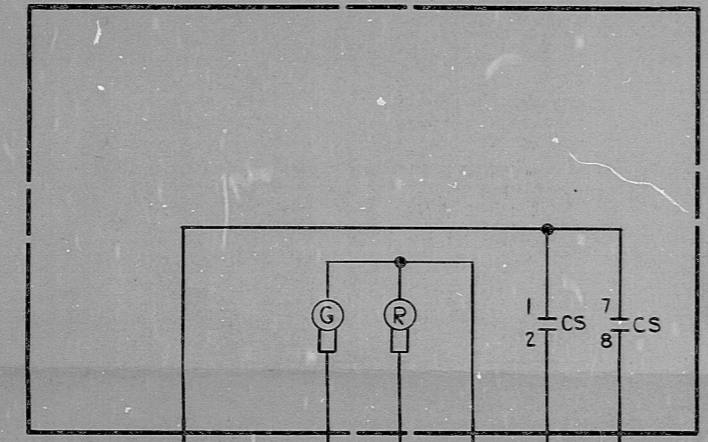

PRC APERTURE CARD

WPPSS QUALITY CLASS II

3	PCP35Q-03354
REV	PCP

5					
4					
3	3-11-82	W.A.			
2	10-20-80	G.S.			
1	4-23-80	A.R.			
REV	DATE	BY	APPROVED		

EBASCO SERVICES INCORPORATED

DIV. CONTROL DR. AAN

CH. A.R. RAO

DATE FEB 22, 1979

APPROVED

DD Price

WASHINGTON PUBLIC POWER SUPPLY SYSTEM

NUCLEAR PROJECTS NO. 3 & 5

CONTROL WIRING DIAGRAM

SPRAY CHEMICAL STORAGE TEST PUMP X

WPPS-3240

D-6001

SHEET 2298

RIDS

8303090657

