


VALVE LIMIT SWITCH DEVELOPMENT

DEVICE	VALVE OPENING %			CWD
	0	90	100	
33-1B UPPER	A-B			*
	C-D			*
	E-F			*
	G-H			*
33-3B INTER	A-B			*
	C-D			*
	E-F			*
	G-H			*
33-2B LOWER	A-B			*
	C-D			*
	E-F			*
	G-H			*

\* THIS SHEET

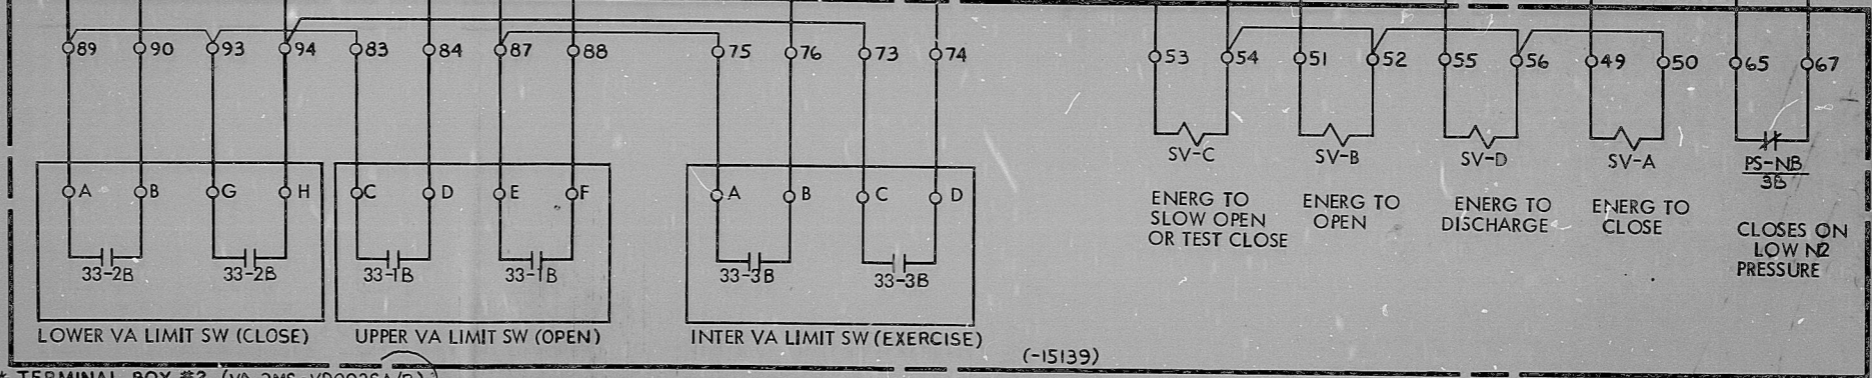

\* TERMINAL BOX #2 (VA 2MS-VDO03SA/B)

PRC  
APERTURE  
CARD

NUCLEAR SAFETY RELATED WPPSS QUALITY CLASS I

5 4 3 2 1 REV. DATE BY APPROVED			EBASCO SERVICES INCORPORATED DIV. CONTROL DR. HSM CH. V. ALKSNINIS DATE AUG 29, 1978	APPROVED 	WASHINGTON PUBLIC POWER SUPPLY SYSTEM NUCLEAR PROJECTS NO. 3 & 5 CONTROL WIRING DIAGRAM S.G.2 MAIN STEAM ISOL VA 2MS-VDO03SA/B ACTUATOR (SB)	WPPS-3240 D-6001 SHEET 2388
--	--	--	---	--------------	---	-----------------------------------

RIDS

8303090682

