


VALVE LIMIT SWITCH DEVELOPMENT

DEVICE		VALVE OPENING %			CWD
		0	90	100	
33-1A UPPER	A-B				*
	C-D				*
	E-F				*
	G-H				*
33-3A INTER	A-B				*
	C-D				*
	E-F				*
	G-H				*
33-2A LOWER	A-B				*
	C-D				*
	E-F				*
	G-H				*

\* THIS SHEET

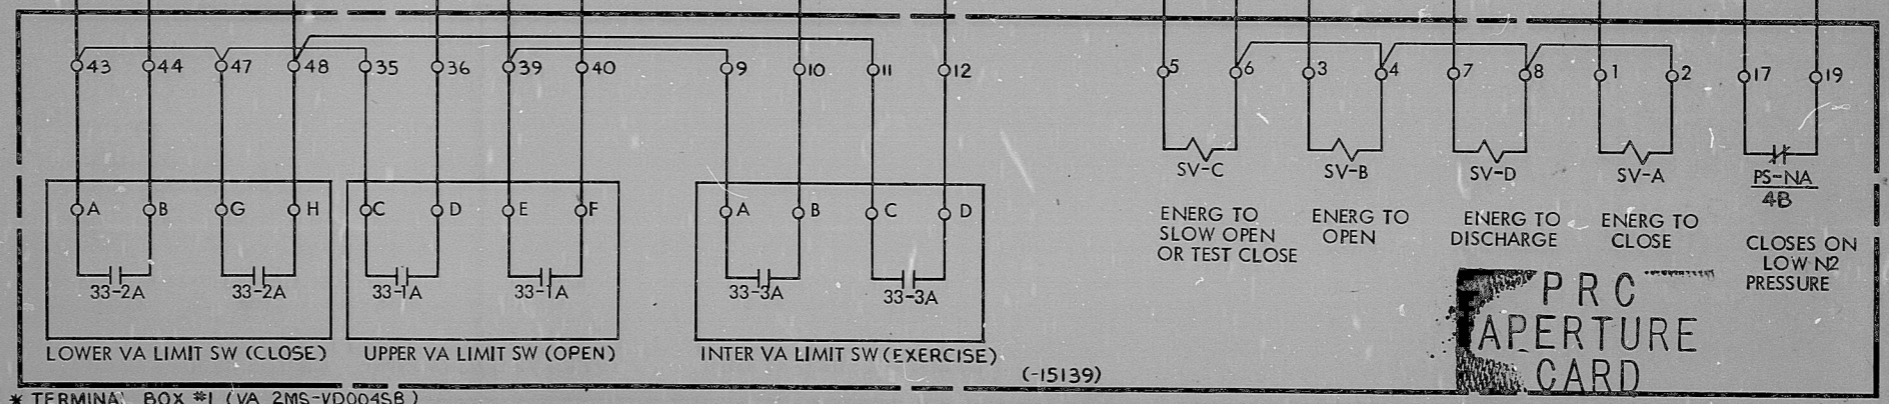

\* TERMINAL BOX #1 (VA 2MS-VD004SB)

NUCLEAR SAFETY RELATED WPPSS QUALITY CLASS I

EBASCO SERVICES INCORPORATED DIV. CONTROL DR. HSM CH. V. ALKSNINIS DATE AUG. 29, 1978		WASHINGTON PUBLIC POWER SUPPLY SYSTEM NUCLEAR PROJECTS NO. 3 & 5 CONTROL WIRING DIAGRAM SG#2 MAIN STEAM ISOL VA 2MS-VD004SB ACTUATOR (SA)		WPPS-3240 D-6001 SHEET 2389
REV. DATE BY APPROVED 2 10-15-81 RVP V.A. 5-22-81 RVP V.A.	APPROVED <i>[Signature]</i>			

**RIDS**

8303090684

