


VALVE LIMIT SWITCH DEVELOPMENT

DEVICE		VALVE OPENING %			CWD
		0	90	100	
33-1B UPPER	A-B				*
	C-D				*
	E-F				*
33-3B INTER	G-H				*
	A-B				*
	C-D				*
33-2B LOWER	E-F				*
	G-H				*
	A-B				*

\* THIS SHEET

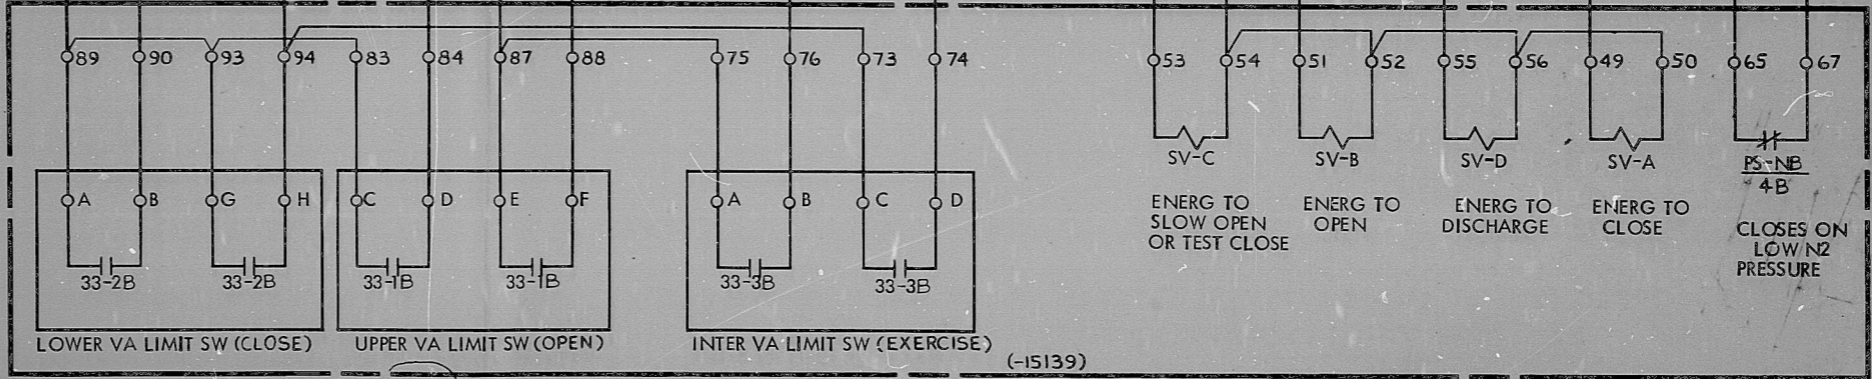

\* TERMINAL BOX #2 (VA 2MS-VD004SA/B)

PRC  
APERTURE  
CARD

NUCLEAR SAFETY RELATED		WPPSS QUALITY CLASS I	
5 4 3 2 1 5-14-82 5-22-81 DIV. CONTROL DR. HSM CH. V. ALKSNINIS DATE AUG. 29, 1978		WASHINGTON PUBLIC POWER SUPPLY SYSTEM NUCLEAR PROJECTS NO. 3 & 5 CONTROL WIRING DIAGRAM S.G.2 MAIN STEAM ISOL. VA. 2MS-VD004SA/B ACTUATOR (SB)	
APPROVED 		WPPS-3240 D-6001 SHEET 2390	

RIDS

8303090686

