


11
11
9.8
8.5
11
10
17

11
9.8
8.5
11
17

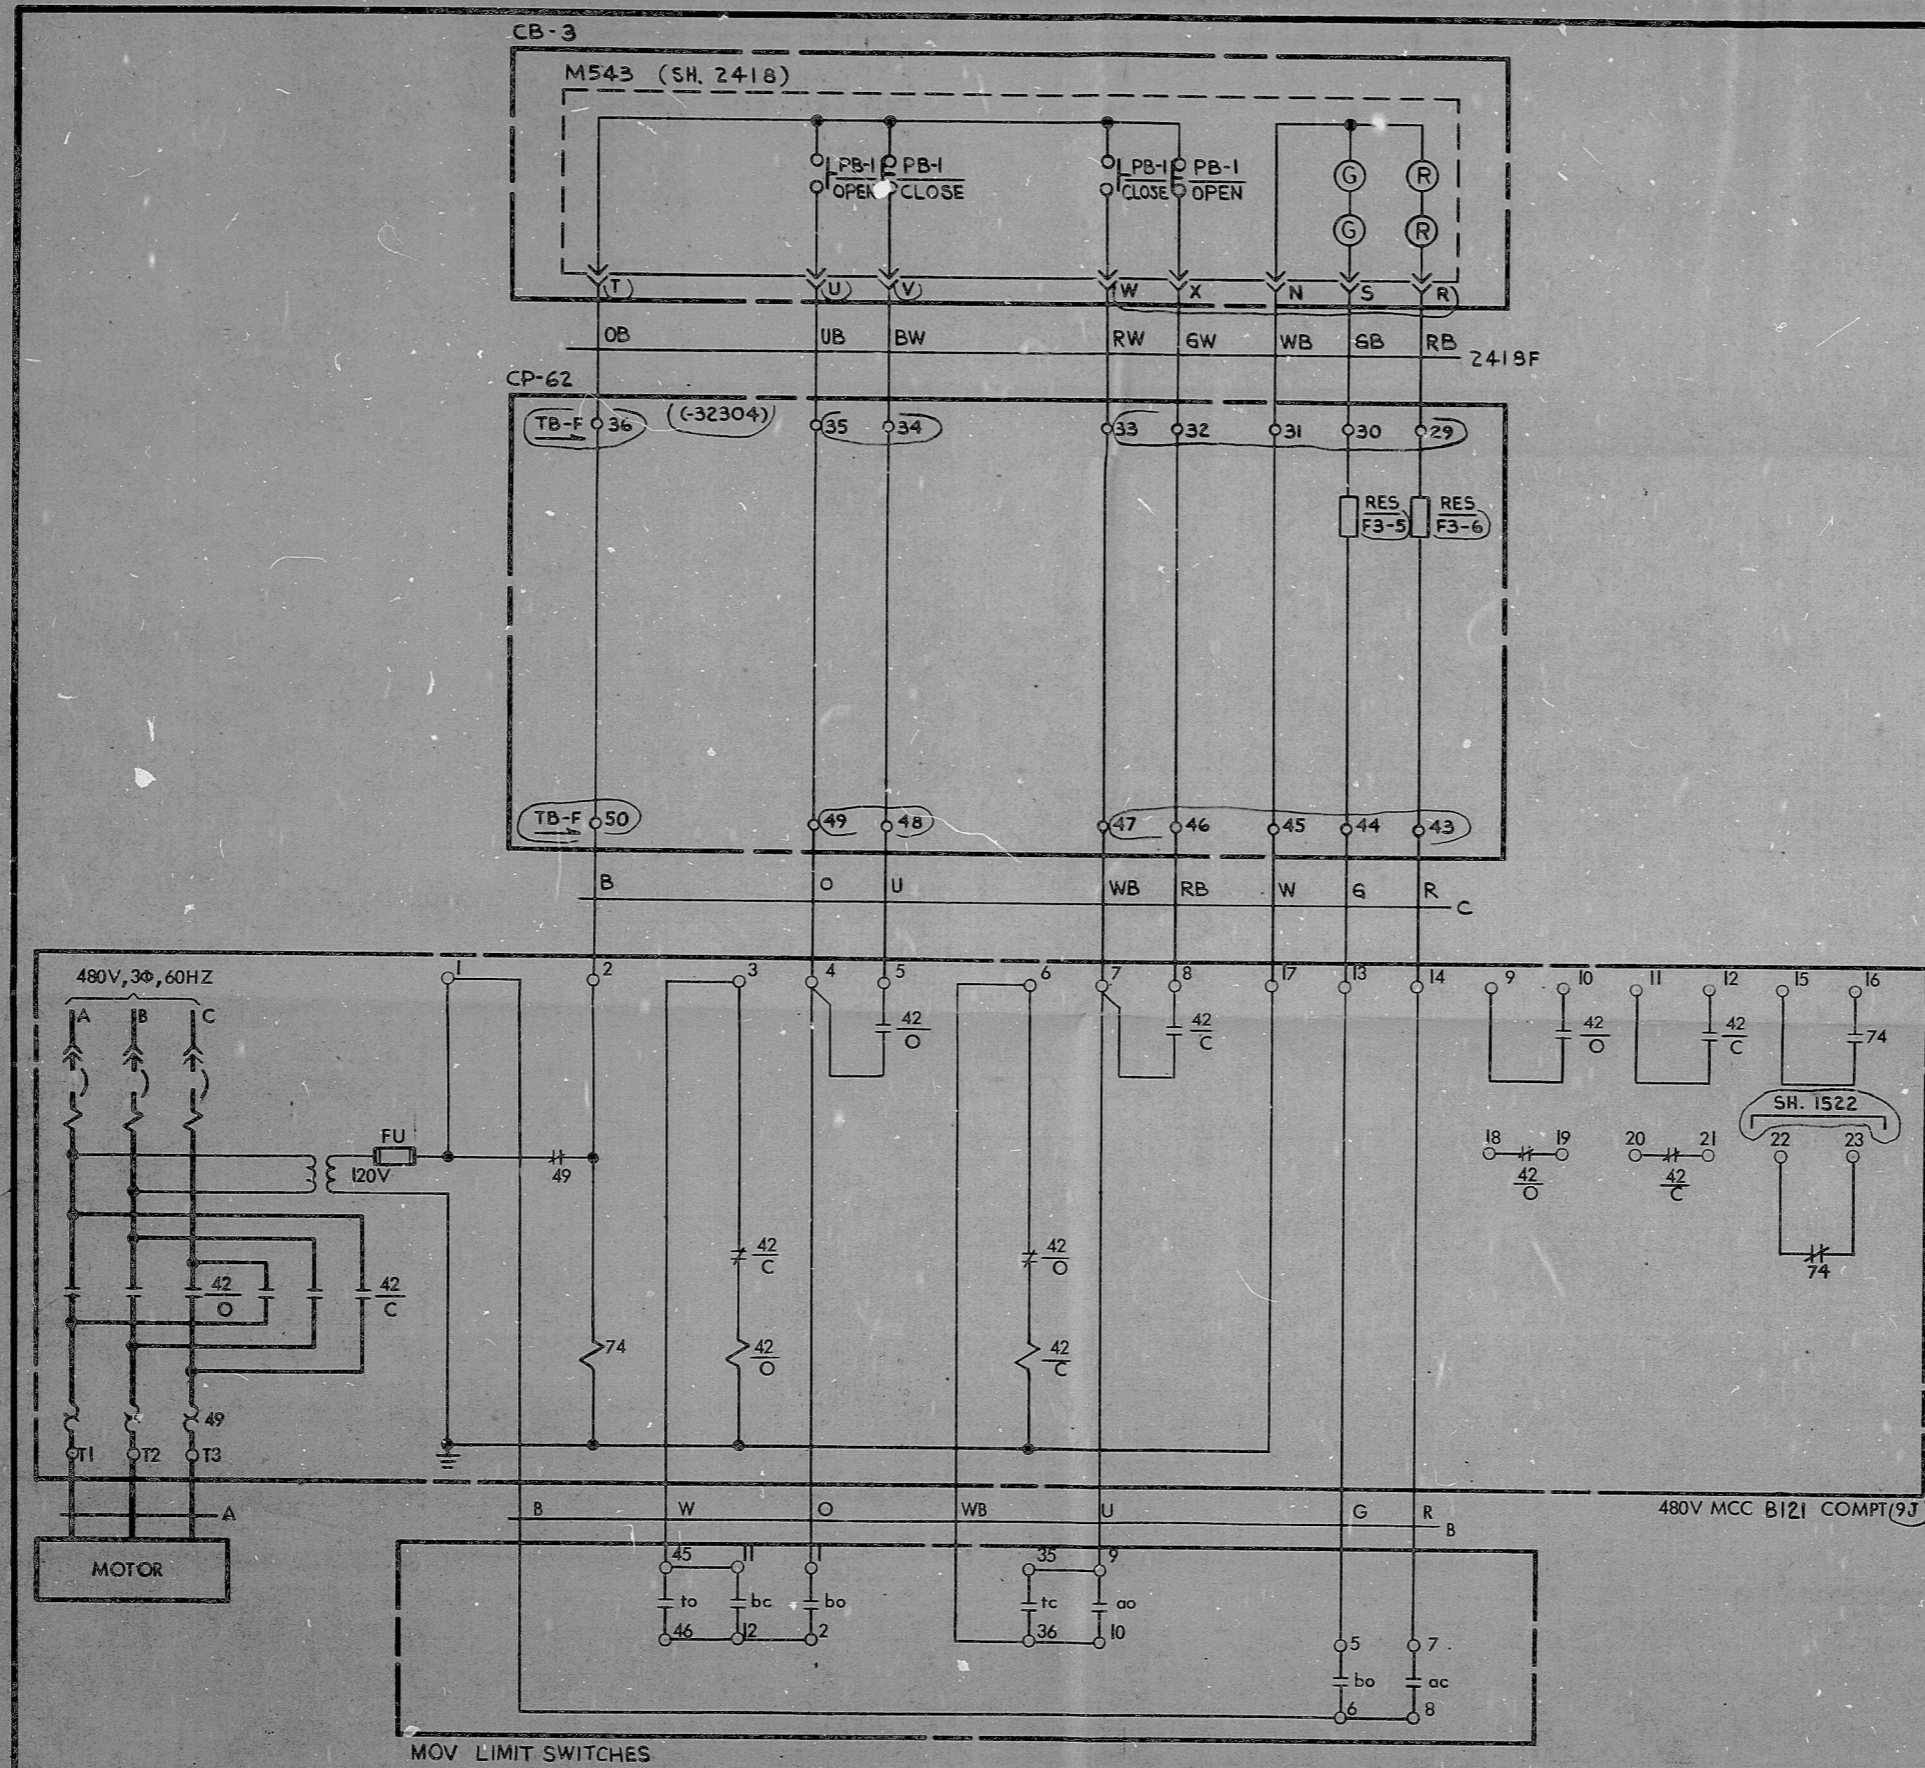

LIMIT SW DEVELOPMENT			
EBASCO SYMBOL	CONT.	VALVE OPNG. %	CWD SH.
bo	1-2		*
ac	3-4		*
bo	5-6		*
ac	7-8		*
ao	9-10		*
bc	11-12		*
ao	13-14		*
bc	15-16		*
a %	17-18		*
b %	19-20		*
a %	21-22		*
b %	23-24		*
a %	25-26		*
b %	27-28		*
a %	29-30		*
a %	31-32		*
1c	35-36	OPENS ON CLOSED ON CLOSE STROKE	*
1c	35-36	CLOSES ON OPENED ON OPEN STROKE	*
1c	45-46	OPENS ON OPENED ON OPEN STROKE	*
CONT. CLOSED * THIS SHEET			

PRC APERTURE CARD

WPPSS QUALITY CLASS II

5 4 3 2 1-16-81 1 1-10-80		EBASCO SERVICES INCORPORATED DIV. CONTROL DR. AAN CH. A. RRAO DATE JUNE 15, 1979		APPROVED <i>D. J. Price</i> LIP		WASHINGTON PUBLIC POWER SUPPLY SYSTEM NUCLEAR PROJECTS NO. 3 & 5 CONTROL WIRING DIAGRAM STM GEN 2-N2 SUPPLY TO MS VA 2MS-VC165B		WPPS-3240 D-6001 SHEET 2366	
---------------------------------------	--	--	--	---------------------------------------	--	---	--	-----------------------------------	--

NOTE 10 1280 11-74 400230

RIDs

8303090711

