

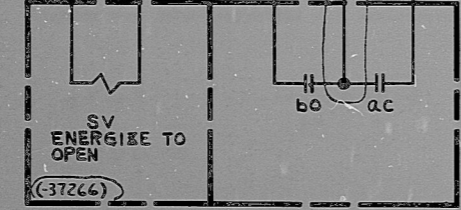
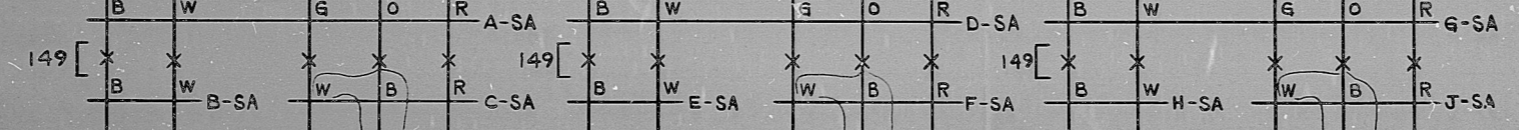
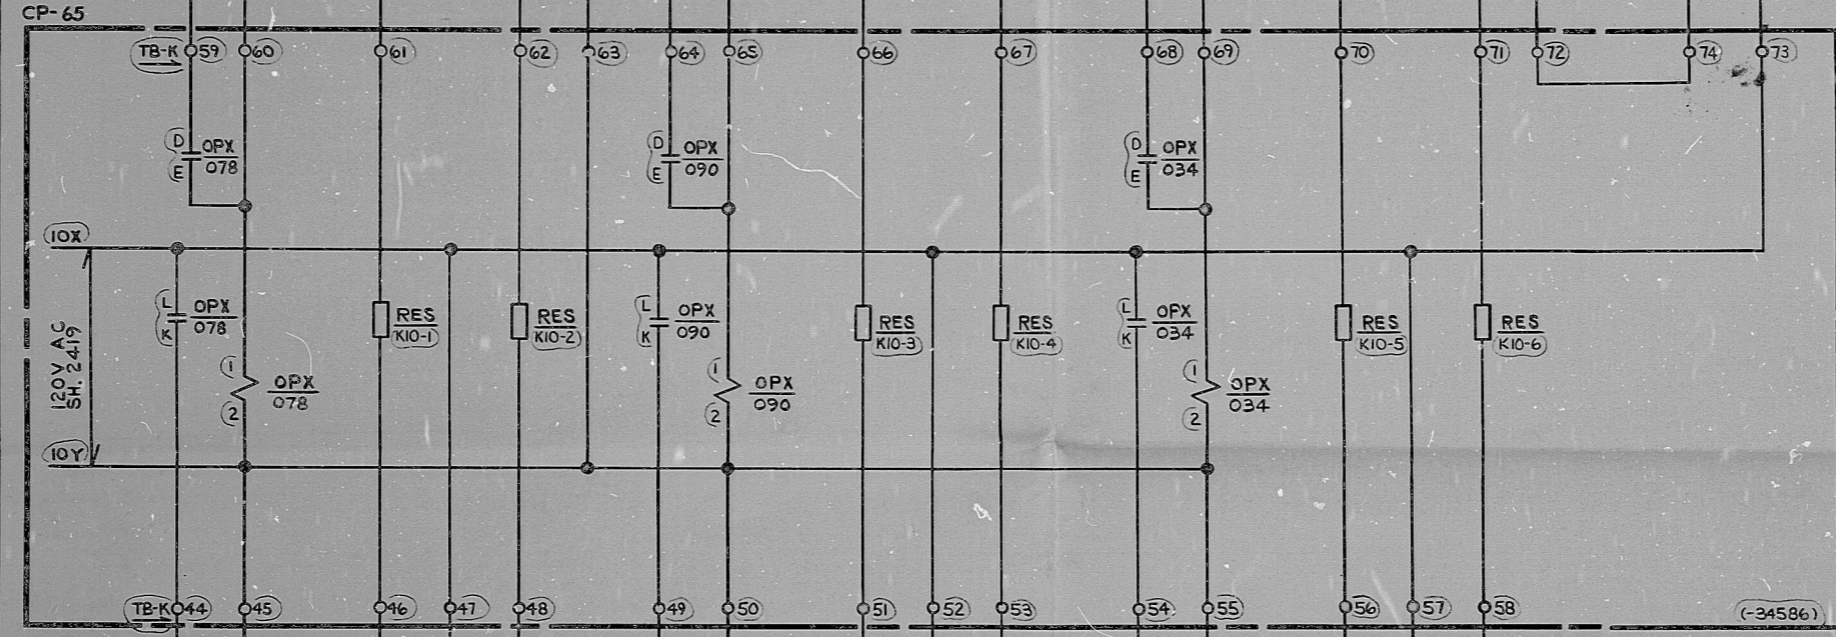



FIG 10 1283 4-77 414180

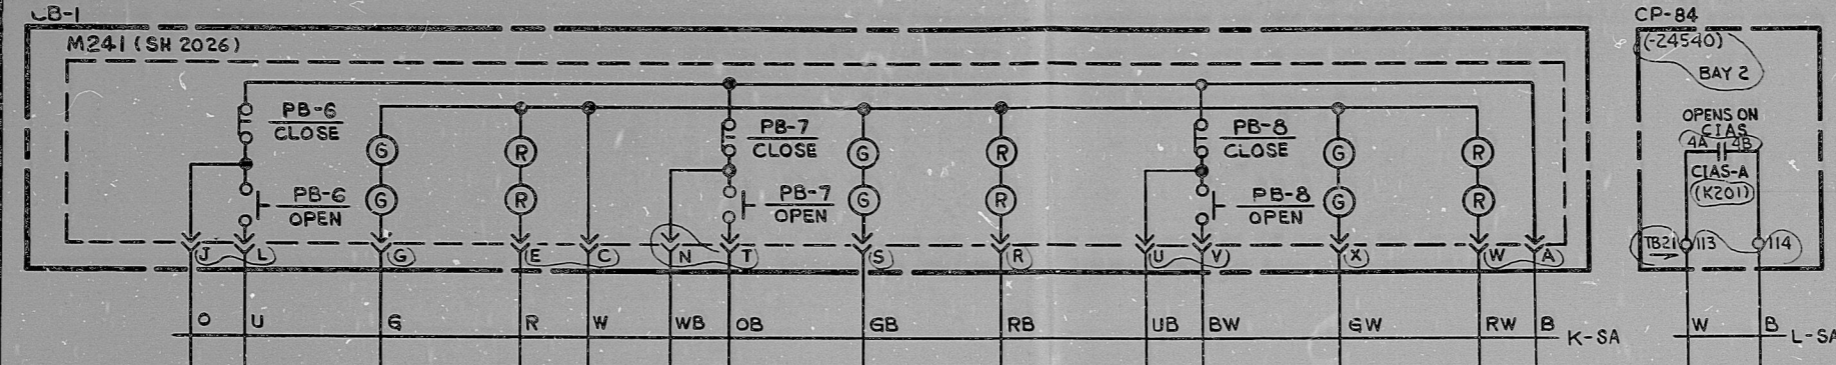

SG2 SAMPLE ISOLATION VA 2BD-VS078SA

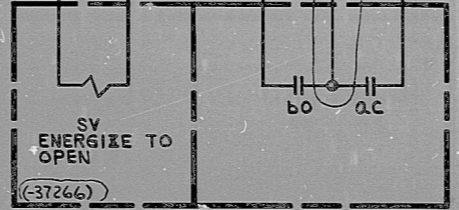


SG2 HOT LEG SAMPLE ISOLATION VA 2BD-VS090SA

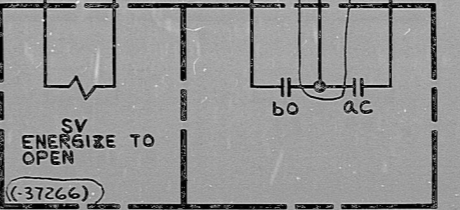

SG2 COLD LEG SAMPLE ISOLATION VA 2BD-VS034SA

PRC APERTURE CARD



NUCLEAR SAFETY RELATED WPPSS QUALITY CLASS I

5					
4					
3					
2	10-15-81	REV	BY	APPROVED	
1	4-23-80	REV	BY	APPROVED	
REV.	DATE	BY	APPROVED		

EBASCO SERVICES INCORPORATED

DIV. CONTROL DR. C. KIM

CH. A. R. RAO

DATE NOV 10, 1978

APPROVED

[Signature]

WASHINGTON PUBLIC POWER SUPPLY SYSTEM

NUCLEAR PROJECTS NO. 3 & 5

CONTROL WIRING DIAGRAM

SG2 SAMPLE ISO VA 2BD-VS078SA, -VS090SA & -VS034SA

WPPS-3240

D-6001

SHEET 24-23

RIDs

8303100116

