

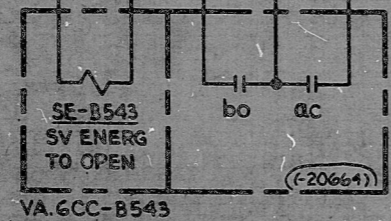



CB-4
(-30374, -30384, -30395)

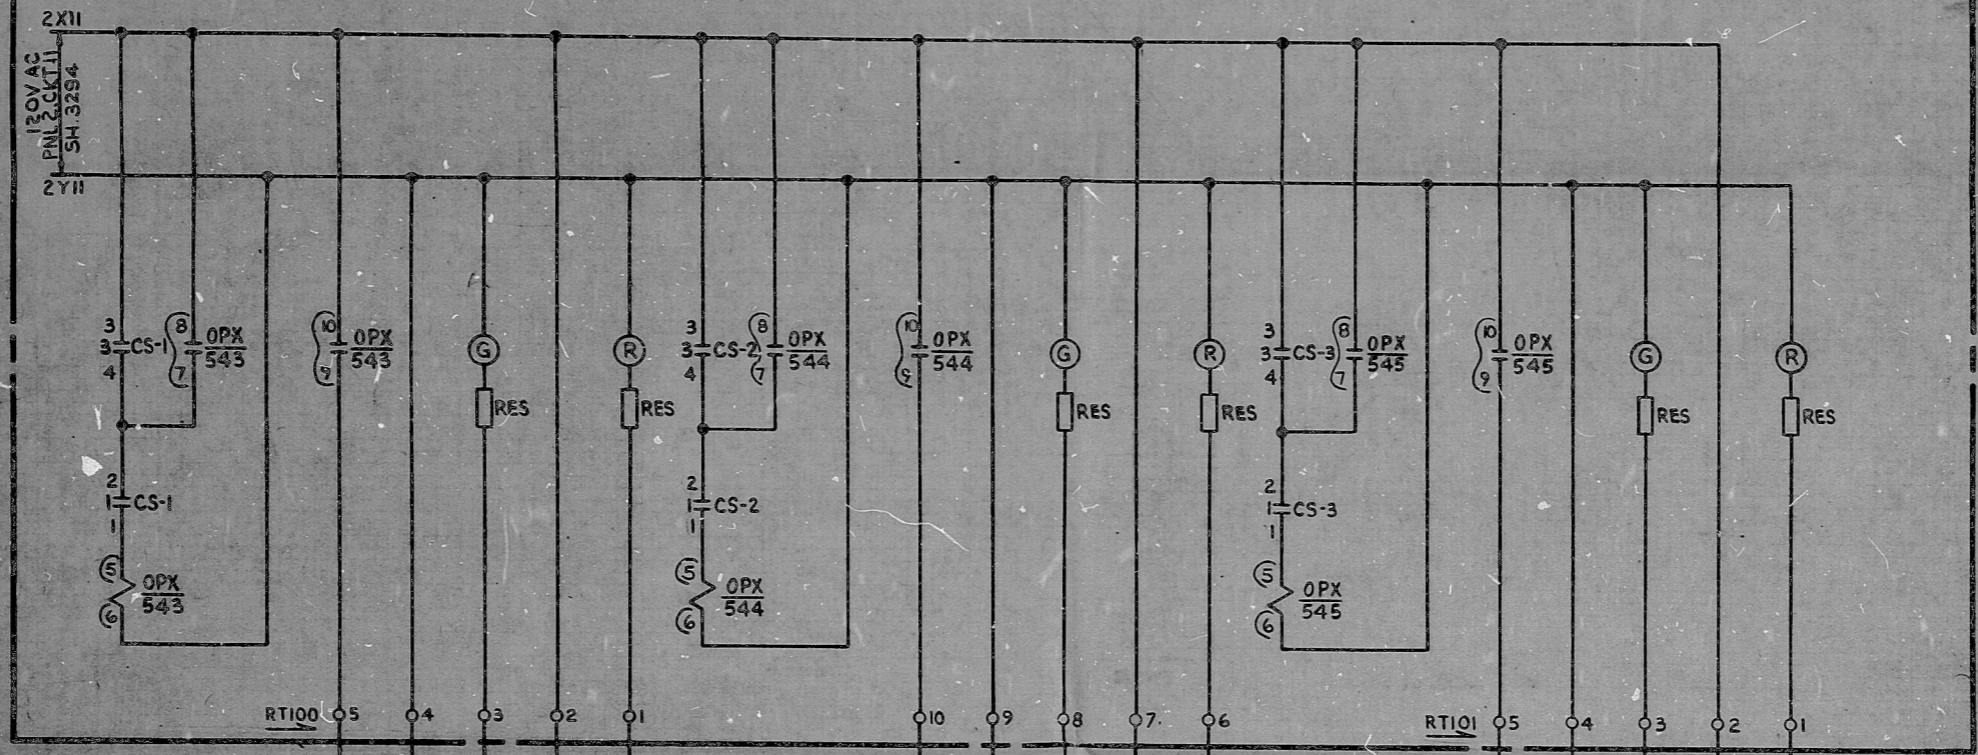

VA.GCC-B543
VOL. REDUCTION PACKAGE

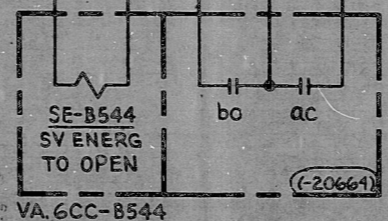

VA.GCC-B544
FLOOR DRN SUB-COOLER & COND. INLET

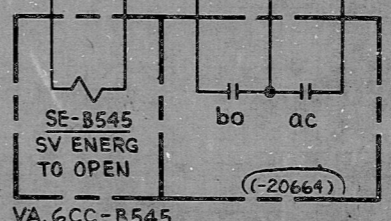

VA.GCC-B545
BORIC ACID CONCENTRATOR INLET


CS-1, CS-2, CS-3

CONTACT	POSITION FRONT VIEW			CWD
	CLOSE	NORM	OPEN	
1		X	X	*
2	X		X	
3			X	*

RETURN TO NORMAL
* - THIS SHEET

PRC
APERTURE
CARD

POOR ORIGINAL

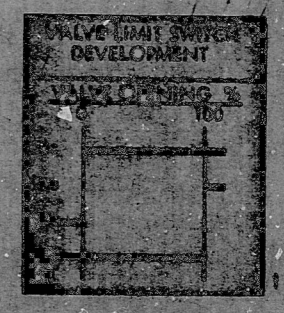

WPPSS QUALITY CLASS II			
EBASCO SERVICES INCORPORATED		WASHINGTON PUBLIC POWER SUPPLY SYSTEM	
1-29-82 2-9-80 2-8-79	DIV. CONTROL DR. EF CH. R. GHATAK	APPROVED <i>N. Wallach</i> 6/21/77	NUCLEAR PROJECTS NO. 2-2-5 CONTROL WIRING DIAGRAM NNS HX VA 6CC-B543, 6CC-B544, 6CC-B545
REV. DATE BY APPROVED	DATE AUG 31, 1977	NNS HX VA 6CC-B543, 6CC-B544, 6CC-B545	WPPSS-3240 D-0001 SHEET 2527

RIDS

8303100212

