
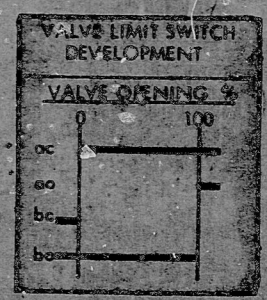
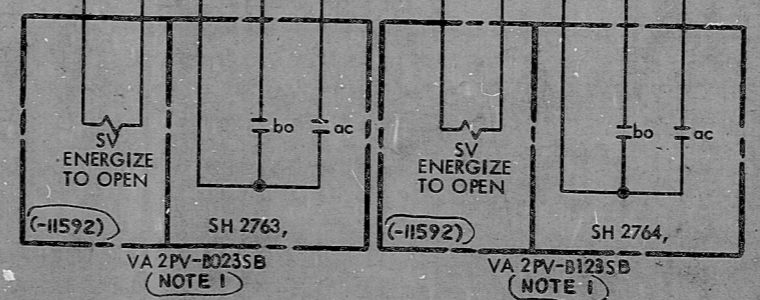


NOTE
1. FIELD TO VERIFY SOLENOID VOLTAGE BEFORE ENERGIZING.

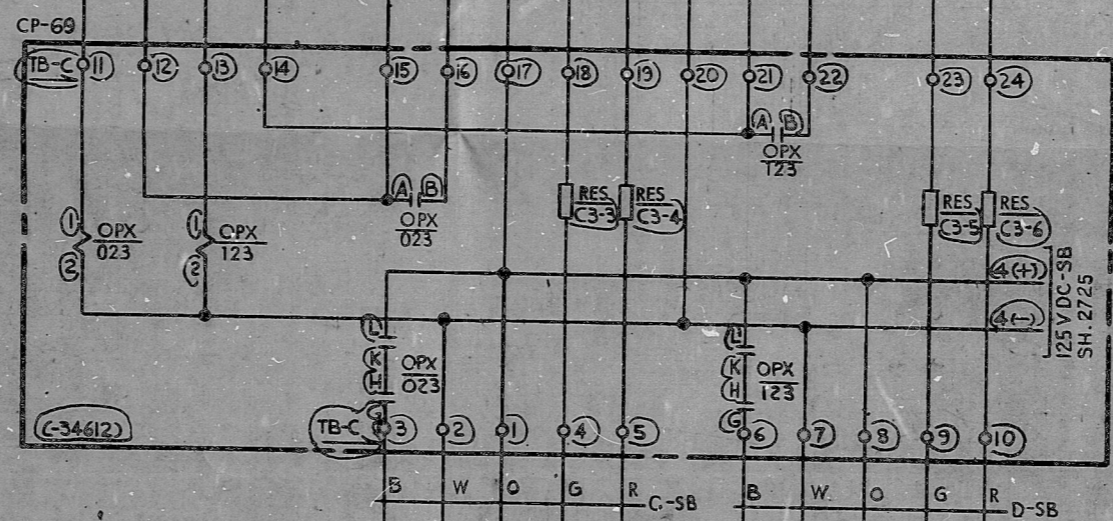

PRO APERTURE CARD

5 4 3 2 1 4-8-82 4-23-80 DATE BY APPROVED DIV. CONTROL DR. A.M. CH. W. ARNHEITER DATE NOV. 21, 1978 APPROVED W.A.		NUCLEAR SAFETY RELATED WPPSS QUALITY CLASS I WASHINGTON PUBLIC POWER SUPPLY SYSTEM NUCLEAR PROJECTS NO. 3 & 5 CONTROL WIRING DIAGRAM ANNULUS VACUUM MAINTENANCE CONTAINMENT ISOL. VA 2PV-B1235B & 2PV-B1235B		WPPSS-3240 D-0001 17
---	--	--	--	----------------------------

RIDS

8303100445

