

CS


CONTACT	POSITION FRONT VIEW			CWD
	ΦA	OFF	ΦC	
1	X			0589
2			X	0589
3	X		X	0589
4		X		

SS (DIESEL LOADING TEST)

CONTACT	POSITION FRONT VIEW						CWD
	OFF	LB2	LB3	LB4	LB5	LBM	
1	X						0589
2		X					0589
3			X				0589
4				X			0589
5					X		0589
6						X	0589
7	X						0589
8		X					0589
9			X				0589
10				X			0589
11					X		0589
12						X	0589

MAINTAINED CONTACT
* - THIS SHEET

MAINTAINED CONTACT
GRAYHILL SERIES 44

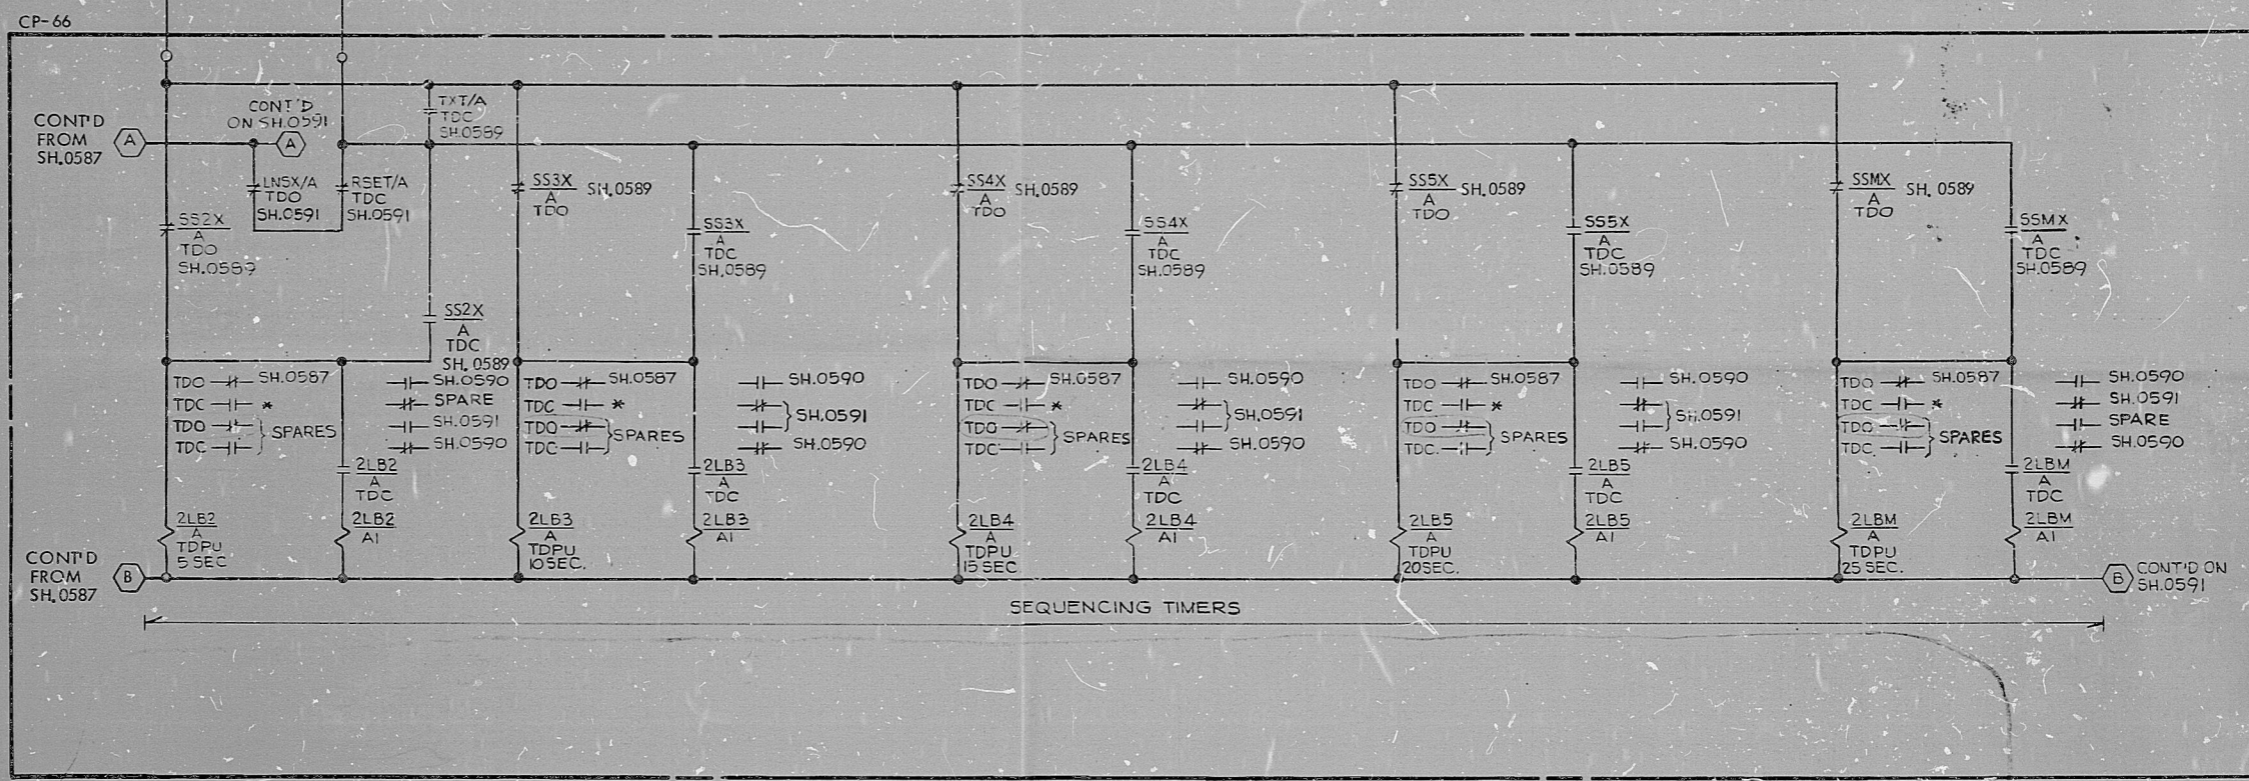

PRC
APERTURE
CARD

5		EBASCO SERVICES INCORPORATED		WASHINGTON PUBLIC POWER SUPPLY SYSTEM		WPPSS-3240	
4		DIV. CONTROL DR. A AN		APPROVED		D-5001	
3		CH. V. ALKSNINIS		<i>[Signature]</i>		NUCLEAR PROJECTS NO. 3 & 5	
2		DATE JUN. 22, 1977		LH PANELS		CONTROL WIRING DIAGRAM	
1		REV. DATE BY APPROVED		EMER. DIESEL GENERATOR A-SA		SEQUENTIA L. LOADING SH. 2	
9-7-75		A.R. [Signature]		[Signature]		SHEET 0588	

K&E 10 1287 11-74 409334

RIDS

8303160277

