



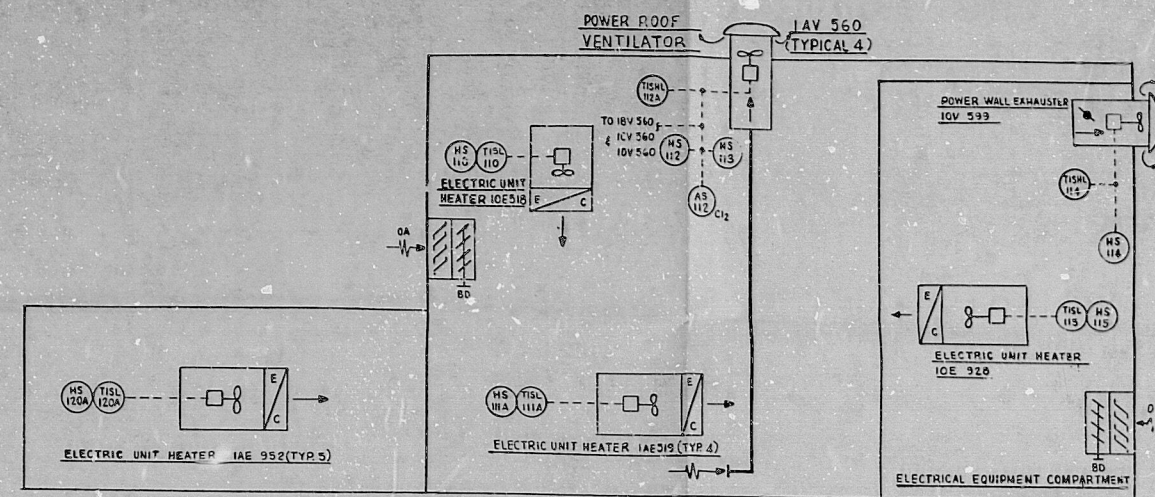

CIRCULATING WATER CHLORINATION AND
ACID FEED ENCLOSURE

ELECTRIC UNIT HEATER	INST NO.	POWER ROOF VENTILATOR	INST NO.
IAE 519	III A	IAV 560	II2 A
IRE 519	III B	IBV 560	II2 B
ICE 519	III C	ICV 560	II2 C
IDE 519	III D	IDV 560	II2 D

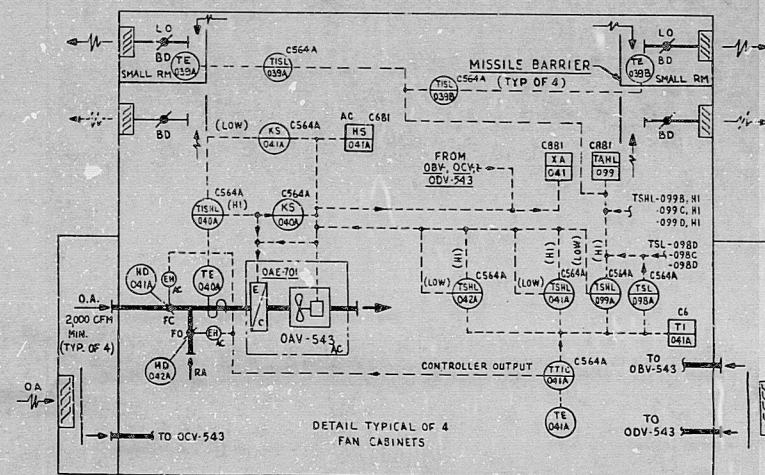


NOTES:

1. DIESEL GENERATOR ENCLOSURE H & V SYSTEM IS CLASS I SEISMIC EXCEPT FOR THE UNIT HEATERS WHICH HAVE ONLY CLASS I SEISMIC SUPPORTS.
2. SPRAY POND PUMP STRUCTURE H & V SYSTEM IS CLASS I SEISMIC.

REVISION 7 OF THIS PRD REQUIRES REVISION OF THE FOLLOWING RELATED DOCUMENTS:

QAD	YES ☒	NO ☐	NA ☐
FD TEXT	YES ☒	NO ☐	NA ☐
LOGIC DIAGRAM	YES ☒	NO ☐	NA ☐

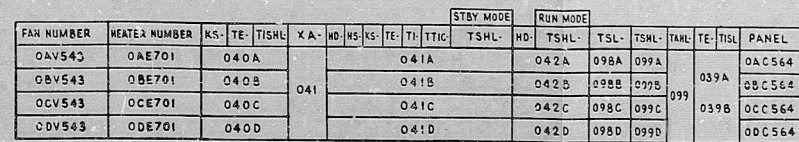

TERA
APERTURE
CARD

[illegible]

RIDS

8110070585

